



# Setu Operations



# CENTRILOGIO<sup>®</sup>

b LIQUI CONTROL<sup>®</sup>

# Table des matières

Ressources dans ce guide .....	4
Aperçu du registre .....	5
Mises à jour de publication .....	6
Procédures de sécurité .....	7
Protection ESD .....	9
Spécifications .....	11
Réglementation et certifications .....	16
Conformité FCC .....	20
Dimensions - Montage sur panneau .....	23
Dimensions - Montage compteur .....	25
Configuration et fonctionnement .....	27
Contrat de licence logicielle .....	31
Informations opérationnelles & menu principal .....	32
Dispositions des écrans de livraison .....	33
Types d'écran d'affichage .....	36
Interface clavier .....	39
Détails de livraison .....	45
Diagnostics .....	55
Menu .....	59
configuration .....	59
Paramètres du registre .....	59
Paramètres du compteur .....	76
Paramètres d'étalonnage .....	84
Sécurité .....	95
Configuration E/S .....	97
Personnaliser l'écran d'accueil .....	103
Configurer la configuration de livraison .....	106
Utilisation du registre .....	110
Effectuer une livraison de base .....	110
Effectuer une livraison prédéfinie - Touche prédéfinie .....	111
Utilisation du bouton Info .....	111
Effectuer une livraison prédéfinie - Configuration de livraison .....	112
Utilisation de la fonction de réinitialisation du tuyau .....	114
Étalonnage à un point .....	114
Étalonnage multipoints .....	116
Réglage du temps de fermeture S1 .....	117
Configuration des options de ticket de livraison .....	118
Imprimer le ticket précédent .....	119
Mise à jour du micrologiciel par USB .....	120
Effectuer une procédure de remise à zéro complète .....	123
Imprimer une transaction .....	124
Configurer des profils personnalisés .....	125
Imprimer un ticket de diagnostic .....	126
Annexe A : Tableau du facteur K (Pulse/Unité) .....	128
Annexe B : Types de données .....	129

## Guides de produits LCR.iQ/MasterLoad.iQ

Félicitations pour l'acquisition du nouveau registre-contrôleur électronique LCR.iQ ou MASTERLOAD.iQ. Ce manuel fournit les détails techniques concernant l'installation, le matériel, la configuration, l'utilisation et les informations réglementaires de votre registre.

**REMARQUE :** Dans tout ce manuel, le LCR.iQ et le MASTERLOAD.iQ sont désignés par le terme « Register » (sauf mention expresse contraire du nom spécifique).

Le registre calcule, surveille et enregistre les données volumétriques des débitmètres de vrac, permet la personnalisation et l'automatisation des processus de transfert de fluide, intègre les capteurs et entrées critiques du système, et assure la communication des données entre l'opérateur, l'équipement et le système back-office de l'opérateur si nécessaire.

Le Register est spécialement conçu pour fonctionner avec les principaux compteurs de carburant en vrac tels que LC et Avery-Hardoll, mais peut facilement être adapté à des systèmes existants utilisant d'autres marques de débitmètres.

Le Register offre de nombreuses nouvelles fonctionnalités, tout en maintenant une compatibilité descendante avec le LCR-II et LCR-600.



## Ressources dans ce guide

Vous pouvez facilement télécharger les versions PDF du Guide d'installation, du Guide de configuration et d'utilisation, et des schémas de câblage en cliquant sur les liens ci-dessous.

Sinon, vous préférerez peut-être commencer par la Présentation du Register [5](#), ou passez directement à parcourir à la fois le Guide d'installation et le Guide de configuration et d'utilisation [27](#).

## Guides Adobe PDF

Téléchargez l'un ou l'autre des guides en utilisant les liens ci-dessous :

- [Guide d'installation](#)
- [Guide de configuration et d'utilisation](#)

## Schémas de câblage

Téléchargez une version PDF haute résolution de ces schémas de câblage :

- [Carte Révision E - Téléchargez le schéma de câblage pleine grandeur.](#)
- [Carte Rev J - Télécharger le schéma de câblage en taille réelle.](#)

## Aperçu du registre

Le Registre est un enregistreur électronique de débitmètre à microprocesseur qui peut être utilisé pour des opérations de transfert de custody approuvées par les Services des Poids et Mesures dans des installations mobiles ou fixes. Le Registre est une unité autonome. Toutes les fonctions d'opération, de configuration et de paramétrage peuvent être réalisées à l'aide des touches de fonction et du clavier alphanumérique du Registre. Aucun pavé tactile, ordinateur portable ou autre dispositif de saisie de données n'est requis.

Un système complet de débitmètre Liquid Controls mesure non seulement le produit avec précision, mais il régule également le débit du produit et élimine les contaminants afin de créer les conditions optimales pour la mesure. Les systèmes typiques incluent un éliminateur d'air/vapeur, un tamis, un débitmètre, un registre et une vanne de régulation.

## Fonctions de base

Les fonctions principales des registres incluent :

- Transfert de custody poids et mesures (livraison de produit et génération de ticket)
- Collecte de données métrologiques
- Livraisons prédéfinies par volume
- Sélection de produits multiples
- Étalonnage multipoint de débitmètre
- Paramètres de sécurité
- Élimination d'air et de vapeur (avec accessoires appropriés)
- Contrôle de vanne mono-étage et bi-étage (avec accessoires appropriés)
- Compensation Électronique du Volume par la Température (ETVC)

## Mises à jour des publications

Les versions les plus récentes de toutes les publications de Liquid Controls sont disponibles sur notre site web, [www.LCmeter.com/resources/technical/manuals](http://www.LCmeter.com/resources/technical/manuals) . Si vous avez des questions concernant la langue ou l'interprétation des manuels, instructions ou fiches techniques LC, veuillez d'abord contacter votre distributeur local pour obtenir de l'aide concernant votre demande.

Pour les problèmes de service nécessitant un support supplémentaire de la part de l'équipe de service Liquid Controls, Veuillez appeler le numéro ci-dessous.

Siège social de Liquid Controls :

Téléphone : +1 847 295-1050 Sans frais : 800 458 5262 Adresse : Liquid Controls LLC, 105 Albrecht Drive, Lake Bluff, IL 60044, USA Site web : [www.LCmeter.com](http://www.LCmeter.com)

## Procédures de sécurité



### SOYEZ PRÊT

Avant d'utiliser ce produit, lisez et comprenez les instructions. · Tous les travaux doivent être effectués par du personnel qualifié formé à la

l'application, l'installation et la maintenance des équipements et/ou systèmes conformément à tous les codes et règlements applicables.

· Lors de la manipulation de composants/cartes électroniques, utilisez toujours un équipement de protection contre les décharges électrostatiques (ESD) approprié et suivez les procédures adéquates.

Assurez-vous que toutes les précautions de sécurité nécessaires ont été prises. · Assurez une ventilation adéquate, un contrôle de la température, une prévention des incendies, une évacuation, et de gestion des incendies.

Assurez un accès facile aux extincteurs appropriés pour votre produit. · Consultez votre service d'incendie local ainsi que les codes étatiques et municipaux pour vous assurer une préparation adéquate.

Lisez ce manuel et toute la documentation fournie dans votre dossier du propriétaire. · Conservez ces instructions pour référence future. · Le non-respect des instructions de cette publication pourrait entraîner des blessures

blessure, ou décès dus à un incendie et/ou une explosion, dommages matériels, ou autres dangers pouvant être associés à ce type d'équipement.



### VIDANGER EN TOUTE SÉCURITÉ LE SYSTÈME DE TUYAUTERIE

Avant le démontage de tout compteur ou composant accessoire : **TOUTES LES PRESSIONS INTERNES DOIVENT ÊTRE RELÂCHÉES ET TOUS LES LIQUIDES DOIVENT ÊTRE VIDANGÉS DU SYSTÈME CONFORMÉMENT À TOUTES LES PROCÉDURES APPLICABLES.**

La pression doit être de 0 (zéro) psi. · Fermez toutes les conduites de liquide et de vapeur entre le compteur et la source de liquide.

**Le non-respect de cet avertissement pourrait entraîner des dommages matériels, des blessures personnelles, ou des décès dus à un incendie et/ou une explosion, ou autres dangers pouvant être associés à ce type d'équipement.**



## **RESPECTEZ LES NORMES NATIONALES ET LOCALES**

Le câblage d'alimentation, d'entrée et de sortie (E/S) doit être conforme à la classification de zone pour laquelle il est utilisé (Classe I, Div 2). Pour l'Amérique du Nord, les installations doivent être conformes au Code électrique national des États-Unis, NFPA 70, ou au Code canadien de l'électricité afin de maintenir les classements Classe I, Division 2. Cela peut nécessiter l'utilisation de connexions ou autres adaptations conformes aux exigences de l'autorité compétente.

L'équipement périphérique doit être adapté à l'emplacement dangereux où il est installé.

**AVERTISSEMENT : Risque d'explosion**

En zone dangereuse, coupez l'alimentation avant de remplacer ou de câbler des modules.

**NE DÉCONNECTEZ PAS** l'équipement sans avoir coupé l'alimentation ou sans s'être assuré que la zone est non dangereuse.

**AVERTISSEMENT : Utiliser un couple de 3,5 in·lb (0,4 N·m) lors du serrage du bornier vis.**

## ESD Protection

### ESD Precaution

#### Ouverture des caisses enregistreuses

Suivez cette procédure chaque fois que vous ouvrez la caisse enregistreuse ou que vous l'approchez avec la porte ouverte : Avant d'ouvrir la caisse et de manipuler la carte CPU, il est important de décharger toute électricité statique qui aurait pu s'accumuler sur votre personne. Pour vous décharger de l'électricité statique, touchez un point bien mis à la terre - tel que le boîtier de la caisse, le compteur, la tuyauterie du camion ou le pare-chocs. Lorsque la maintenance est terminée et que la porte de la caisse est fermée, la carte CPU est protégée contre les décharges électrostatiques par le boîtier de la caisse qui est mis à la terre sur le châssis.

## Preventing ESD Damage

Pour prévenir les dommages causés par les décharges électrostatiques (ESD) à la caisse enregistreuse, les installations sur camion doivent correctement mettre à terre le coussin de siège du camion et le châssis de l'imprimante Epson. Une exposition prolongée aux décharges électrostatiques sur des semaines, des mois ou des années peut corrompre la mémoire de la caisse et endommager les composants électroniques des caisses enregistreuses (ainsi que d'autres composants électriques du système électrique du camion).

Les sièges réglables et amortissants, s'ils ne sont pas correctement mis à la terre, génèrent des quantités importantes d'électricité statique (ESD). Les pivots et les charnières de ces sièges isolent le coussin de siège de la masse électrique. Sans une liaison équipotentielle appropriée, une charge électrostatique s'accumule entre le coussin de siège et l'opérateur. Cette charge électrique peut pénétrer dans le terminal (Register) à partir de n'importe quel point du système électrique du camion, y compris l'alimentation du terminal et le câblage de l'imprimante.

## Kits de mise à la terre Liquid Controls

Toutes les installations du terminal (Register) dans un camion doivent comporter des sièges et des imprimantes mis à la terre en utilisant les éléments suivants : kits :

- Kit de bracelet de terre (Numéro de pièce LC 82185)
- Kit de fil de terre pour imprimante Epson (Numéro de pièce LC 82184)

Des sièges correctement mis à la terre permettent à l'électricité statique de 's'évacuer' avant qu'elle ne puisse s'accumuler, se décharger et endommager le terminal ou d'autres composants électriques.


Le kit de fil de terre pour imprimante Epson est inclus dans chaque envoi de kit de câble d'imprimante Epson. Pour les installations existantes et les caisses enregistreuses/imprimantes précédemment achetées, les deux kits de mise à la terre sont disponibles auprès de LC.

## Mise à la terre avec un support de compteur ou un support distant

Dans une installation où la caisse enregistreuse est montée directement sur le compteur, le boîtier de la caisse est mis à la terre via le compteur. Si la caisse enregistreuse n'est pas montée sur le compteur, vous devez vous assurer que le boîtier de la caisse est correctement mis à la terre.

### Méthodes alternatives de mise à la terre pour caisses enregistreuses montées à distance

Pour les installations où la mise à la terre du boîtier de la caisse via un support n'est pas possible, un trou de vis de terre externe est disponible. Ce trou nécessite une vis de terre #8-32 x 1/4" - qui est fournie avec la caisse (la référence LC de la vis est 08254) - et également un fil toronné de calibre 12 ou plus, connecté à une terre connue (moins de 1 ohm).

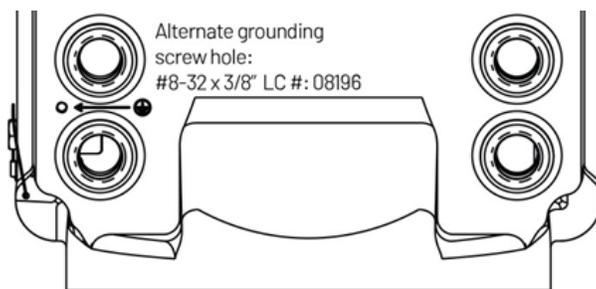

Une autre option consiste à connecter la vis de terre 8-32 x 1/4" (à l'intérieur du boîtier de la caisse) à un fil toronné de calibre 12 ou plus, connecté à une terre connue (moins de 1 ohm).

## Spécifications

### Mécanique

#### Boîtier et clavier

Le boîtier et les bases du registre sont des pièces moulées en aluminium sous pression avec une finition protectrice au chromate et une peinture en poudre uréthane à haute durabilité. La conception de la charnière interne du couvercle permet un accès facile aux connexions internes et protège toutes les parties mobiles de la charnière des intempéries pour prévenir davantage la corrosion. Les fonctionnalités Poids et Mesures sont accessibles via une fixation étanche sur le côté du couvercle. On trouve 11 ports NPT de demi-pouce à l'arrière du registre pour assurer des connexions câblées sécurisées pour une large gamme de dispositifs externes.

#### Matériaux de construction

- Aluminium moulé sous pression de haute qualité A360, couvercle de boîtier et base de boîtier
- Finition chromate avec revêtement protecteur en poudre
- Fenêtre d'affichage en verre trempé
- Joint en silicone pour la vitre d'affichage
- Support d'affichage en acier inoxydable
- Joint de porte en silicone
- Clavier – Commutateur à membrane avec revêtement silicone rétroéclairé
- Fixations/pièces de quincaillerie en acier inoxydable
- Rondelle d'étanchéité en silicone lié à l'acier inoxydable

#### Classification certifiée de température opérationnelle

- La caisse enregistreuse est certifiée pour un fonctionnement normal dans la plage de température de -40 à 140 ° F (-40 à 60 °C).

#### Affichage

- TFT/LCD haute définition robuste de 7 pouces (écran cristaux liquides à transistor en couche mince)  
Écran vidéo avec rétroéclairage LED.
- 800 x 480 pixels (152,4 mm x 91,4 mm)

- Luminance : 1500 cd/m<sup>2</sup>
- Plage de température acceptable pour le fonctionnement ou le stockage de l'écran : -40 °F à 185 °F (-40 °C à 85 °C).

## Poids

- Environ 12 lbs (version montée sur compteur, sans accessoires supplémentaires)
- Approximativement 5 kg (version pour montage sur panneau, sans accessoires supplémentaires)

## Entrée de câble

- Onze (11) ports filetés 1/2" NPT (1/2-14 NPT)

## Clavier alphanumérique

Le clavier alphanumérique du registre est fabriqué en silicone résistant aux hydrocarbures et comprend 12 grandes touches alphanumériques, 5 touches de navigation et 5 touches de fonction qui correspondent aux indicateurs d'affichage adjacents pour une fonctionnalité guidée par l'opérateur. Les touches, lorsqu'elles sont enfoncées, donnent à l'opérateur une confirmation tactile positive des frappes. La fonctionnalité de multi-appui du clavier permet également aux utilisateurs de saisir jusqu'à quatre caractères alphanumériques sur une seule touche.

## Électrique

### Entrées

Les entrées sont configurables dans le registre pour gérer une variété d'accessoires externes qui fournissent des signaux de données dans le système de jaugeage, y compris l'entrée d'impulsions et divers capteurs externes.

### Tension d'entrée du registre

- Voltage – 9 to 28 VDC
- Current maximum: 5 A maximum

### Pulse Input

In order to calculate flow measurements when mounted to a positive displacement meter, the Register receives a pulse input from a quadrature pulser that is mechanically connected to the

flow meter output shaft (meter mount option only). A pulse input can also come from an external device such as a Liquid Controls Pulse Output Device (POD) or another externally mounted pulse generator. If an external LC POD is purchased, these materials are necessary, but are not supplied with the POD:

- 16-22 AWG 4 conductor Shielded Cable (Consult the POD manual for complete specifications)
- Weather Proof flexible conduit or loom
- ½” Conduit connectors or cable glands

#### **RTD Temperature Probe**

The Register is equipped with an input for a temperature probe, so the register can read realtime temperature as well as compensate volume measurements according to the temperature of the product.

- 4 wire platinum sensor
- 100  $\Omega$  resistance at 0 C
- 138.5  $\Omega$  resistance at 100 C

#### **Optical Air Eliminator**

The Register is equipped to handle an optical air eliminator input:

- Voltage – 10 to 28 VDC
- Current – 0.5 Amp maximum

#### **Digital Inputs 1, 2, 3, 4, 5, and 6**

- Active Low, normally pulled high
- Voltage: 5 to 28 VDC
- Current: 3 mA maximum sink current
- Maximum Frequency: 10 kHz

## Outputs

The Register is equipped with six digital outputs and four solenoid outputs. These outputs allow the Register to communicate with meter system accessories such as solenoid- controlled valves, optical air and vapor eliminators, remote displays, printers, and third-party devices.

### Digital Outputs 1, 2, 3, 4, 5, and 6

- Open drain output, active low to ground, thermally protected
- Voltage: 5 to 28 VDC
- Current: 500 mA maximum

### Outputs for solenoids 1, 2, 3, and 4

- Open drain output, active low to ground, thermally protected
- Voltage: 12 VDC nominal
- Current: 1 A maximum
- Voltage: 24 VDC nominal
- Current: 0.5 A maximum

### Pulse Output

- Voltage peak to peak – 5 to 28 V
- Frequency maximum – 7500 Hz

### Scale Pulse Output

- Current sinking capability: 150 mA

### Electrical Protection

- 5 A fuse on power cable

## **Communications**

- RS-232
- RS-485
- CAN BUS – Consult the applicable Chassis Builder's Guide, available from the truck chassis manufacturer.
- Ethernet (Gigabit)
- Bluetooth (wireless)
- Wi-Fi (wireless)


## **Printer (Epson Model 295)**

- Voltage – 24 VDC
- Current – 0.8 Amp maximum
- Operating Temperature – -22 to 104 °F (-30 to 40 °C)

## Regulatory & Certifications

The equipment is Listed by UL to applicable US and Canadian standards for use in hazardous locations under Liquid Controls file E180172.

### LCR.iQ and MASTERLOAD Serial Number tags

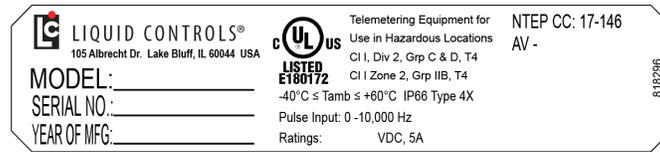

## Class I

- Potentially Explosive Gas/Vapor Atmospheres.

## Division 2 and Zone II

- Gases and vapor are not normally present in an explosive concentration but may accidentally exist during abnormal operations.

## Explosive Atmospheres



- This equipment has been found to comply with the European Directive for Equipment For Potentially Explosive Atmospheres 2014/34/EU (ATEX), Certification Scheme for Explosive Atmospheres of INTERNATIONAL ELECTROTECHNICAL COMMISSION (IECEX) and Brazil's Portaria 179, subject to the following condition of safe use: Wipe with damp cloth and de-energize before opening. Certificates (if applicable) are issued are issued by DNV GL and are etched on the tag.
- II - Suitable for use in surface installations.
- 3G - Equipment for explosive gas atmospheres, having a "high" level of protection, which is not a source of ignition in normal operation or during expected malfunctions.
- Ex ec - Explosion protection is provided by the increased safety method of protection with the "ec" level of protection.
- GC - Equipment Protection Level level, per IEC 60079-0, EN 60079-0, and ABNT NBR IEC 60079-0. Suitable for installations in Zone 2.

## Grp C&D and Grp IIB

- Flammable/explosive Gas groups.

## T4

- Temperature class for surface temperature limitations. T4 means that at the point it reaches the rated maximum ambient temperature, the equipment will not generate temperature higher than 135 °C

## **-40 °C ≤ Tamb ≤ 60 °C**

- Safe limits of ambient temperature.

## IP66

- Ingress protection: dust tight and protected against powerful water jetting.

## Type 4X

- The enclosure has been evaluated by UL for outdoor use to provide protection against water and dust and an increased level of protection against corrosion; and that will be undamaged by the external formation of ice.

## CE 2460



- Indicates conformity with all applicable Directives for products sold within the European Economic Area. DNV GL has performed Quality Assurance Notification under its ATEX Notified Body number 2460.

## Specifications

LCR.iQ® Specifications			
<b>Enclosure</b>			
Waterproof, corrosion resistant and dust-proof - meets IP66 and UL Type 4X requirements			
<b>Display</b>			
7 inch, 800 x 480 high-resolution, Full Color			
<b>Temperature Range</b>		<b>Input Voltage</b>	
-40°F (-40°C) to 140°F (60°C)		9-28 VDC	
<b>Keypad</b>			
LED Back-lit		Petroleum-resistant	
Non-conductive, UV resistant elastomer		Field Replaceable	
<b>Communication</b>		<b>I/O</b>	
RS232/485 Comm Ports	2	Solenoid Outputs (high current)	4
RS485 Dedicated Comm Ports	2	Programmable Digital Outputs	6
WiFi	Internal antenna	Digital Inputs	6
Bluetooth	Internal antenna	RTD Probe Input	1
Extended range antenna (externally mounted)	Optional accessory	Optical Sensor Input	1
4-20 mA inputs	1 expandable to 7	Scalable Pulse Output (Additive inj, display, PLC)	1
<b>Processor &amp; Storage</b>			
Dual-Core Processor Speed		800 MHz	
Internal RAM		1GB	
Internal Storage		128MB Flash NAND 8GB eMMC Flash drive	
External Storage via Removable USB			

## FCC Compliance



Unique Identifier: LCR.iQ or MASTERLOAD.iQ

Responsible Party:

Liquid Controls LLC

105 Albrecht Drive

Lake Bluff, IL 60044 USA

[www.LCmeter.com](http://www.LCmeter.com)

**FCC Compliance Statement:** This device complies with Part 15 of the FCC Rules. Operation is subject to the following two conditions: (1) This device may not cause harmful interference, and (2) this device must accept any interference received, including interference that may cause undesired operation.

This device contains FCC ID Z64-WL18DBMOD, IC: 451I-WL18DBMOD, and may optionally contain FCC ID MCQ-XBPS3B, IC: 1846A-XBPS3B (DIGI Module).

This equipment has been tested and found to comply with the limits for a Class B digital device, pursuant to part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference in a residential installation. This equipment generates, uses, and can radiate radio frequency energy and, if not installed and used in accordance with the instructions, may cause harmful interference to radio communications. However, there is no guarantee that interference will not occur in a particular installation. If this equipment does cause harmful interference to radio or television reception, which can be determined by turning the equipment off and on, the user is encouraged to try to correct the interference by one or more of the following measures:

- Reorient or relocate the receiving antenna.
- Increase the separation between the equipment and receiver.

- Connect the equipment into an outlet on a circuit different from that to which the receiver is connected.
- Consult the dealer or an experienced radio/TV technician for help.

Any changes or modifications to this equipment, not expressly approved by Liquid Controls could void the user's authority to operate the equipment.

This device complies with the ISED Canada license-exempt RSS standard(s). Operation is subject to the following two conditions: (1) This device may not cause harmful interference, and (2) this device must accept any interference received, including interference that may cause undesired operation.

Cet appareil est conforme à la norme RSS exempte de licence d'ISED Canada. L'opération est sous réserve des deux conditions suivantes: (1) Cet appareil ne doit pas causer d'interférences; et (2) Cet appareil doit accepter toute interference fonctionnement indésirable de l'appareil CAN ICES-3(B)/NMB-3(B)

This device could automatically discontinue transmission in case of absence of information to transmit or operational failure. Note that this is not intended to prohibit transmission of control or signaling information or the use of repetitive codes where required by the technology.

The device for operation in the band 5150-5250 MHz is only for indoor use to reduce the potential for harmful interference to co-channel mobile satellite systems.

High power radars are allocated primary users (i.e. priority users) of the bands 5250-5350MHz and 5650-5850MHz and that these radars could cause interference and or damage to the Wi-Fi transceiver.

This equipment complies with the FCC/IC radiation exposure limits set forth for an uncontrolled environment.

Only antennas specified by Liquid Controls shall be used with this equipment.


The antenna for this equipment shall be installed and operated to maintain a separation distance of 20 cm or greater between the antenna and any person.

The antenna for this equipment shall not be co-located with or operated in conjunction with any other antenna or transmitter. The antennas shall be installed and operated to maintain a separation distance of 20 cm or greater between any other radiating antenna.


The FCC ID and IC can also be viewed on the Register by pressing then then .

## Dimensions - Panel Mount


FRONT VIEW

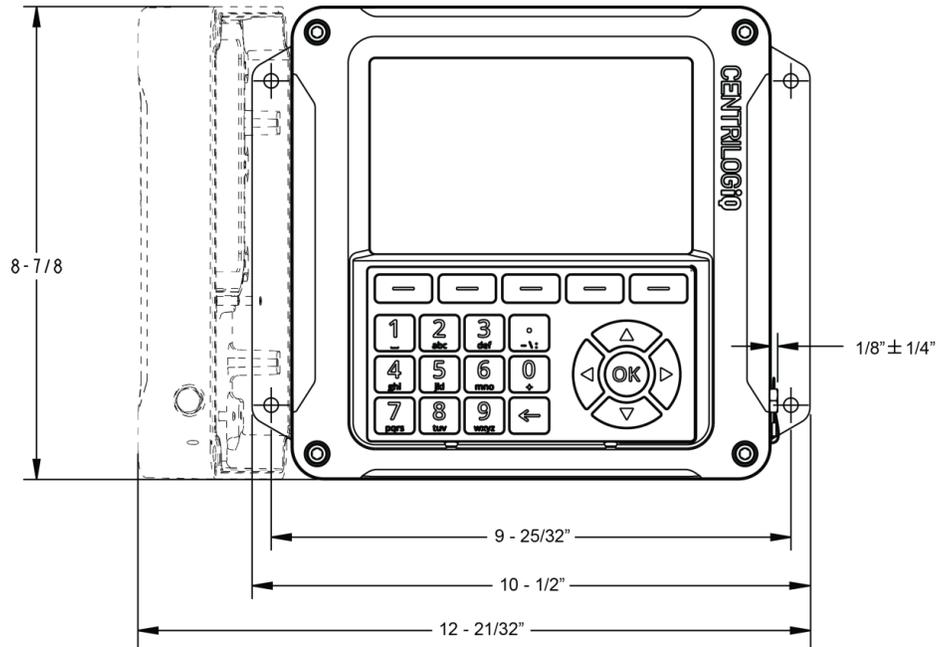


BACK VIEW

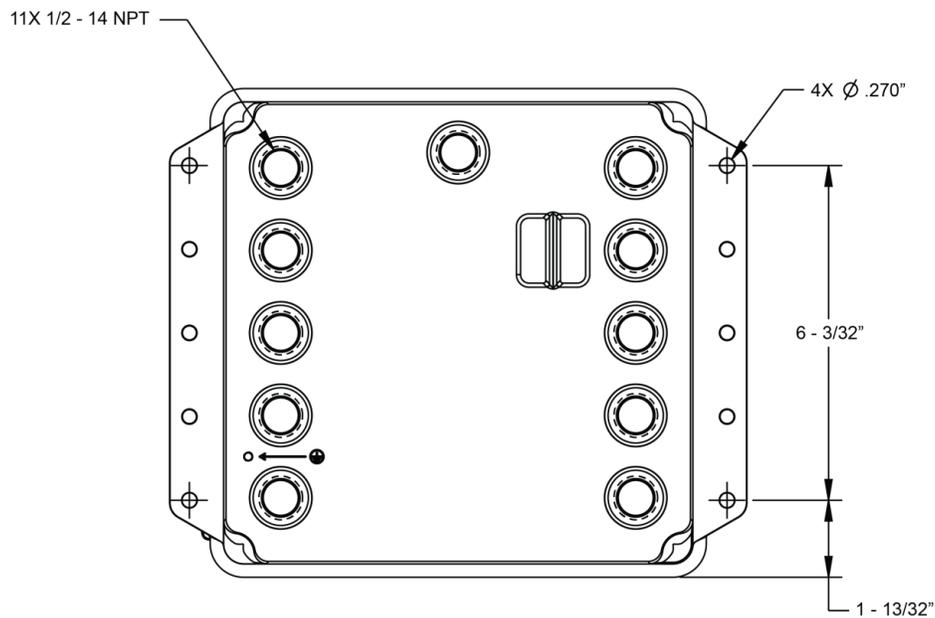

**SIDE VIEW**

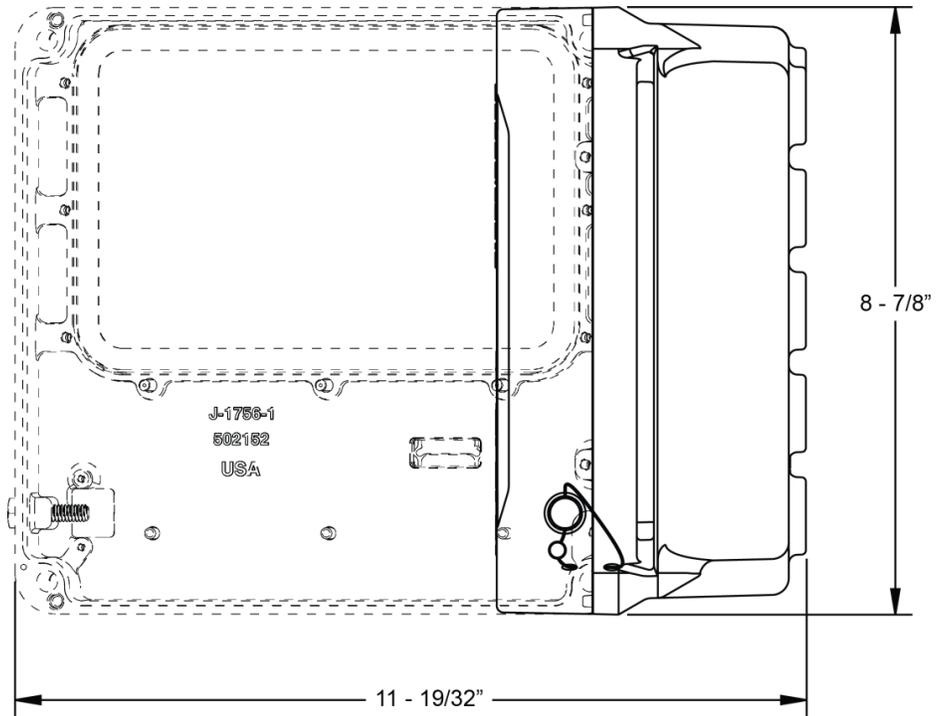


**TOP VIEW**

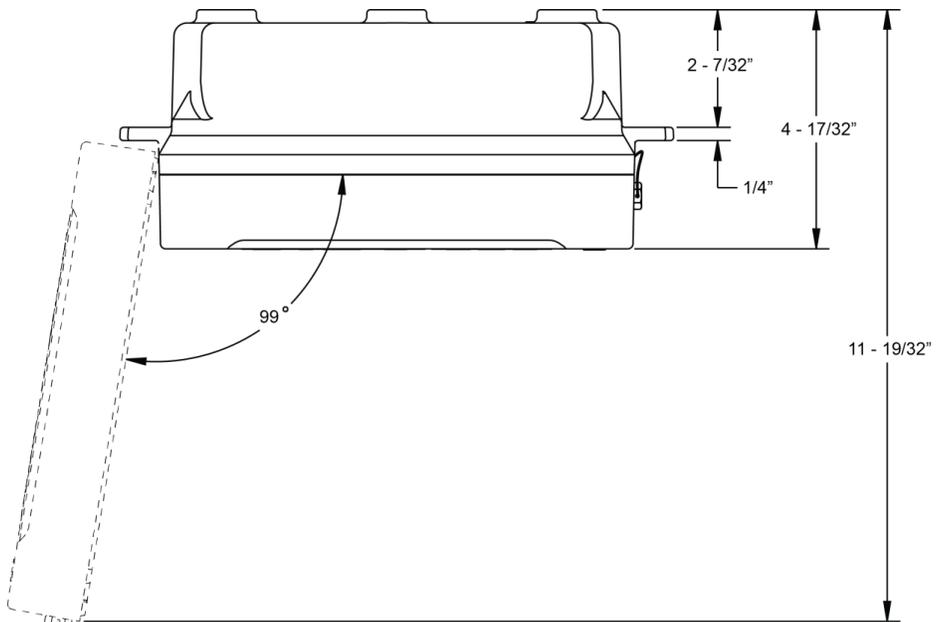


## Dimensions - Meter Mount


Front View

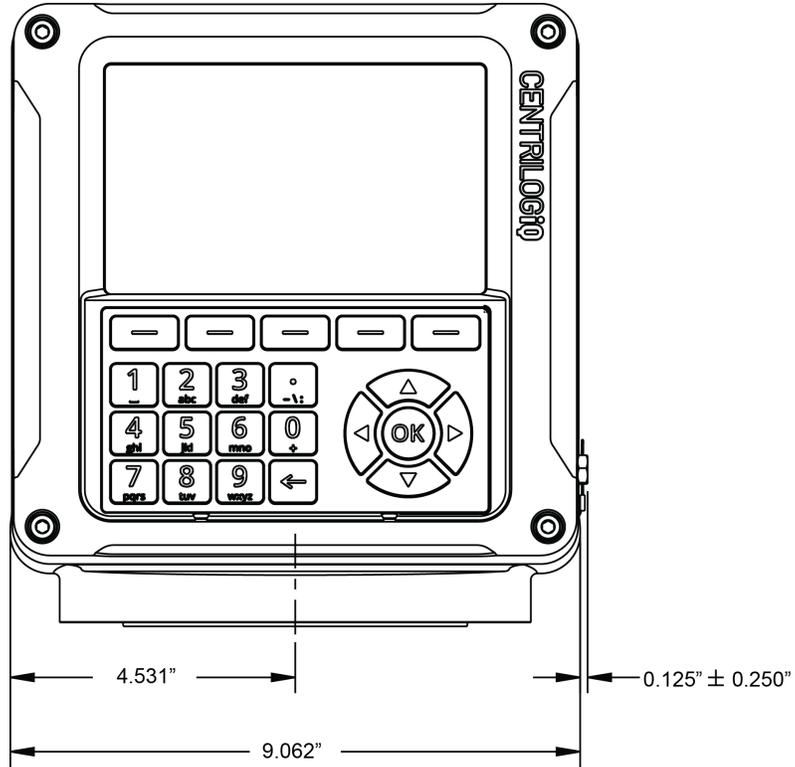


Back View

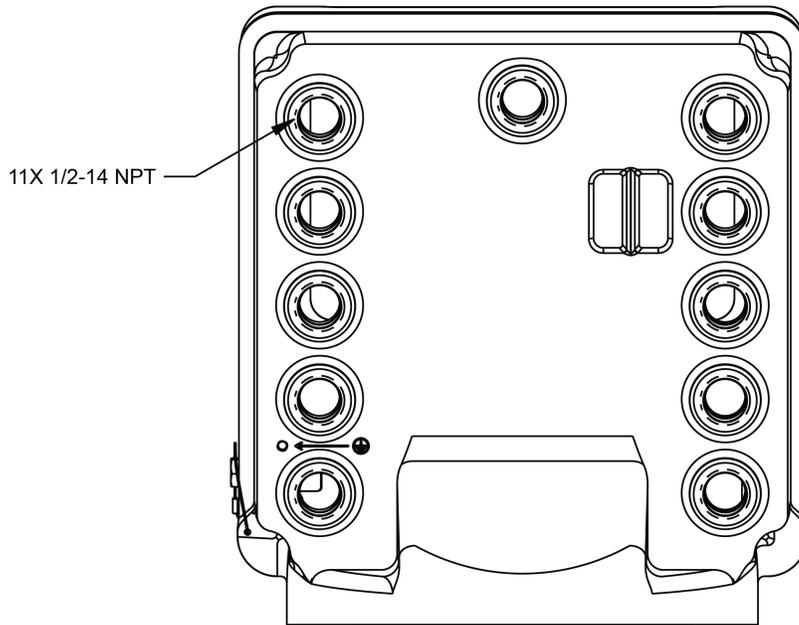


Side view

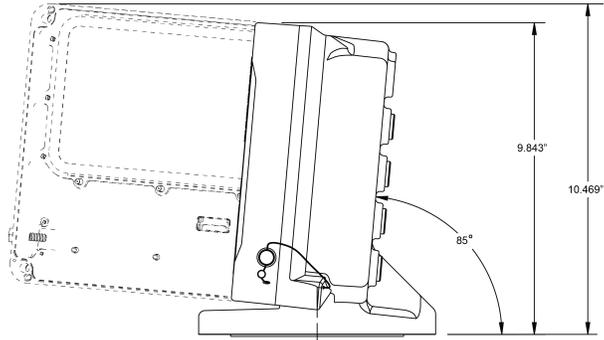

Top View

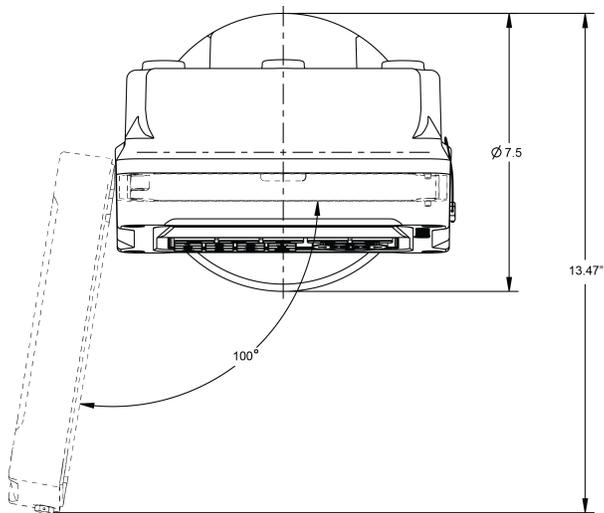

Bottom View

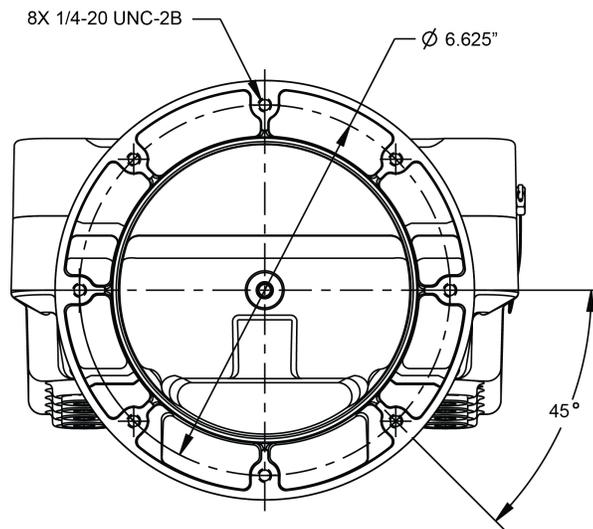

## Setup and Operation

The Liquid Controls LCR.iQ or MASTERLOAD.iQ is a microprocessor-based electronic meter register that can be used for Weights & Measures approved custody transfer actions in mobile or fixed installations.

**NOTE:** Throughout this manual, both the LCR.iQ and MASTERLOAD.iQ are referred to as “Register” (unless otherwise specifically referenced by name).

The Register is a self-contained unit. All operation, setup, and configuration functions can be carried out using the Register function keys and alphanumeric keypad. No lap pads, laptops, or other data entry devices are required.

A complete Liquid Controls meter system not only accurately measures product, it also regulates product flow and removes contaminants in order to produce the optimal conditions for measurement. Typical systems include an air/vapor eliminator, strainer, meter, register, and control valve.

### **It's just that simple.**

Liquid Controls engineers took an aggressive approach by designing the Register from the operator's perspective, as if little training should be required to use it. The result is a user-guided, configurable interface that walks the operator through the fueling operation, minimizing chance for error.

### **COMMON FUELING PROCESSES COMPLETED IN 3 STEPS OR LESS**

User-configurable fueling processes control the number of steps required for the operator to complete his or her delivery. Pump and print operations are complete in two steps, using one function key!



**OPERATOR FRIENDLY SCREENS WITH DAY / NIGHT MODES AND BRIGHTNESS CONTROL**

The Register screens adapt to the operator. Idle screen shows the last delivery data, changing to full screen, active fueling mode with yellow background when **Start** is pressed. Operators have the option to see fueling details during active fueling and can easily adjust screen brightness and toggle between day or night modes for reduced eye strain.



**SIMPLE METER CALIBRATION**

The intuitive calibration of the Register enables you to simply enter the "corrected prover" or master meter volume, and it will do the rest. With up to 16 points of linearization, the Register is by far the most precise register ever made.



## REAL-TIME ON-SCREEN DIAGNOSTICS

The Register provides the operator with real-time diagnostics. It also provides an error indicator and message for any error condition that arises. Also, the operator can easily print the report for corrective action and reference.



## SECURITY

The Register has been designed with the highest levels of security, according to Center for Internet Security (CIS) benchmarks. As an Internet-enabled device, it is imperative that any weights-and-measures-approved devices meet or exceed CIS benchmarks for security. This level of stringency also provides a robust user level security to prevent tampering or inadvertent access to forbidden areas and settings on the device. Safety and security go hand-in-hand, and these are the number one priority at Liquid Controls.



### CONFIGURABLE DELIVERY SETUP

Guide the operator through the fueling process of your choosing. From basic pump-and-print to presetting—either by volume or product weight. It's easy to adjust price per gallon, percent tax, or select multiple deliveries on a single ticket.



### CONFIGURABLE IDLE SCREEN

Easily configure the idle screen fields the operator sees before, during, and after fueling. All units of measure including date and time formats are also configurable to comply with local standards.



## Software License Agreement

Read this license carefully. You agree that by using the itemized software package, you have agreed to the software license terms and conditions. This agreement constitutes complete and entire agreement between you and Liquid Controls with respect to this product.

1. Liquid Controls hereby grants to Licensee a non exclusive license to use SR1000 and SR1010 (hereinafter referred to as "Licensed Software").
2. Under the License granted herein, Licensee may use the itemized machine readable (executable code) copy of the Software, including any subsequent updates which maybe provided. Licensee shall not, without Liquid Controls prior written consent, (a) rent, lease, lend, sublease or otherwise transfer the materials hereunder; (b) remove or obscure proprietary or copyright notices which may be set forth on the Licensed Software; or (c) alter, decompile, or disassemble the program.
3. One (1) copy of the Licensed Software, including any software distributed on disks may be made for backup purposes only. No other copies may be made or used without the written consent of Liquid Controls.
4. Title. No title to ownership of any Licensed Software is transferred to the Licensee.
5. Upgrades. License upgrades may become available for the Licensed Software. Any cost associated with such upgrades will solely be determined by Liquid Controls.
6. Warranty. Liquid Controls makes and licensee receives no warranty, express or implied, and thereby expressly excludes all warranties of merchantability and fitness for a particular purpose.
7. Limitation of Liability. Licensee shall have the sole responsibility for adequate protection and backup of its data in connection with the Licensed Software. In no event shall Liquid Controls be liable for (a) special, indirect or consequential damages; (b) any damages whatsoever resulting from loss of use, data, or profits, product, inaccurate input or work delays, or any direct property damage arising out of or in connection with this agreement or the use or performance of the Licensed Software.
8. Termination. Liquid Controls may terminate this software license granted hereunder and require return of the Licensed Software if Licensee fails to comply with these license terms and conditions.
9. Licensee acknowledges that it has read this agreement, understands it, and agrees to be bound by its terms, and further agrees that this is the complete and exclusive statement of the agreement between Liquid Controls and Licensee, which supersedes and merges all prior proposals, understandings, and all other agreements, oral or written, between the parties relating to this agreement. This agreement may not be modified or altered except by written instrument duly executed by both parties.
10. This Agreement and performance hereunder shall be construed and interpreted under the laws of the State of Illinois.
11. If any provision of this agreement is invalid under any applicable statute or rule of law, it is to that extent to be deemed omitted.
12. Licensee may not assign or sublicense, without the prior written consent of Liquid Controls, its rights, duties, or obligations under this Agreement to any person or entity in whole or in part.
13. The waiver or failure of Liquid Controls to exercise in any respect any right provided herein shall not be deemed a waiver of any further right hereunder.

## Operational Information & Main Menu

This figure provides a visual overview of the register. In the sections below, you can find general information on the operation of the register, screen layout, types of display screens, and the keypad.



## Delivery Screen Layouts


### Delivery Screens

The user interacts with the register through the delivery screens. A user can view delivery details, and also enter information before, during, and after completing a transaction. There are three separate delivery screens that may appear:

- Idle / Home Delivery Screen
- Active Delivery Screen
- Active Delivery Screen - Show Details


### Idle / Home Delivery Screen

The idle delivery screen will appear when the Register is between deliveries—and not in any of the setup screens. This is also known as the **Home** screen, since a typical user will spend much time interacting with the Register here.

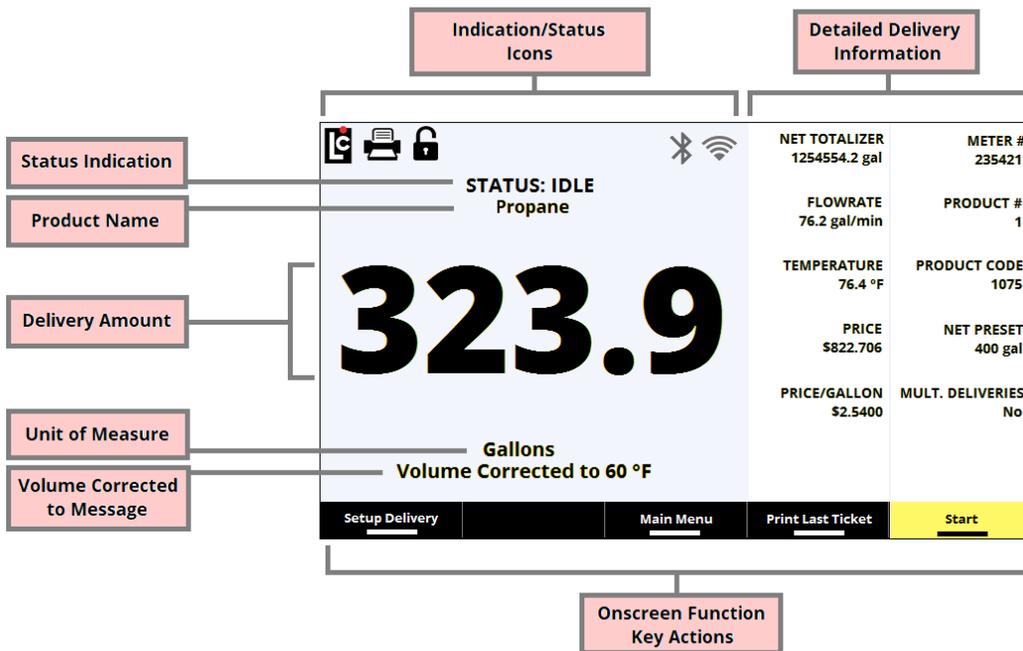


## Active Delivery Screen (Full Screen)

The Active delivery screen appears any time the Register is performing an active delivery. The default active delivery screen is the Full Screen mode—which displays large, bright delivery volume, along with the base regulatory details for a transaction.

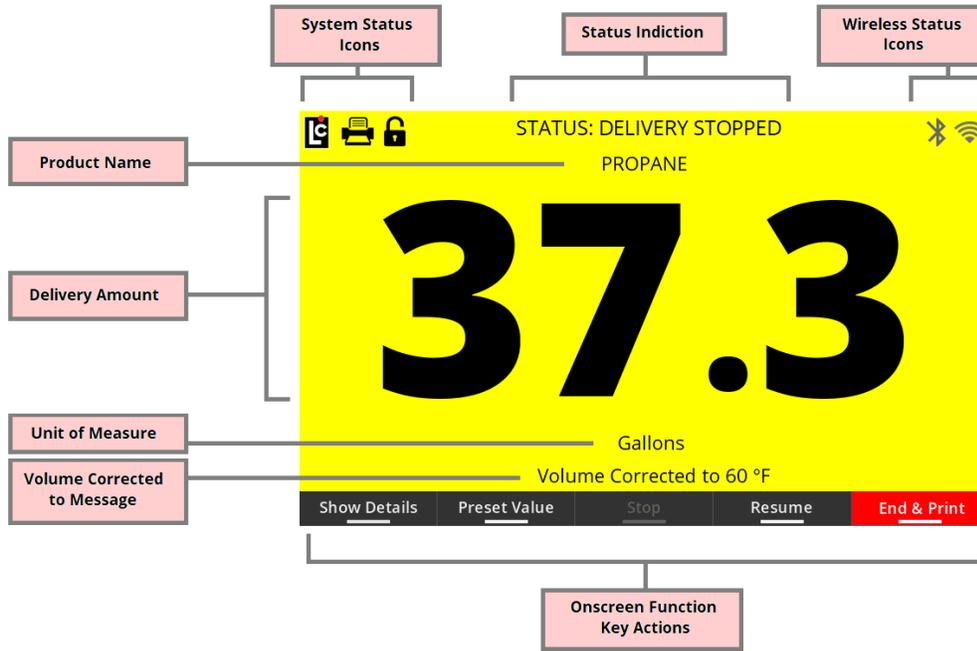

## Active Delivery Screen - Show Details


Display this screen at any time during a delivery by pressing the function key that corresponds to **Show Details**. The **Show Details** screen will display up to two columns of additional information about the active delivery. These columns are configurable when setting up the Register, and can display up to 12 separate parameters of data during an active delivery.

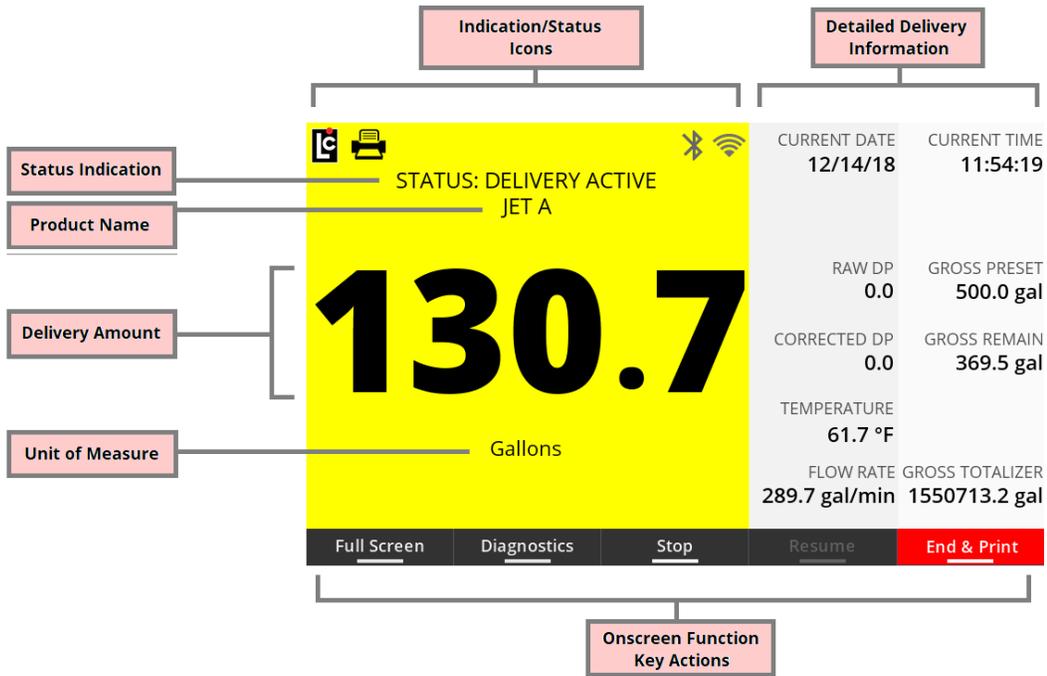

## Display Screen Types


With menus, you can quickly navigate to various operational screens available within the Register. There are two menus accessible to the user, the **Main Menu** and the **Setup Menu**.

Access to the main menu is accessible from the idle delivery screens, or anytime the Register first enters the calibration mode (in a non-active delivery mode). Access to the setup menu is available from the **Main Menu** only. Each menu provides access to a number of operational screens.

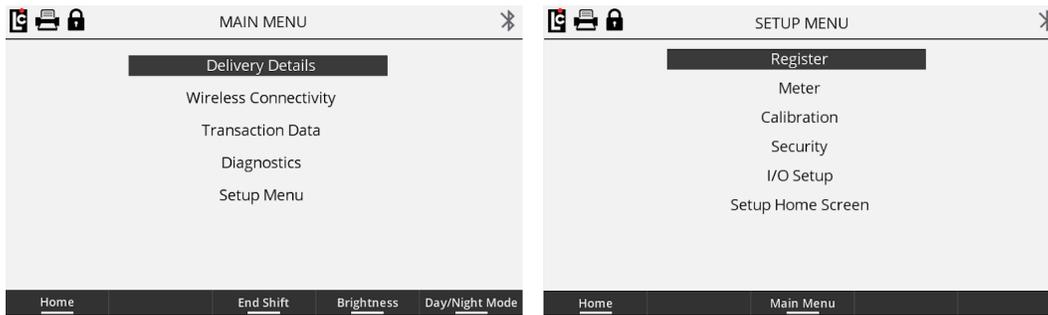

Detailed Operational Screens appear anytime a selection is made to one of the menu items.


When inside a detailed operational screen, you will see the title of the screen, the page number (if multiple pages are available), as well as all available parameter fields on that page.

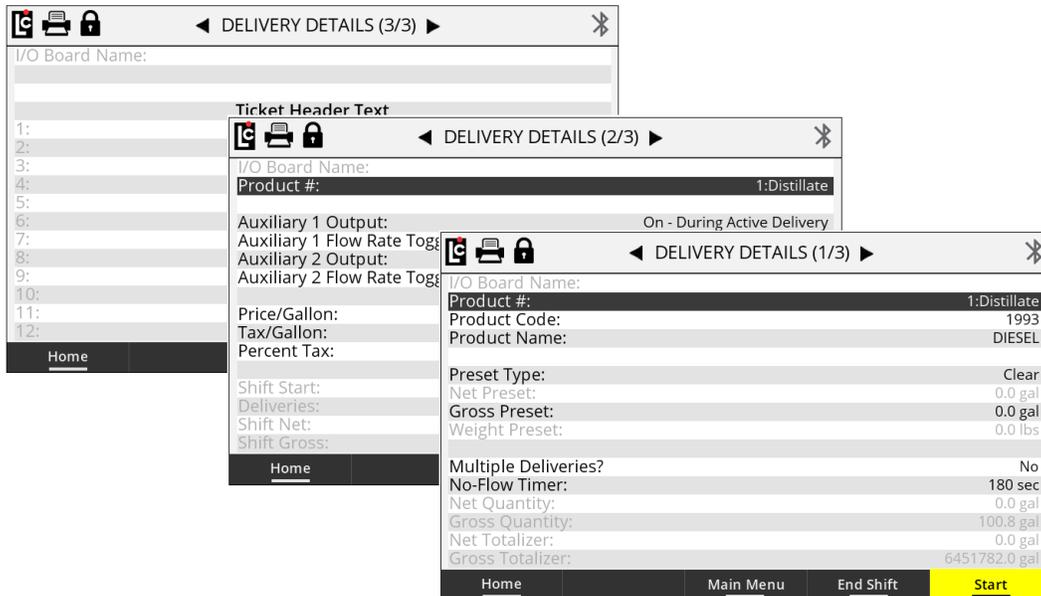

**Parameter fields** display current information that has already been setup. Other general information may also be shown. There are three main types of parameter fields within an operation screen: list boxes, text fields, and read-only fields.




**List Box** parameter fields, when selected, provide the user with a list of options that are available for that specific parameter. A list may be a drop-down list of available settings, or as simple **Yes/No** selection. When the user selects a list box parameter, the list box will display on the screen and the user can use the navigation keys to scroll up or down through the available list of options. Press **OK** to make a selection.

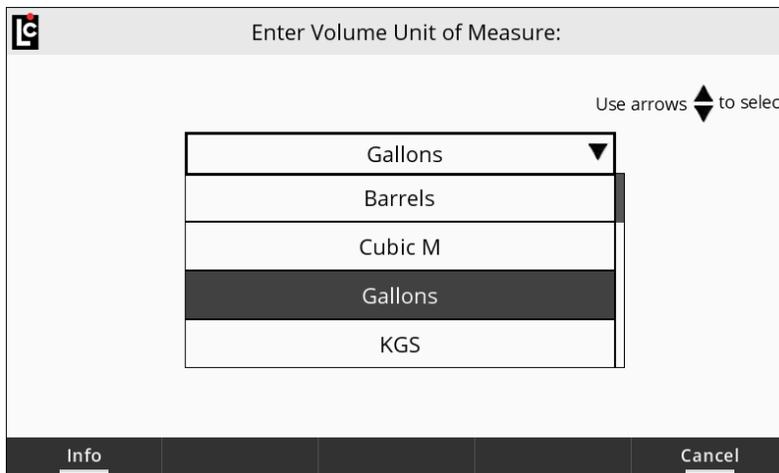


**Text box:** When a text box parameter field has been selected, the user can manually enter text information specific to that parameter. Text for these fields can be entered using the alphanumeric keypad. Keep in mind that a text field can either be **numeric** (only numbers are

permitted for that parameter) or alphanumeric (either numbers or letters are permitted for that specific parameter).

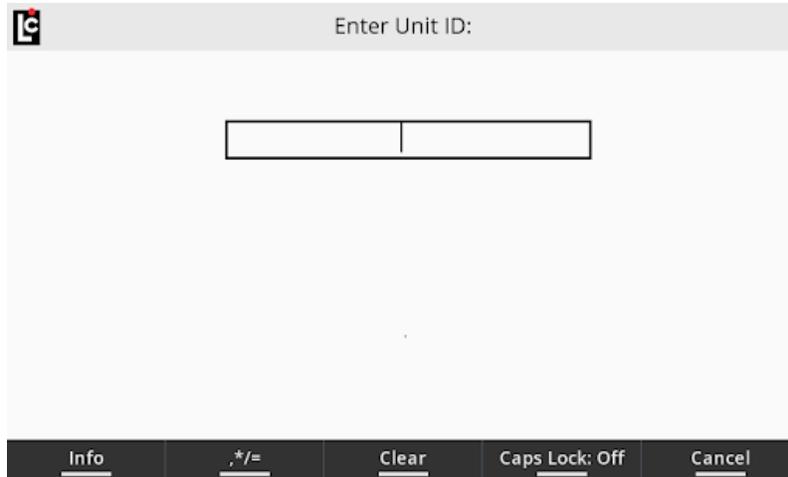

**Read-only** fields are for informational purposes, and display an Register parameter field that maybe be useful when setting up or programming the register. Read-only fields always appear on the screen in a gray text color.

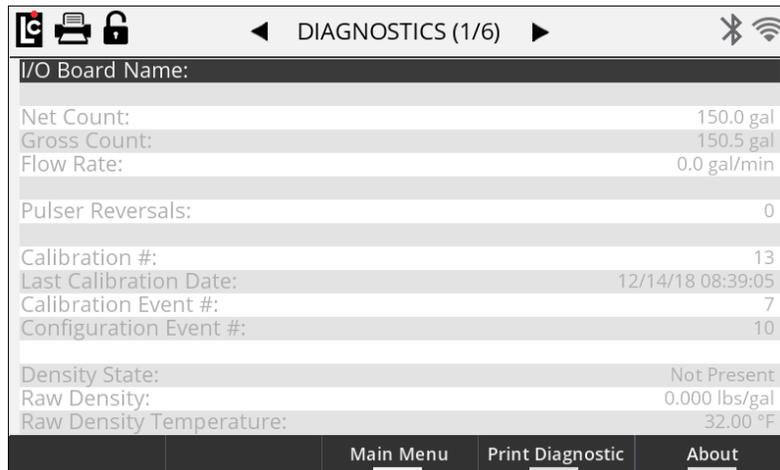

## Keypad Interface

### Keypad

The Register keypad serves as a tool for basic delivery functionality, data entry and screen navigation. There are three sections of the keypad, including function keys, alphanumeric keys and, navigation keys. See the detail explanations below.



**Function keys** provide a simple way to perform specific tasks such as starting a delivery, setting a preset amount, or accessing a different menu. Each function key corresponds to an onscreen action. The onscreen action of the function keys will vary on different screens or menus.


Onscreen actions that appear in white are actions that are available to the user. Onscreen actions that appear in gray are unavailable (in the current context). Onscreen actions that correspond to a function key may have different background color for easier identification and operation. In some screens, one or more of the function keys may not correspond to any onscreen action. In such cases, the onscreen section for that function will be empty.




**Navigation Keys** give the user a simple way to move among screens, and also help in making selections. The up and down arrow keys move the selection bar up and down through screens, menus, and list boxes. The right and left arrow keys are for scrolling through setup screens, and also move a cursor left or right within a text box. Use the **OK** key to enter a field that you've selected, or to accept data that has been selected or entered for a field.

<b>Start</b>	Start will reset the LCR.iQ for a new delivery
<b>End &amp; Print</b>	End & Print will complete the current delivery and print a ticket
<b>Stop</b>	Stop will pause an active delivery and allow access to addition delivery parameters
<b>Resume</b>	Resume will continue a delivery that has been paused by pressing the Stop key
<b>Show Details</b>	Show Details will change the delivery screen from full screen to details screen mode
<b>Full Screen</b>	Full Screen will change the delivery screen from details screen to full screen mode
<b>Preset Volume</b>	Preset Volume will display a numeric text prompt to enter a preset amount for delivery
<b>Diagnostics</b>	Diagnostics will take the user into the diagnostics screens
<b>Home</b>	Home will return the LCR.iQ back to the idle delivery screen (Home)
<b>About</b>	About will display information about the LCR.iQ such as software versions and regulations
<b>View Message Log</b>	View Message Log will show details of the selected message log data type
<b>Close</b>	Close will close the current viewable screen
<b>Hose Reset</b>	Hose reset will actuate the hose reset feature if activated
<b>Print Last Ticket</b>	Print Last Ticket will reprint a copy of the previous delivery ticket
<b>Print Diagnostic</b>	Print Diagnostic will print a copy of the current diagnostic information
<b>Print</b>	Print will print off a transaction record, audit log or data log depending on the screen selected
<b>Setup Delivery</b>	Setup Delivery will allow access to the setup delivery prompts from the idle delivery screen
<b>&lt; Back</b>	<Back will navigate to a previous option in a setup screen
<b>Next&gt;</b>	Next> will navigate to the next option in a setup screen
<b>Info</b>	Info will display information about the current display screen and its selection options
<b>Close Info</b>	Close Info will close the info screen and return to the current display screen
<b>End Shift</b>	End Shift will end the current active shift and print the active shift ticket
<b>Brightness</b>	Brightness will display a selection bar for setting the brightness of the display
<b>Day/Night Mode</b>	Day/Night Mode will toggle between the day mode and night mode of the display
<b>Advanced Setup</b>	Advanced Setup will allow access from delivery setup menu to delivery details screens
<b>Main Menu</b>	Main Menu will navigate to the main menu screen
<b>Setup Menu</b>	Setup Menu will navigate to the setup menu screen
<b>Clear</b>	Clear will clear all of the current text in a text box leaving just a blank cursor
<b>Caps Lock:Off</b>	Caps Lock: Off will toggle the Caps lock to On
<b>Caps Lock:On</b>	Caps Lock: On will toggle the Caps lock to Off
<b>Cancel</b>	Cancel will cancel an entry and return to the previous screen and not save changes
<b>Services</b>	Services will access the services screens in the I/O setup menu
<b>Audit Trail</b>	Audit Trail will access the audit trail screen from the security menu
<b>Software Update</b>	Software Update will access the software update screen from the security menu
<b>&lt;/=</b>	</= will allow access to addition text characters that can be used in text fields
<b>Run Calibration</b>	Run Calibration starts the calibration process and resets the LCR.iQ to 0
<b>End</b>	End will terminate a calibration and return the screen back to the current calibration screen

**Alphanumeric Keys** are primarily for data entry, such as setting a preset amount, entering a delivery prompt, or programming the register. Each alpha-numeric key has the ability to display multiple characters according to the number of times that you press a key. Press an alpha-numeric key once to display the primary key function, which is the largest character shown on each key. Here's an example: If the cursor is within a text box field, pressing the **5** key one time will display the number 5.

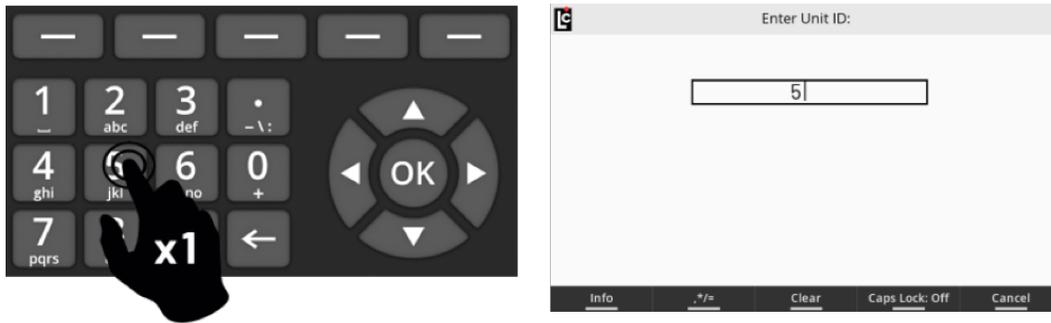

Pressing an alpha-numeric key multiple times will display additional characters. These additional characters are the smaller characters shown on each key. (Default setting is Caps Lock set to Off, which results in lower case letters. Press the Caps Lock key to turn on capitalization and enter all capital letters.) Let's extend the example above: With the cursor in a text box field, pressing the **5** key twice (within 1 second) will display the letter J. Pressing the **5** key three times successively (within 1 second) will display a K; pressing the key four times will display an L.

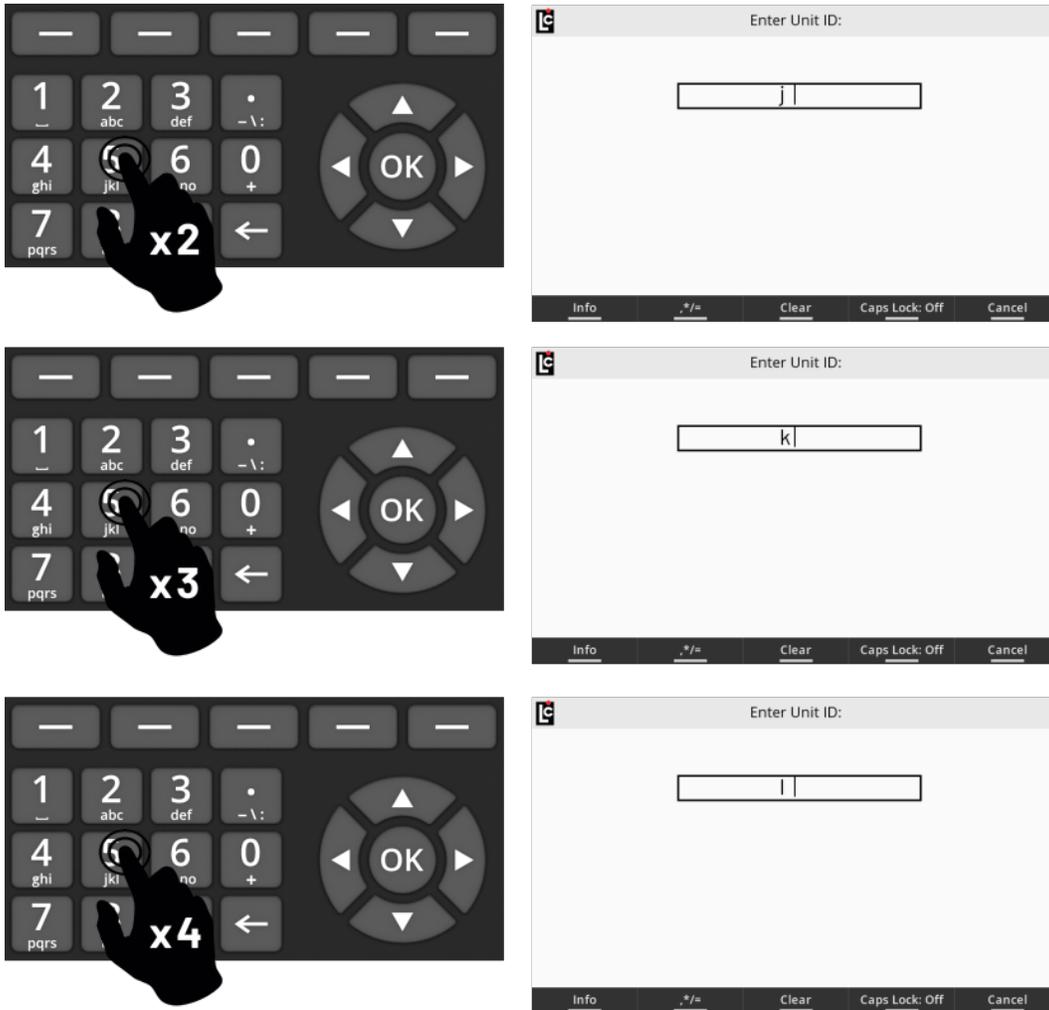


When accessing a numeric-only text box field, the alphanumeric keys will only display numbers when pressed. Pressing a key multiple times within a numeric-only field will simply display the same number (repeatedly). There is an additional alpha-numeric key that enables quick access to the most commonly used symbols on the Register. These options are **. (point) - (dash) \ (slash) : (colon) .**

The location for this key can be seen in the figure below.



**NOTE:** Additional symbols are available when a text box screen is displayed. A function key containing the symbols , \* / = will appear. Pressing this key will display a chart of many additional available symbols. Use the navigation keys to select these symbols.

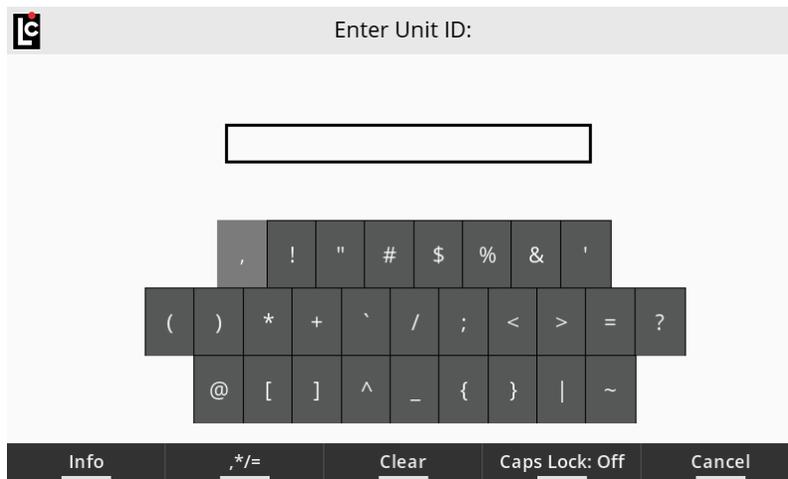

## Delivery Details

This section contains additional delivery parameters that you can configure for display on the [Delivery Screens](#) <sup>33</sup>. There are three screens that contains a number of parameters each. See the explanations for each below.

### Delivery Details (1/4)

#### I/O Board Name

(This appears on each of the three screens)

A text field that is used to identify the currently selected I/O board in the I/O board # field. The name will display on some other screens where it is necessary to clearly identify the selected board. **(Maximum - 16 Characters)**

#### Product #

(This appears on each of the three screens)

A listing of the 16 products available for setting up and calibrating the Register.

**Options:** Products 1-16 are available for setup. Only setup and calibrate products that are to be used by the Register.

### Product Code

A text field for identifying the selected product with a code. The product code will appear on most ticket formats to identify the product that was delivered. (**Maximum - 5 Alphanumeric characters**)

### Product Name

A text field for identifying the selected product with a specific name. This name will appear on most ticket formats.

### Preset Type

A list box for specifying how the Register will react when it reaches the preset amount. The choice here also affects when the end delivery command is sent and when the ticket will print.

#### Options:

- Clear – At the point when the Register reaches the preset value, the delivery ends automatically, the ticket is printed, and the preset value is set to 0.
- Multiple – At the point when the Register reaches the preset value, the delivery is paused but remains active until the user either (a) presses **Resume** , (b) sets a new preset and presses **Resume** , or (c) ends the delivery by pressing the **End & Print** button and the preset value is set to 0.
- Retain – At the point when the Register reaches the preset value, the delivery automatically ends, the ticket prints, and the original preset value is retained for the next delivery.

### Net Preset

A numeric text field for the net preset value—if net presets are accepted and temperature compensation is active. (**Maximum - 7 numeric characters**)

### Gross Preset

A numeric text field for the gross preset value—if gross presets are accepted. (**Maximum - 7 numeric characters**)

### Weight Preset

A numeric text field for the weight preset value—if weight presets are accepted. (Maximum - 7 numeric characters)

### Price Preset

A numeric text field for the price preset value—if price presets are accepted. (Maximum - 7 numeric characters)

### Multiple Deliveries?

A list box in which you can specify if the **Multiple Deliveries** feature is to be on or off. If **Multiple Deliveries** is set to **Yes** , you can fill multiple tanks at one location without being affected by the **No Flow Timer** feature (see below. This only applies to the next delivery, and will revert back to **No** automatically when the delivery completes.

If this field is set to **No** , any deliveries will need to be within the value specified in **No Flow Timer** .

**NOTE:** There is also a printer parameter, **Print Multiple Deliveries Per Site Message in Register 3/3** , that is directly affected by this setting.

### No Flow Timer

A numeric-only field for specifying the duration of the **No Flow Timer** . This is an internal timer that begins when the Register senses that there is no longer any product moving through the meter. If this timer counts up to its set point, the Register will assume that the delivery is complete and a ticker will print automatically. The default value for this field is **180 (seconds)** . Deactivate this feature by entering 0 seconds, which permits filling multiple tanks at a single location simultaneously. The timer helps to ensure that deliveries are not split between authorized and unauthorized locations. If the value is set to 0—or any value greater than 180— and the **Print Multiple Deliveries Per Site** message is set to **On** , the **Multiple Deliveries At One Site** message will print on the delivery ticket. (Maximum - 3600 Seconds)

## Price/Unit

A numeric-only text field for specifying a price per-unit. (Maximum - 7 numeric characters)

**NOTE:** The unit label will vary depending on the unit of measure that has been set up in the Register.

## Taxe/Unité


Champ texte numérique uniquement permettant de saisir une taxe par unité à appliquer au volume livré. (Maximum - 7 caractères numériques)

**REMARQUE :** Le libellé de l'unité varie en fonction de l'unité de mesure configurée dans le registre.

## Taxe en pourcentage

Champ texte numérique uniquement pour spécifier une taxe en pourcentage/unité qui s'applique au Prix/Unité. (Maximum - 6 caractères numériques)

## Détails de la livraison (2/4)

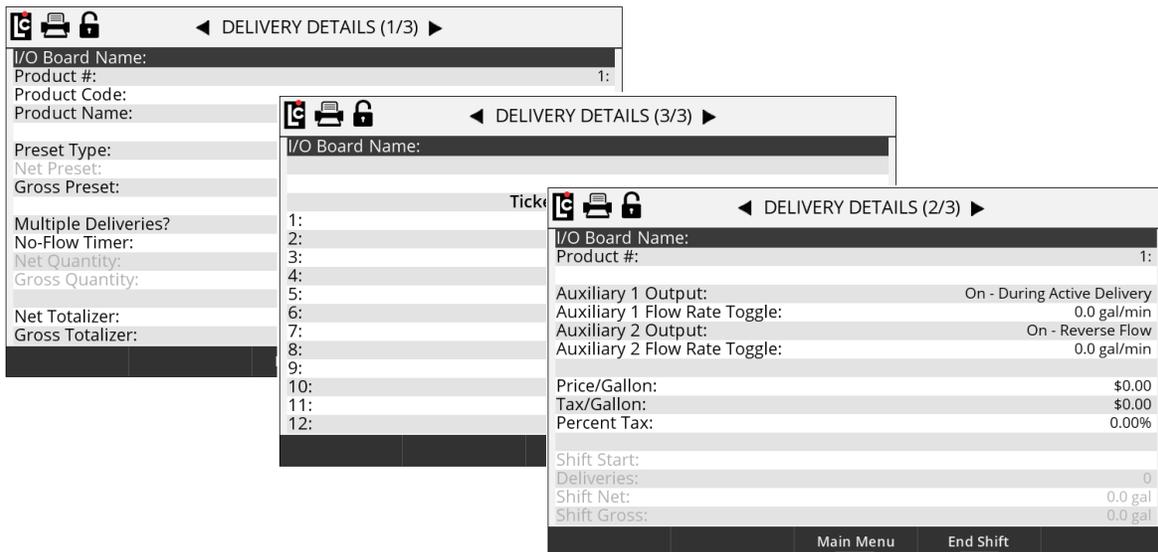

## Auxiliary 1 Output

A list box that determines how any digital output that is set to AUX 1 will operate on the selected product. To control external components, there are several features in the Register that can be set to perform according to the Auxiliary 1 and Auxiliary 2 settings. This includes pumps, injectors, PTO, throttle, alarms, and reset pulse, among others.

### Options:

- Off – Any output set to AUX 1 Calibration Mode Settings will always be off (inactive).
- On – Any output set to AUX 1 Calibration Mode Settings will always be on (Active and Sinking to ground).
- On - During Active Delivery – Any output set to AUX 1 Calibration Mode Settings will turn on (Sink to ground) when a delivery is started. It will turn off when the delivery is complete.
- On - During Run State – Any output set to AUX 1 Calibration Mode Settings will turn on (Sink to ground) when a delivery is active and not paused. The output will be on when a delivery begins. However, if the delivery pauses, the output will turn off until the delivery resumes. If the **End of delivery** command is given, the output will remain off and the delivery will end.
- On - Flow Rate Monitor – Any output set to AUX 1 Calibration Mode Settings will be on when a delivery is active. However, it will deactivate if the flow rate meets or exceeds 40 units/time. If the flow rate does not meet or exceed 40 units/time, the output will remain on.
- On - Reverse Flow – Any output set to AUX 1 Calibration Mode Settings will be off when a delivery begins. It will only turn on when the register detects flow in the negative or reverse direction.
- Reset Pulse/Delivery Start – For any delivery that uses 3rd-party remote counters requiring a reset pulse to 0.0, any output set to AUX 1 Calibration Mode Settings will output a short pulse at the start of a delivery.
- Toggle Flow Rate – Any output set to AUX 1 Calibration Mode Settings will turn on once the flow rate of the Register exceeds the set flow rate point in the **Auxiliary 1 Flow Rate Toggle** field. See below.

- Calibrated Scaled Pulse Output – Any output set to AUX 1 Calibration Mode Settings will be a calibrated pulse output that scales according to the Pulse Output Frequency setting in the calibration mode.

### Auxiliary 1 Flow Rate Toggle

A numeric-text field that can be used to program a flow rate set point when the Aux 1 is set to **Toggle flow rate** . Auxiliary 1 remains activated above the set flow rate value and deactivates when the flow rate falls below the value.

A common use for this output is an air operated valve (AOV) on the pump. When the flow rate value is attained, the AOV is activated switching the pump from low-bypass pressure mode to full-flow fuel mode (high bypass pressure). When the flow rate falls below the set value, the AOV deactivates and the pump returns to low-flow.

Another possible output is the engine throttle—to increase and decrease the RPM of the pump shaft. In applications such as these, the flow rate value in this field should be below the low- flow rate with a fully open nozzle—or the output will never turn on.

Another application of this field is to set the value as a maximum flow rate at which a valve should be closed. On fuel delivery trucks, flow valves often activate an internal switch at approximately 18 GPM (68 LPM). The value of this field is unique to each product.

### Auxiliary 2 Output

A listing that determines how any digital output that is set to AUX 2 will operate on the selected product. To control external components, there are several features in the Register that can be set to perform according to the Auxiliary 1 and Auxiliary 2 settings. This includes pumps, injectors, PTO, throttle, alarms, reset pulse, among others

#### Options:

- Off – Any output set to AUX 2 Calibration Mode Settings will always be off (inactive).
- On – Any output set to AUX 2 Calibration Mode Settings will always be on (Active and Sinking to ground).

- On - During Active Delivery – Any output set to AUX 1 Calibration Mode Settings will turn on (Sink to ground) when a delivery is started. It will turn off when the delivery is complete.
- On - During Run State – Any output set to AUX 1 Calibration Mode Settings will turn on (Sink to ground) when a delivery is active and not paused. The output will be on when a delivery begins. However, if the delivery pauses, the output will turn off until the delivery resumes. If the **End of delivery** command is given, the output will remain off and the delivery will end.
- On - Flow Rate Monitor – Any output set to AUX 2 Calibration Mode Settings will be on when a delivery is active. However, it will deactivate if the flow rate meets or exceeds 40 units/time. If the flow rate does not meet or exceed 40 units/time, the output will remain on.
- On - Reverse Flow – Any output set to AUX 2 Calibration Mode Settings will be off when a delivery begins. It will only turn on when the register detects flow in the negative or reverse direction.
- Reset Pulse/Delivery Start – For any delivery that uses 3rd-party remote counters requiring a reset pulse to 0.0, any output set to AUX 2 Calibration Mode Settings will output a short pulse at the start of a delivery.
- Toggle Flow Rate – Any output set to AUX 2 Calibration Mode Settings will turn on once the flow rate of the Register exceeds the set flow rate point in the **Auxiliary 1 Flow Rate Toggle** field. See below.
- Calibrated Scaled Pulse Output – Any output set to AUX 2 Calibration Mode Settings will be a calibrated pulse output that scales according to the Pulse Output Frequency setting in the calibration mode.

### Auxiliary 2 Flow Rate Toggle

A numeric-text field that can be used to program a flow rate set point when the AUX 2 is set to **Toggle flow rate**. Auxiliary 2 remains activated above the set flow rate value and deactivates when the flow rate falls below the value.

### Shift Start

A read-only field that displays the time and date that the current active shift began.

### Deliveries

A read-only field that displays the number of deliveries made during the currently active shift. This value will reset each time the **Clear-Shift** command is given and the shift ticket prints.

### Shift Net

A read-only field that will display the total net volume that was delivered during the currently active shift. This value will reset each time the **Clear-Shift** command is given and the shift ticket prints.

### Shift Gross

A read-only field that will display the total gross volume that was delivered during the currently active shift. This value will reset each time the **Clear-Shift** command is given and the shift ticket prints.

### Net Quantity

A read-only numeric field that displays the current net delivery quantity.

### Gross Quantity

A read-only numeric field that displays the current gross delivery quantity.


### Net Totalizer

A numeric-text field that display the current accumulative net totalizer value of the selected product. This is a non-resettable totalizer. However, it is programmable in the Weight and Measures (Calibration) mode—if reprogramming is necessary. **(Maximum - 9 numeric characters)**

### Gross Totalizer

A numeric-text field that displays the current accumulative gross totalizer value of the selected product. This is a non-resettable totalizer. However, it is programmable in the Weight and Measures (Calibration) mode—if reprogramming is necessary. **(Maximum - 9 numeric characters)**

## Delivery Details (3/4)

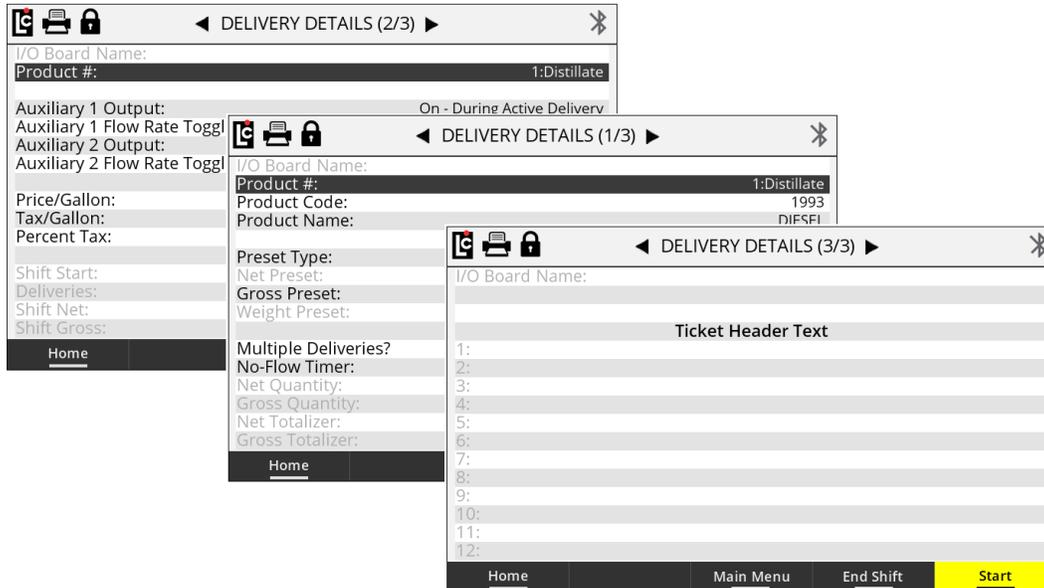

### Ticket Header Text 1-12

Each ticket header line is an alphanumeric text field that is available for entering data that will print at the top of each ticket. Typically, this is useful for printing the company name, address, phone number, email, etc of the marketer. You can enter up to 12 lines of header text, and also insert blank lines between lines of text.

Header lines 11 and 12 are for Auxiliary 1 (Header 11) and Auxiliary 2 (Header 12). These are programmable only when the Register is in the calibration mode. Use these lines to print a specific message on the ticket when triggered by the either of these **Auxiliary** settings: **On** , **On During Delivery** , or **On During Run State** .

## Delivery Details (4/4)

### Ticket Footer Text 1-8

Each ticket footer line is an alphanumeric text field that is available for entering data that will print at the bottom of each ticket. You can enter up to 8 lines of footer text, and also insert blank lines between lines of text.

## End Shift

Pressing the **End Shift** function key to end the shift. Respond to the prompt “**Are you sure you want to end your shift?**” with either the **Yes** or **No** function keys:


- No - Returns the Register back to the Delivery Details screen.
- Yes - Prints the end-of-shift ticket if a ticket printer is available and ready.

## Diagnostics

Diagnostics screens give you easy access to view real-time diagnostics of the Register. If the printer is available, the you can print a diagnostic ticket. These screens present important system information, as well as on screen visual indications for register state, inputs, outputs and board/sensor status. The diagnostic mode also provides access to the comprehensive list of message data logs that are available in the Register.

### Diagnostics Screen 1/6

A number of diagnostic values appear on screen 1/6 :

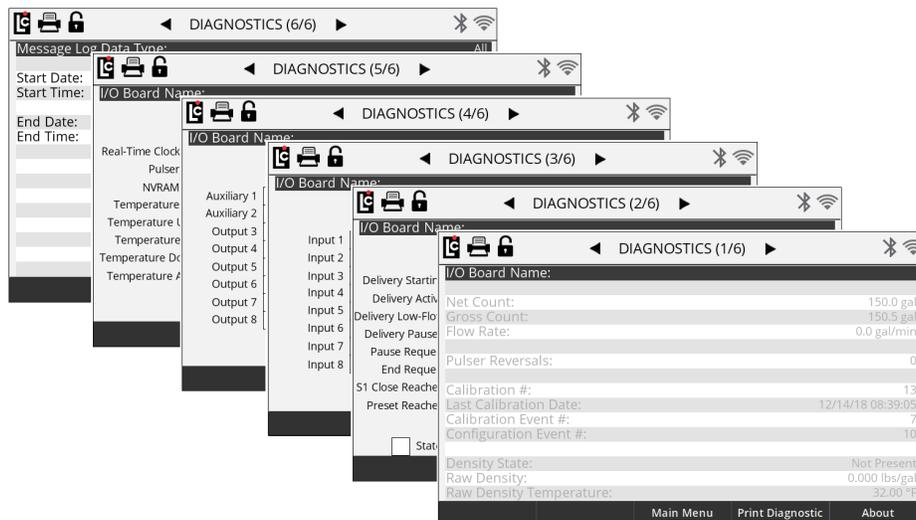

**I/O Board Name** – A text field that identifies the currently selected I/O board in the **I/O board #** field. The name will also appear on other screens to clearly identify the selected board. **(Maximum - 16 Characters)**

**Net Count** – A read-only field showing the current net delivery volume displayed on the Register.

**Gross Count** – A read-only field showing the current gross delivery volume displayed on the Register.

**Flow Rate** – A read-only field showing the current flow rate registered by Register during a delivery.


**Pulser Reversals** – A read-only field that accounts for any quadrature pulser faults registered by the Register during a delivery. **Calibration #** – A read-only counter that increments one number each time the Register enters the calibration mode. This field is for metrological and troubleshooting use only.

**Last Calibration Date** – A read-only field displaying the last date and time the Register entered into the calibration mode. **Calibration Event #** – A read-only counter that increments one number each time the Register enters the calibration mode and a calibration change is made. This field only increments one time per entry into calibration even if multiple changes are made. This field is for metrological and troubleshooting use only.

**Configuration Event #** – A read-only counter that increments one number each time (a) the Register enters the calibration mode and (b) a configuration field changes. This field only increments one time per entry into calibration even if multiple changes are made. This field is for metrological and troubleshooting use only.

## Diagnostics Screen 2/6

**Register State** – a real-time view of the current status of the key Register state fields. This is useful to see if a parameter is active (Yellow), not active (White), or in an error state (Red).


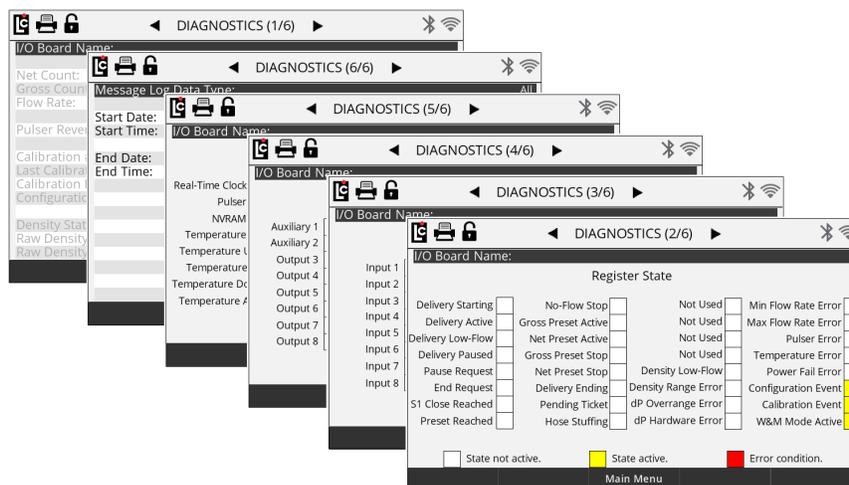


## Diagnostics Screens 3/6 and 4/6

I/O Board inputs and outputs appear on screens 3/6 and 4/6. These provide a real-time view of the current status of Register I/O board digital inputs and outputs. These are useful in monitoring inputs and outputs that may have a status of **on** (Yellow), **off** (White), or **error** (Red).

## Diagnostics Screen 5/6

Potential error conditions are shown on Diagnostics Screen 5/6. The status will be either off (White) or error (Red).

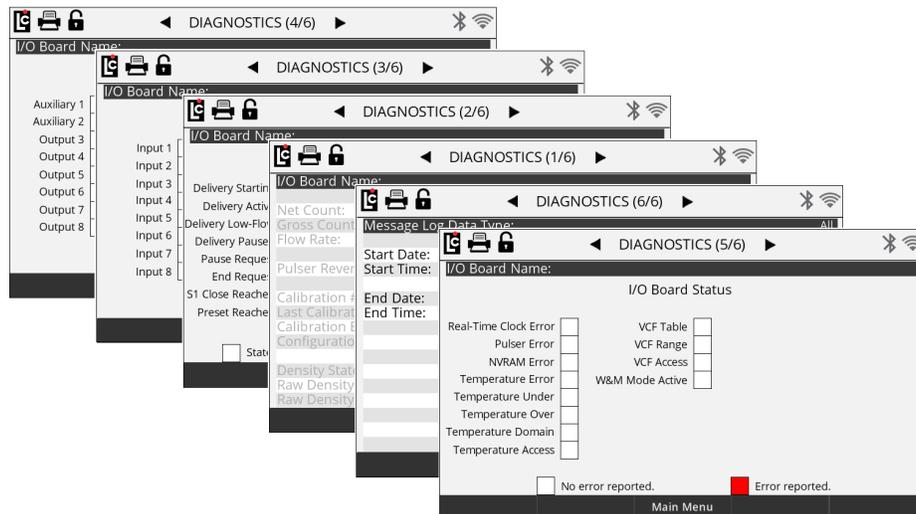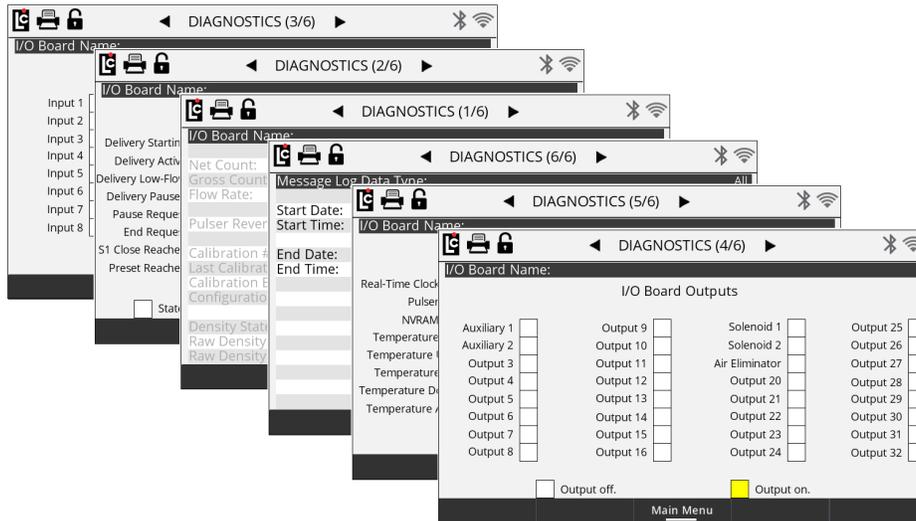


## Diagnostics Screen 6/6

Message Logging is a tool within the register that allows a user to pull log files from the register and display, print and export log information within a given date range.


### Message Log Data Type

A list box that can be used to select a data log that can be viewed on screen and printed. Upon selecting **Message Log Data Type**, a drop-down menu appears and provides the following log file types you can view.

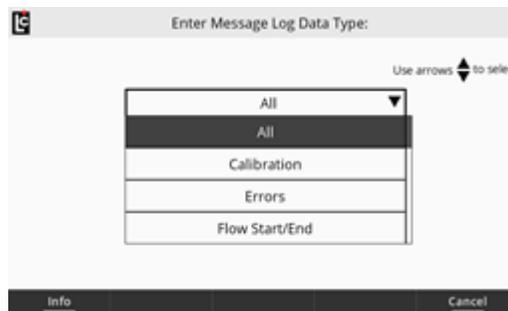

**Message Log Data Types** include the following: All, Calibration, Errors, Flow Start/End, Hardware Diagnostics, LCP Diagnostics, Operator Actions, Parameter Changes, Shift Start/End, Software Diagnostics, and Warnings.


Once a log file type is selected, press the function key **View Logs** to display the logs on the screen within the given date range. Once the log is viewable on screen, you can press the function key **Print** to print the log (if printer is installed).

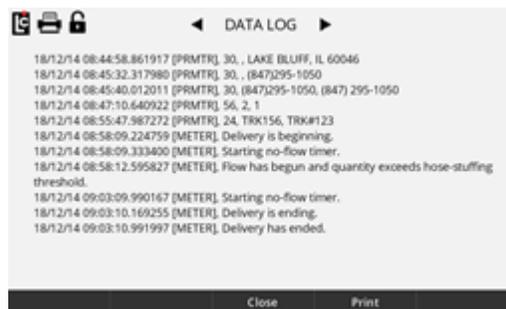

## Setup Menu


The Setup Menu contains a list of menu options for configuring the Register for operation.

Typically, the setup menu options are set up when the register is installed or calibrated. Settings that are programmed using the setup menu options will affect how the register will display, print, report and operate. When setting up the Register, it is important to understand how each of these settings affect the Register register and contribute to proper operation for the application.

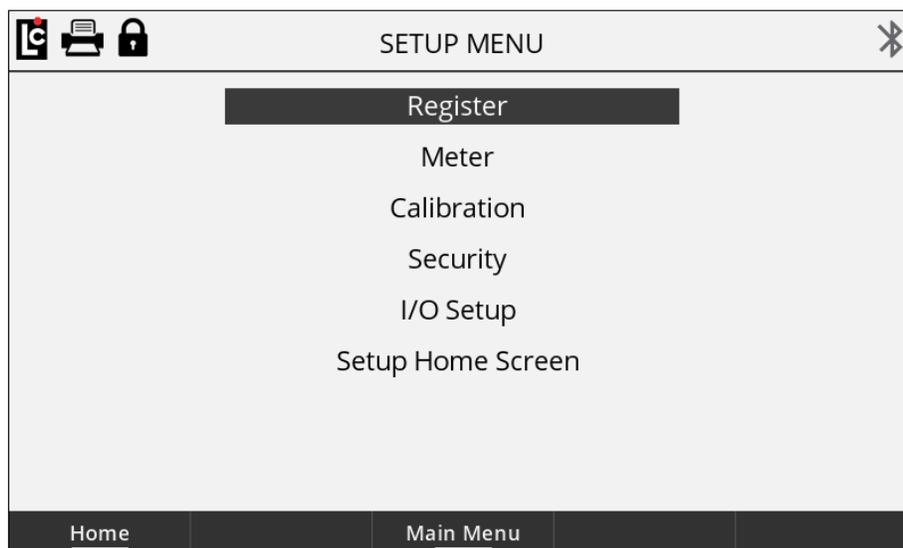

## Register Settings

Register menu options can be found on three screens. These parameters are for configuring general functionality of the Register, and how it will interact with components in the system.

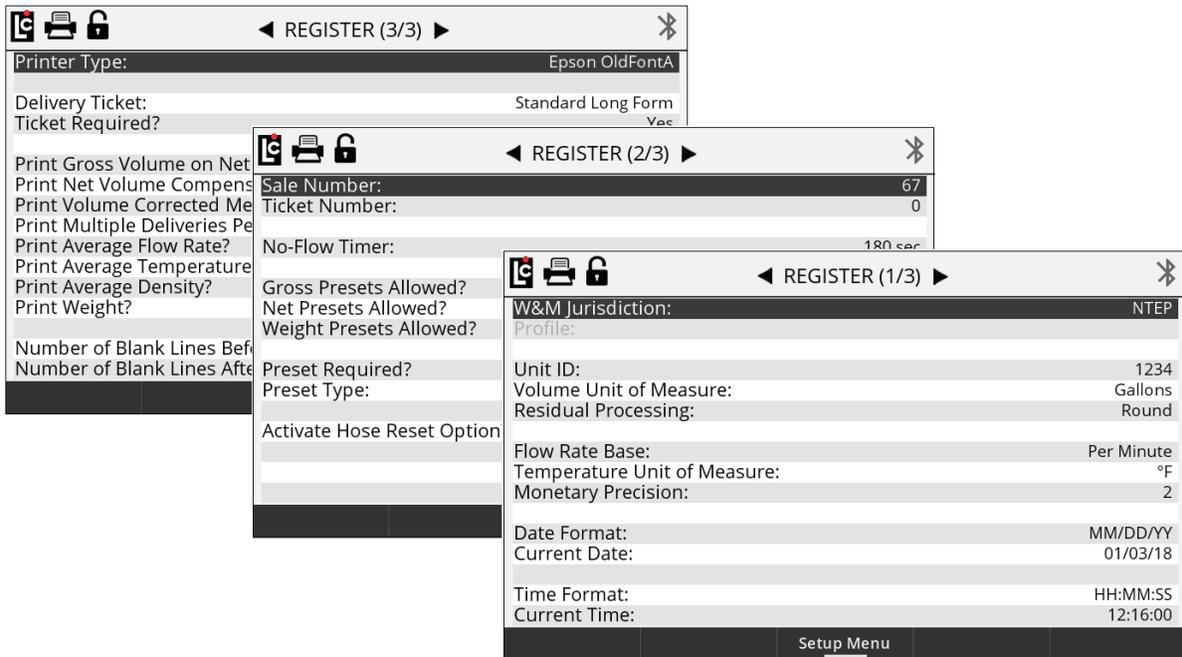

### Register (1/3)

**W&M Jurisdiction** – Selecting the proper local jurisdiction option will automatically adjust the available setup menu options and remove options that are not acceptable based on the selection.

Options:

- NTEP - National Type Evaluation Program - US W&M
- Measurement Canada

**Unit ID** – A text field for identifying the equipment or meter that the Register is associated with. **(Maximum - 10 alphanumeric characters)**

**Volume Unit of Measure** – A list box for setting the volumetric unit of measure to be used by the register for flow measurement.

Options:

- Gallon
- Litre

- Cubic Meter
- LB (Pound)
- KG (Kilograms)
- Barrel
- Other

**Residual Processing** – A list box for selecting how the Register will display volumes less than the least significant digit.

Options:

- Round - Adjust delivery amount to the closest least significant digit.
- Truncate - Throw away the remaining value and always round down.

**Flow Rate Base** – A list box for selecting the time unit for flow measurement. This field will affect how the unit of flow rate measure will display on the screen—and what appears on printed tickets and transactional records.

Options:

- Per Minute
- Per Hour
- Per Second

**Temperature Unit of Measure** – A list box for selecting the unit of measure used when a temperature probe is connected to the Register.

Options:

- °F - Fahrenheit
- °C - Celsius

**Monetary Unit of Measure** – A text field for identifying the type of currency. (Maximum - 3 alphanumeric characters)

**Monetary Precision** – A list box that is used to select the number of decimal places to be used when printing and displaying pricing.

Options:

- 0 (0) - No decimal place
- 1 (0.0) - One digit after the decimal place
- 2 (0.00) - Two digits after the decimal place
- 3 (0.000) - Three digits after the decimal place
- 4 (0.0000) - Four digits after the decimal place

**Date Format** – A list box that is used to set the format for displaying and printing the Register date.

Options:

- MM/DD/YY - Month/Day/Year
- DD/MM/YY - Day/ Month/Year

**Current Date** – A fixed data entry field setting the internal calendar of the Register according to the date format field option. The Register will update the calendar automatically according to this setting. The date can be displayed on screen, printed on the ticket, and appear in each transaction record.

**Time Format** – A list box that is used to set the format for displaying and printing the Register time.

Options:

- HH/MM/SS - Time will display with Hours/Minutes/Second
- AM/PM - Time will display with Hours/Minutes with am or pm

**Current Time** – A fixed-data entry field for setting the register time clock of the Register according to the time format field option. The Register will update the time according to this setting. The time can be displayed on screen, printed on the ticket, and appear in each transaction record.

## Register (2/3)

The screenshot displays three overlapping windows of the Register setup menu. The top window, titled 'REGISTER (1/3)', shows settings for 'W&M Jurisdiction: NTEP' and 'Unit ID: 1734'. The middle window, titled 'REGISTER (3/3)', shows 'Printer Type: Epson OldFontA', 'Delivery Ticket: Standard Long Form', and 'Ticket Required? Yes'. The bottom window, titled 'REGISTER (2/3)', shows 'Sale Number: 67', 'Ticket Number: 0', 'No-Flow Timer: 180 sec', 'Gross Presets Allowed? Yes', 'Net Presets Allowed? Yes', 'Weight Presets Allowed? No', 'Preset Required? No', 'Preset Type: Clear', and 'Activate Hose Reset Option? Yes'. A 'Setup Menu' button is visible at the bottom of the bottom window.

**Sale Number** – A numeric-only text field that will automatically increment one digit for each delivery or transaction that is started by the Register. The sale number can be set to any initial numeric value up to 6 digits, and will increment from that value. A new Register will always start from 1. This is a required field on all standard ticket formats.

**Ticket Number** – A numeric-only text field that will automatically increment one digit for each delivery ticket that is printed by the Register including duplicate tickets of the previous delivery. The ticket number can be set to any initial numeric value up to 6 digits, and will increment from that value. A new Register will always start at ticket number 0 which deactivates the ticket number feature. If deactivated, the ticket number will not increment and will not print on any of the delivery ticket formats.

**No Flow Timer** – A numeric-only text field that sets a timer (in seconds) to automatically terminate an active delivery (and prints a ticket, when applicable) if no product movement is sensed during the duration of the timer. This timer will not activate until at least one whole unit of volume has been registered by the Register.

Setting this field to 0 will deactivate the No Flow Timer. Also, setting this field to a value of 0 or a value greater than 180 (up to 3600) may activate the “Print Multiple Deliveries Per Site Message”

**NOTE: See Register (3/3) to setup the “Print Multiple Deliveries Per Site Message”.**

The No Flow Timer can also be toggled on and off (180 to 0) in the Setup Delivery mode by activating the Multiple Deliveries Per Site option in Configure Delivery Setup menu.

**Gross Presets Allowed?** – A list box that enables or disables the option and the ability to use gross presets when making a delivery.

Options:

- No - Gross presets are not allowed
- Yes - Gross presets are allowed

**Net Presets Allowed?** – A list box that enables or disables the option and the ability to use gross presets when making a delivery. Net presets require an ETVC kit to be installed and temperature compensation to be active on the Register.

Options:

- No - Net presets are not allowed
- Yes - Net presets are allowed

**Weight Presets Allowed?** – A list box that enables or disables the option and the ability to use weight presets during a delivery.

Weight presets require that an automatic density sensor be installed, or otherwise that the manual density entry is active on the Register.

Options:

- No - Weight presets are not allowed
- Yes - Weight presets are allowed

**Price Presets Allowed?** – A list box that enables or disables the option and the ability to use price presets when making a delivery. Price presets require the Price/Unit to not be zero.

Options:

- At Least the Entered Price
- No - Price presets are not allowed
- No More than the Entered Price

**Preset Required** – A list box that specifies a requirement for the user to enter a preset value for every transaction of the Register.

Options:

- No - Presets are optional
- Yes - Presets are required

**Preset Type** – A list box that is used to setup how the Register will respond when the preset amount has been reached. These setting options will affect when the end delivery command is sent and also when the ticket will print.

Options:

- Clear – At the point the preset value is reached, the delivery automatically ends, the ticket prints, and the preset value is set to 0.
- Multiple – At the point the preset value is reached, the delivery is paused but remains active–until the user either presses resume, sets a new preset and presses resume or ends the delivery by pressing the **End & Print** button and the preset value is set to 0.

- Retain – At the point the preset value is reached, the delivery automatically ends, the ticket prints, and the preset value that was originally set is retained for the next delivery.

**NOTE: See Operating the Register**

preset type.

 for more detail on selecting a

**Activate Hose Reset Options?** – A list box for selecting if the **Hose Reset** feature will be active on the Register. When this feature is set to **YES**, the Register will present the onscreen action key **Hose Reset** when the **START** key is pressed. This onscreen action will display until the register has delivered up to 1 gallon (4 Litres), then this key will disappear from the onscreen action options.

**Fully-packed hose:** To comply with Weights & Measures requirements, it is necessary to start and stop each delivery with a fully packed hose. This will be the case with normal deliveries. However, there are times where the hose is not fully packed (for example, after a preset delivery). As such, the hose must be packed and the register zeroed prior to making the next delivery.

Options:

- Yes - Hose reset option is active
- No - Hose reset option is not active

**NOTE: See Operating the Register**

hose reset feature.

 for more detail on using the

## Register (3/3)

REGISTER (2/3)	
Sale Number:	67
Ticket Number:	0
No-Flow Timer:	180 sec

REGISTER (1/3)	
W&M Jurisdiction:	NTEP
Profile:	
Unit ID:	1224
Volume Unit of Measure:	
Residual Processing:	
Flow Rate Base:	
Temperature Unit of Measure:	
Monetary Precision:	

REGISTER (3/3)	
Printer Type:	Epson OldFontA
Delivery Ticket:	Standard Long Form
Ticket Required?	Yes
Print Gross Volume on Net Deliveries?	No
Print Net Volume Compensation Parameter?	No
Print Volume Corrected Message?	Yes
Print Multiple Deliveries Per Site Message?	Yes
Print Average Flow Rate?	No
Print Average Temperature?	No
Print Average Density?	No
Print Weight?	No
Number of Blank Lines Before Ticket:	0
Number of Blank Lines After Ticket:	6

**Printer Type** – A list box for selecting type of printer connect to the Register—if a printer is necessary.

Options:

- EPSON NewFontB - For use with EPSON 220 roll printers
- EPSON NewFontA - For use with EPSON TM-T88iii (Wired) and EPSON TM-P80 (wireless Bluetooth) thermal printers
- EPSON OldFontA - For use with EPSON 295 Slip printers
- EPSON OldFontB - For use with EPSON 300 Roll Printers
- OKIDATA ML184T - For use with Okidata ML184T
- BLASTER - For use with Cognitive Solutions Thermal Printer

**Delivery Ticket** – A list box that is used to select the desired Register base ticket format to be used when printing tickets. There are four base ticket formats available, however additional information such as price, tax, header, average temperature, average flow rate, and more can be added to each base ticket format when setting up the Register.

Options:

- Standard Long Form - For tickets when a larger area is available for printing more ticket details.
- Standard Short Form - For tickets with a small fixed printing area such as a preprinted ticket previously used with mechanical registration.
- Detailed with Totalizers - For markets such as terminals and aviation that require start and end totalizers printed on the ticket.
- Long Form without Time - For use by 3rd party devices that pass through date/time, and do not require the Register time stamp on the ticket.
- English/French Long Form – Similar to the Standard Long Form ticket but with French.
- English/French Short Form - Similar to the Standard Short Form ticket but with French.
- English/French Custom – For specific Canadian markets.
- No Ticket - When Register will not print any ticket. However, a 3rd party may still pass-through print information by means of the LCP communication protocol.

Standard Long Form (Minimum Options)

```

START          10/30/18 08:15:12
FINISH         10/30/18 08:21:15

START COUNT    0.0 GALLONS
END GROSS COUNT 100.0 GALLONS
GROSS DELIVERY 100.0 GALLONS
1993 REG. GASOLINE  GASOLINE 1
SALE NUMBER    2232
METER NUMBER   368251
UNIT ID        TR3526
    
```

Detailed with Totalizers (Minimum Options)

```

SALE NUMBER    2232
TIME START     10/30/18 08:15:12
TIME END       10/30/18 08:21:15
START COUNT    0.0 GALLONS
END GROSS COUNT 100.0 GALLONS
GROSS DELIVERY 100.0 GALLONS
1990 REG. GASOLINE  GASOLINE 1
START TOTALIZER 2563215.1 GALLONS
END TOTALIZER  2563315.1 GALLONS
    
```

Standard Short Form (Minimum Options)

```

SALE# 2251 DATE 10/30/18 08:15:12
COUNT: START 0.0 END 100.0
GROSS DELIVERY 100.0
1993 REG. GASOLINE  GASOLINE 1
    
```

Long Form without Time (Minimum Options)

```

DATE          10/30/18
START COUNT   0.0 GALLONS
END GROSS COUNT 100.0 GALLONS
GROSS DELIVERY 100.0 GALLONS
1993 REG. GASOLINE  GASOLINE 1
    
```

In the ticket options shown above, the minimum amount of information available is shown for each format type. Information such as ticket headers, pricing, and ticket number are options

that will print on any of these formats—if data is entered into the appropriate fields. Also, there are additional fields listed in the options below that can print on all of the above tickets (when enabled).

**Ticket Required?** – A list box for choosing whether or not a ticket is necessary to start a delivery. In most cases, Weights & Measures-governed truck applications will require a printed ticket for each transaction.

Options:

- Yes - The previous delivery ticket must be printed completely, a new ticket must be in place and the printer ready in order to begin a delivery.
- No - No ticket is required to begin a delivery. However, if a ticket printer and ticket are in place, then the Register will be able to print.

**Print Gross Volume on Net Deliveries?** – A list box used to add a printed line(s) to the delivery ticket showing the Gross Delivery information along with the Net Delivery information when temperature compensation is active. If temperature compensation is not active, all delivery amounts will automatically be Gross Delivery amounts. If using the ticket format Detailed with Totalizers, the Gross Totalizers will also be printed with the Net Totalizers when active.

Options:

- Yes - Prints line(s) on the ticket showing the Gross Delivery information
- No - No additional line(s) are printed

```

SALE #  2251  DATE 10/30/18 8:15:29
COUNT: START  0.0  END      100.0
GROSS DELIVERY          101.5 GALLONS
NET DELIVERY            100.0 GALLONS
1075  PROPANE                      LPG  1
TABLE 24  SG                        0.505
VOLUME CORRECTED TO          60 DEG F

```

**Print Net Volume Compensation Parameter?** – A list box for adding a printed line to the delivery ticket that shows the selected temperature compensation table and parameter that are currently in use by the Register.

Options:

- Yes - Prints a line on the ticket showing compensation table and parameter
- No - No additional line is printed

```

SALE #  2251  DATE 10/30/18 8:15:29
COUNT: START  0.0  END      100.0
GROSS DELIVERY          101.5 GALLONS
NET DELIVERY            100.0 GALLONS
1075  PROPANE                      LPG  1
TABLE 24  SG                        0.505
VOLUME CORRECTED TO          60 DEG F

```

**Print Volume Corrected Message?** – A list box for adding a printed line to the delivery ticket that shows the product selected is volume-corrected to the selected base temperature of the

compensation table. Typical settings for base temperature at 60 °F / 15 °C—depending on the selected compensation table. However, some tables may vary.

Options:

- Yes - Prints a line on ticket showing the VOLUME CORRECTED TO message
- No - No additional line is printed

```
SALE # 2251 DATE 10/30/18 8:15:29
COUNT: START 0.0 END 100.0
GROSS DELIVERY 101.5 GALLONS
NET DELIVERY 100.0 GALLONS
1075 PROPANE LPG 1
TABLE 24 SG 0.505
VOLUME CORRECTED TO 60 DEG F
```

**Print Multiple Deliveries Per Site Message?** – A list box for adding a printed line to the delivery ticket showing that multiple deliveries were made at a site. This message will print only if the **No Flow Timer** is set to value of 0 seconds or greater than 180 seconds. This line will also print if the **Select Multiple Delivery** is an active option in the **Setup Delivery** mode.

Option:

- Yes - Prints line on ticket: MULTIPLE DELIVERIES AT ONE SITE
- No - No additional line is printed

```

SALE # 2251 DATE 10/30/18 8:15:29
COUNT: START 0.0 END 100.0
GROSS DELIVERY 101.5 GALLONS
NET DELIVERY 100.0 GALLONS
1075 PROPANE LPG 1
TABLE 24 SG 0.505
VOLUME CORRECTED TO 60 DEG F
- MULTIPLE DELIVERIES AT ONE SITE -
    
```

**Print Average Flow Rate?** – A list box for adding a printed line to the delivery ticket showing the average flow rate throughout the duration of a delivery transaction.

Options:

- Yes - Prints line on the ticket displaying the AVERAGE FLOW RATE
- No - No additional line is printed

```

SALE NUMBER 2232
TIME START 10/30/18 08:15:12
TIME END 10/30/18 08:21:15
START COUNT 0.0 GALLONS
END GROSS COUNT 100.0 GALLONS
GROSS DELIVERY 100.0 GALLONS
1990 REG. GASOLINE GASOLINE 1
AVERAGE FLOW RATE 86.5 GAL/MIN
AVERAGE TEMPERATURE 63.7 DEG F
START TOTALIZER 2563215.1 GALLONS
END TOTALIZER 2563315.1 GALLONS
    
```

**Print Average Temperature?** – A list box for adding a printed line to the delivery ticket showing the average temperature throughout the duration of a delivery transaction.

Options:

- Yes - Prints line on the ticket showing the AVERAGE TEMPERATURE
- No - No additional line is printed

SALE NUMBER	2232
TIME START	10/30/18 08:15:12
TIME END	10/30/18 08:21:15
START COUNT	0.0 GALLONS
END GROSS COUNT	100.0 GALLONS
GROSS DELIVERY	100.0 GALLONS
1990 REG. GASOLINE	GASOLINE 1
AVERAGE FLOW RATE	86.5 GAL/MIN
AVERAGE TEMPERATURE	63.7 DEG F
START TOTALIZER	2563215.1 GALLONS
END TOTALIZER	2563315.1 GALLONS

**Print Average Density?** – A list box for adding a printed line to the delivery ticket showing the average density throughout the duration of a delivery transaction.

Options:

- Yes - Prints line on the ticket showing the AVERAGE DENSITY
- No - No additional line is printed

SALE NUMBER	2232
TIME START	10/30/18 08:15:12
TIME END	10/30/18 08:21:15
START COUNT	0.0 GALLONS
END GROSS COUNT	100.0 GALLONS
GROSS DELIVERY	100.0 GALLONS
1990 REG. GASOLINE	GASOLINE 1
AVERAGE DENSITY	6.758 LBS/GAL
WEIGHT (REF.)	675.8 LBS
START TOTALIZER	2563215.1 GALLONS
END TOTALIZER	2563315.1 GALLONS


**Print Weight?** – A list box for adding a printed line to the delivery ticket showing the weight (reference) of a delivery transaction.

Options:


- Yes - Prints line on the ticket showing the WEIGHT (REFERENCE)
- No - No additional line is printed

SALE NUMBER	2232
TIME START	10/30/18 08:15:12
TIME END	10/30/18 08:21:15
START COUNT	0.0 GALLONS
END GROSS COUNT	100.0 GALLONS
GROSS DELIVERY	100.0 GALLONS
1990 REG. GASOLINE	GASOLINE 1
AVERAGE DENSITY	6.758 LBS/GAL
WEIGHT (REF.)	675.8 LBS
START TOTALIZER	2563215.1 GALLONS
END TOTALIZER	2563315.1 GALLONS

**Number of Blank Lines Before Ticket** – A numeric-only text field that will print (feed) blank lines on all tickets prior to printing any of the Register printer text. Typically, this helps to align a ticket when using a slip printer. **(Maximum - 20 lines)**

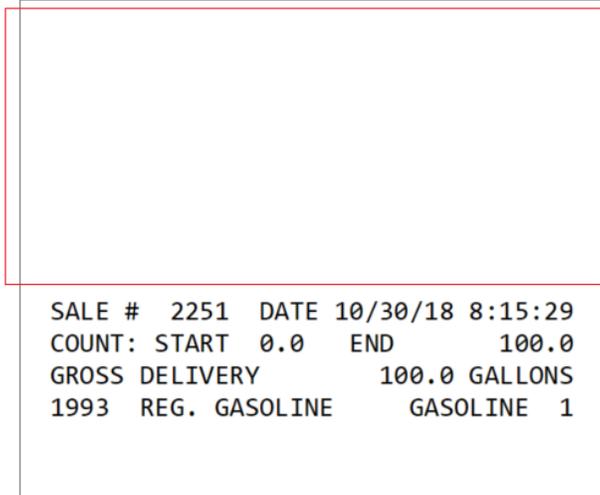


**Number of Blank Lines After Ticket** – A numeric-only text field that will print (feed) blank lines on all tickets after printing the last line of text send to the Register. With roll printers, this typically helps to feed the roll paper beyond the razor used to remove the ticket. **(Maximum - 20 lines)**

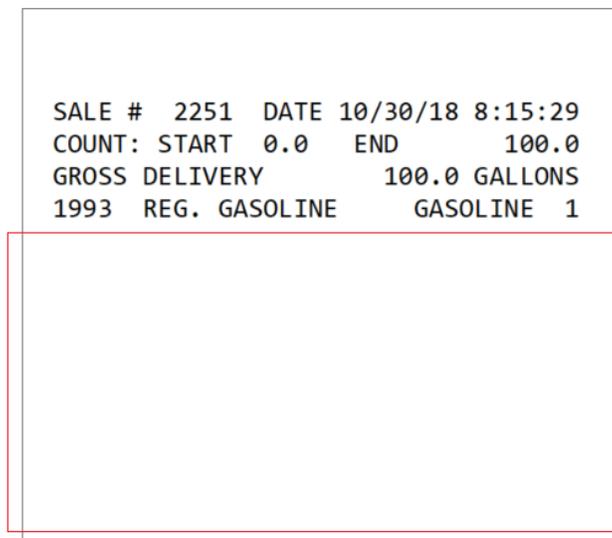

## Meter Settings

Meter menu options allow the user to set up information specific to the meter that is connected to the Register. It will be identified by the I/O Board #, UID, and Name fields.

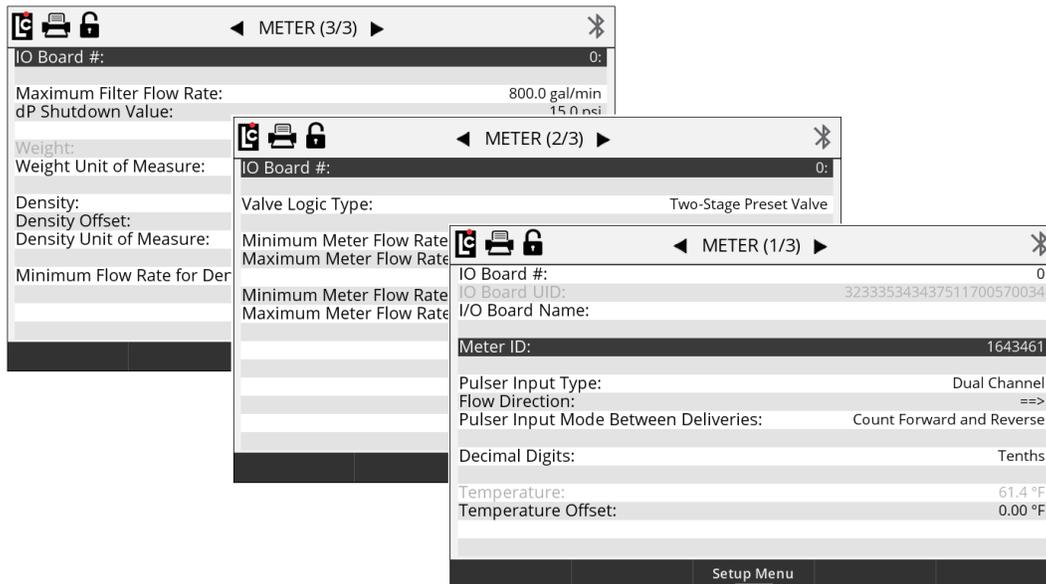

### Meter (1/3)

**I/OBoard#** – A numeric-only text field for identifying an I/O board that is connected to the Register. Settings for the each I/O board can be made when the selected I/O board appears in this field. The main I/O board in the Register is always I/O board 0. **(Maximum setting is currently 0)**

**I/O Board UID** – This read-only fields displays the serial number of the I/O board# that is currently selected.

**I/O Board Name** – A text field for identifying the currently selected I/O board in the I/O board # field. The name will also appear in other screens to clearly identify the selected board. **(Maximum - 16 alphanumeric characters)**

**Meter ID** – A text field for identifying a meter that is connected to the Register, Typically, the serial number of the meter is entered here. The value of this field is also printed on the Register calibration ticket. **(Maximum - 10 alphanumeric characters)**

**Pulser Input Type** – A list box for selecting the type of pulse input signal that will be connected to the selected I/O board.

Options:

- Dual Channel - 2 channel quadrature pulser signal such as the Register internal pulser or a POD pulser.
- All Single Channel - Single channel square wave signal
- Triple Channel - 3 channel pulser square wave signal
- None - No pulser is connected to the Register

**Flow Direction** – A list box field for inverting the direction of flow within the Register. If the register is counting in the reverse direction when first installed, inverting the flow direction will cause the register to count in the opposite direction.

Options:

- = = >
- < = =

**Pulser Input Mode Between Deliveries** – A list box field for specifying how the Register will respond to any registered pulse signal when the register is not in an active delivery.

Options:

- Count Forward and Reverse - A registered pulse signal—either forward or reverse—will directly affect the accumulative totalizer readings. It will also display the volume on the idle delivery screen.
- Forward Count Only - A registered pulse signal, in the forward direction only, will directly affect the accumulative totalizer readings. It will also display the volume on the idle delivery screen.
- Ignore - Any pulse signal that is detected when a delivery is not active will be ignored by the Register.

- Reverse Count Only - A registered pulse signal, in the reverse direction only, will directly affect the accumulative totalizer readings. It will also display the volume on the idle delivery screen.

**HEPCV In Use?** – A list box for enabling or disabling the Hose End Press Control Valve. This feature is to be enabled only when using a hose end press control valve in an aviation fueling system. This feature is designed to reduce back pressure and flow surges in the system.

Options:

- Yes – Enables HEPCV
- No – Disables HEPCV

**Decimal Digits** – A list box field that sets the decimal place for the displayed volume and also the shift and accumulative totalizers. Options:


- Tenths - Sets the decimal place to the tenth unit position (xxxxx.x)
- Whole - Sets the decimal place to the whole units position (xxxxxx)
- Hundredths - Sets the decimal place to the hundredths position (xxxx.xx)

**Temperature** – This numeric-only text field displays the current temperature sensed by the Register temperature probe when installed. Use this field to set a temperature offset, if the value is within the allowed range of the temperature offset field below. If no probe is installed, this value will read --.- .

**Temperature Offset** – A numeric-only text field for specifying an offset to the value of the current temperature reading. A value of +/- .54 degrees F or +/- .3 degrees C is allowed by Weights and Measures. When an offset is entered and within the acceptable range, the current temperature will automatically be adjusted by the amount of this value. **(Floating point from -.30 to +.30°C or -.54 to +.54°F)**



## Meter (2/3)

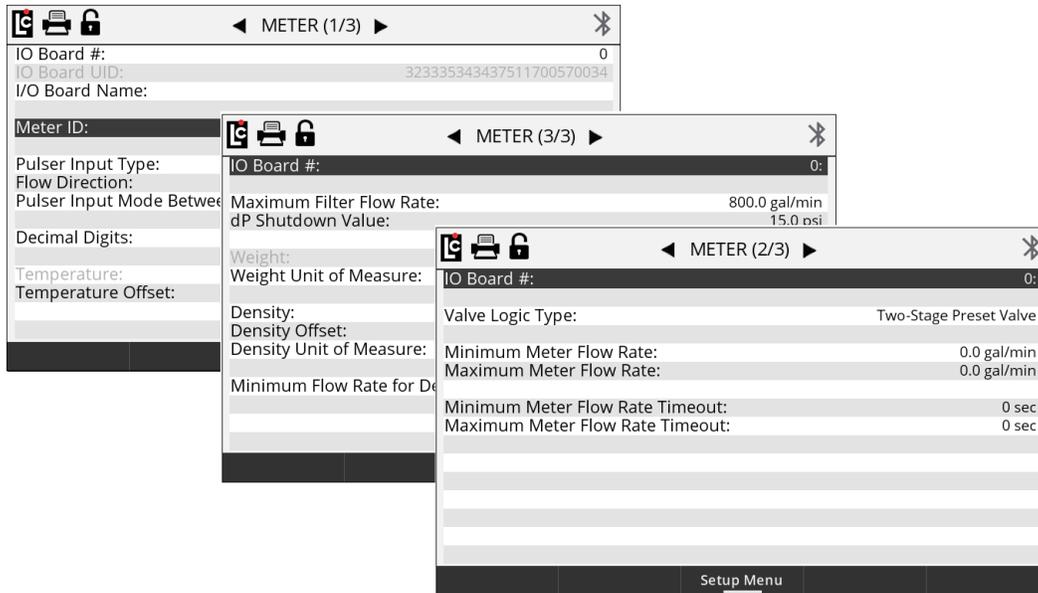


**Valve Logic Type** – A list box field that is used to select the logic to be used when connecting a solenoid valve to the Register.


Options:

- Two-Stage Preset Valve - This logic is to be used with standard 2 stage preset valves.  
With this logic, only S1 will open for full flow when a delivery starts. S2 will only open for dwell (slow) flow. This logic is the same as in the LCR-II and LCR 600 registers.
- Single/Dual Option Preset Valve - This logic can be used when using single or dual stage preset valves. With this logic both S1 and S2 will energize at the start of a delivery. If an S1 close time is set, S1 will drop out when the S1 close is reached and S2 will remain open until the final closure amount reached.


### Two-Stage Preset Valve Logic

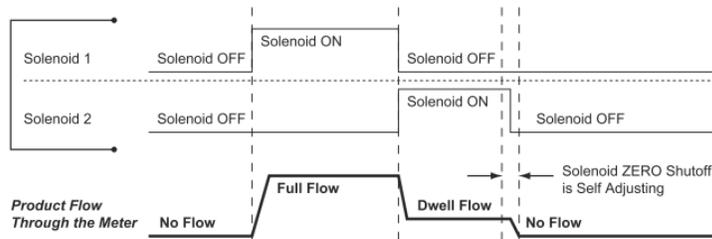

### Single/Dual Option Preset Logic (Single Stage)

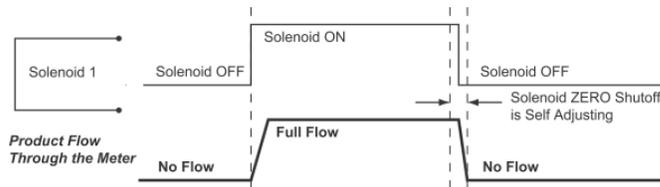

### Single/Dual Option Preset Logic (Dual Stage)

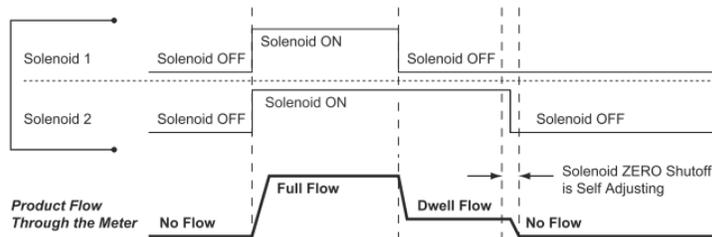

**Minimum Meter Flow Rate** – A numeric text field that can be used to set a minimum flow rate value for the Register. If the delivery flow rate drops below this value for a duration greater than the Minimum Flow Rate Timeout value, the delivery will be paused by the register and an error message generated to inform the user that the Minimum Flow Rate was detected. **(Maximum - 6 numeric characters)**

**Maximum Meter Flow Rate** – A numeric text field that can be used to set a maximum flow rate value for the Register. If the delivery flow rate rises above this value for a duration greater than the Maximum Flow Rate Timeout value, the delivery will be paused by the register and an error message generated to inform the user that the Maximum Flow Rate was exceeded. **(Maximum - 6 numeric characters)**

**Minimum Meter Flow Rate Timeout** – A numeric text field that can be used to set the timeout duration for the minimum flow rate. This is the amount of time, in seconds, that the minimum

flow rate can drop below the set Minimum Flow Rate valve before the delivery pauses. **(Maximum setting - 15 sec)**

**Maximum Meter Flow Rate Timeout** – A numeric text field that can be used to set the timeout duration for the maximum flow rate. This is the amount of time, in seconds, the maximum flow rate can rise above the set Maximum Flow Rate valve before the delivery pauses. **(Maximum setting - 15 sec)**

### Meter (3/3)

The screenshot displays three overlapping screens from the LCR.iQ setup interface:

- METER (2/3)**: Shows IO Board # (0), Valve Logic Type (Two-Stage Preset Valve), and Minimum/Maximum Meter Flow Rate fields.
- METER (1/3)**: Shows IO Board # (0), IO Board UID (323335343437511700570034), and IO Board Name.
- METER (3/3)**: Shows Meter ID, Pulser Input Type, Flow Direction, Pulser Input Mode Between, Decimal Digits, Temperature, and Temperature Offset. It also displays a list of parameters:
 

Maximum Filter Flow Rate:	800.0 gal/min
dP Shutdown Value:	15.0 psi
Weight:	0.0 lbs
Weight Unit of Measure:	lbs
Density:	0.000 lbs/gal
Density Offset:	0.000 lbs/gal
Density Unit of Measure:	lbs/gal
Minimum Flow Rate for Density:	0.0 gal/min

**Maximum Filter Flow Rate** – A numeric only text field that is used along with a Liquid Controls Differential Pressure Transducer (dP) to calculate corrected differential pressure based on the maximum rated flow rate of the filter vessel. This field should be set to the maximum flow rate rated on the filter housing. This option only applies when a Liquid Controls dP transducer is connected to the Register. **(Maximum setting - 9999.9)**

**dP Shutdown Value** – A numeric only text field that should be set to the maximum differential pressure allowed (JIG Standard 15 PSI) when using the Liquid Controls Differential Pressure Transducer. This option only applies when a Liquid Controls dP transducer is connected to the Register. The maximum setting is 60 psi (The Current JIG standard is 15 PSI)

**Weight** – A read only field that displays a weight value when using Liquid Controls Automatic Density Sensor or entering a manual density value into the Register. **Weight Unit of Measure** – A list box field that is used to select the unit of measure for weight when using this feature.

Options:

- kgs - Kilograms
- lbs - Pounds

**Density** – A numeric only text box that can either have a density value manually entered or automatically generated using the Liquid Controls Automatic Density Sensor. The maximum setting is 999.999

**Density Offset** – A numeric only text box that can be used to add an offset to the value measured by the Automatic Density Sensor when installed. This setting has a fixed adjustment of +/- 0.8 units. **Density Unit of Measure** – A list box field that is used to select the unit of measure for density when using this feature.


Options:

- kg/L - Kilograms per Litre
- kg/bbl - Kilograms per Barrel
- kg/gal - Kilograms per Gallon
- kg/m<sup>3</sup> - Kilograms per Meter Cubed
- lb/L - Pounds per Litre
- lb/bbl - Pounds per Barrel
- lb/gal - Pounds per Gallon
- lb/m<sup>3</sup> - Pounds per Meter Cubed

**Minimum Flow Rate Density** – A numeric text box that can be used to set a minimum acceptable flow rate value when calculating density. This value will vary according to the acceptable minimum flow rate of the meter and should never be set below the minimum rated volumetric flow rated on the meter. **(Maximum setting - 999999 Units)**

## Calibration Settings

Calibration menu options allow the user to set up and calibrate up to 16 specific products for delivery on the Register. There are four Calibration Settings screens.

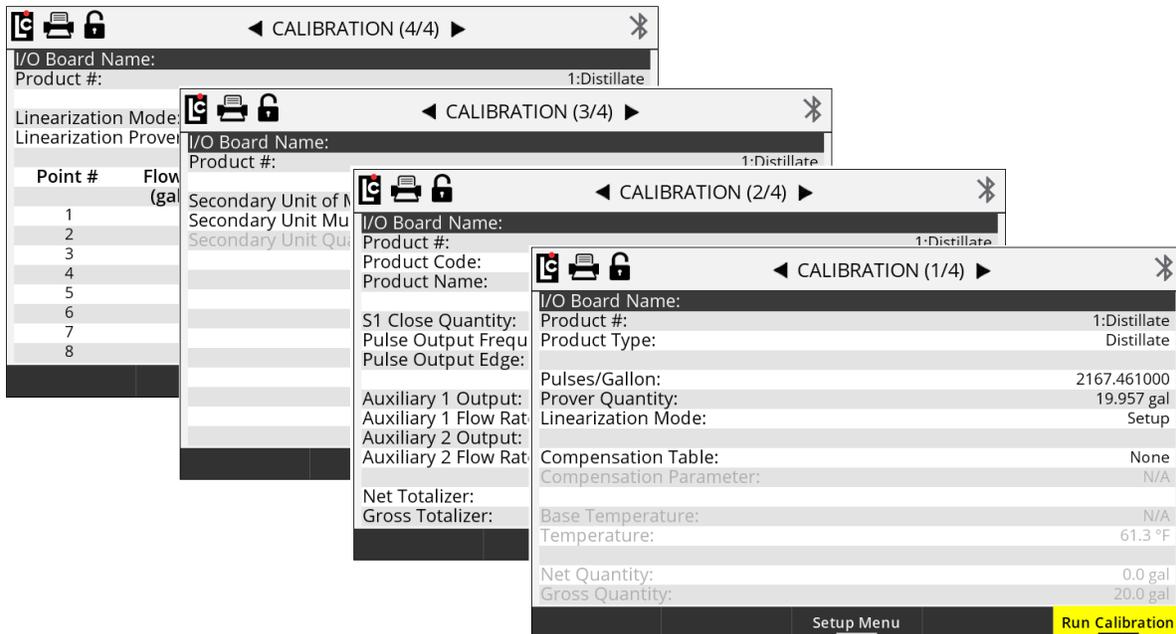

### Calibration (1/4)

**IO Board Name** – A text field that is used to identify the currently selected I/O board in the I/O board # field. The name will display on other screens as well to clearly identify the selected board. **(Maximum - 16 Alphanumeric characters)**

**Product #** – A list box containing the 16 products that are available for setup and calibration with the Register.

Options:

- Products 1-16 are available for setup. Only setup and calibrate products that are to be used by the Register.

**Product Type** – A list box for selecting the product (classification) type. The product type will print on all calibration and diagnostic tickets, and it will designate the Product Type for each Product Number. The product type will also appear on all delivery tickets to assist in identifying the delivered product.

Options:

- Ammonia
- Aviation
- Distillate
- Gasoline
- LPG
- Lube Oil
- Methanol
- Blank

**Pulses/Unit (Gallon, Liter...)** – A numeric-only text field for specifying the number of pulses that equal the whole-unit of measure for the product being setup on the Register. This number is most important, since it directly affects the calibration of the meter. **(Maximum setting - 20000.000000 units)**

**NOTE: A chart of starting reference calibration factors**  can be found in an appendix to this manual. Refer to this chart for assistance in selecting a starting Pulses/Unit number.

**Prover Quantity** – A numeric-only text field for calibrating the product currently being set up.

This field is used during calibration to enter the known prover quantity of a volumetric proving device or master meter. After a calibration run, entering a value into this field will automatically adjust the **Pulse/Unit** field by the percent error that is calculated. Learn more in [Single-point Calibration](#)

**Linearization Mode** – A list box for applying multi-point calibration, when such calibration is in use. Setting this field to **Applied** will activate multi-point calibration, if all parameters have been met for using multi-point calibration. For instructions on how to perform multi-point calibration, see [Multi-point Calibration](#)

**Compensation Table** – A list box for selecting and using temperature compensation on a product that is being set up. See the Compensation Types and Parameter chart below for details of each table.

Options:

- None - Select None if no temperature compensation is to be used
- Table 24 - Select this table for LPG (USA)
- Table 54/54E - Select this table for LPG (Canada and Europe)
- Table 54B - Select this table for Refined Petroleum (Canada and Europe)
- Table 54C - Select this table for Specialized Products (Canada and Europe)
- Table 54D - Select this table for Lube Oil (Canada and Europe)
- Table 6B - Select this table for Refined Petroleum (USA)
- Linear C - Select this table for a general Linear table when measuring Celsius
- Linear F - Select this table for a general Linear table when measuring Fahrenheit
- NH3 - Select this table for measuring Ammonia (Canada)

Product	VCF Type	Parameter	iQ Parameter Range	iQ Fluid temp. range
General (at 15 °C)	Linear	Coefficient of Thermal Expansion (per °C)	0 to 0.0025	-90 °C to 100 °C
General (at 60 °F)	Linear	Coefficient of Thermal Expansion (per °F)	0 to 0.0045	-130 °F to 212 °F
LPG (at 60 °F)	Table 24	Relative Density (Specific Gravity - SG)	0.500 to 0.550	-50 °F to 140 °F
LPG (at 15 °C)	API Table 54/54E	Density (kg/m <sup>3</sup> )	500 to 600	-46 °C to 60 °C
Refined Products (at 60 °F)	API Table 6B	API Gravity (°API)	0 to 85	-50 °F to 200 °F
Refined Products (at 15 °C)	API Table 54B	Density (kg/m <sup>3</sup> )	653 to 1075	-50 °C to 95 °C
Specialized Products (at 15 °C)	API Table 54C	Coefficient of Thermal Expansion (per °C)	0.000486 to 0.001674	-50 °C to 95 °C
Lube Oil (at 15 °C)	API Table 54D	Density (kg/m <sup>3</sup> )	801.3 to 1163.8	-50 °C to 95 °C
NH <sup>3</sup> (at 15 °C)	NH3 Table	Density (kg/m <sup>3</sup> )	617.7 (fixed)	-30 °C to 40 °C

**Compensation Parameter** – A numeric-only field whose parameter is dependent on the Register Parameter Range listed in the compensation table that was chosen in the list box.


**Base Temperature** – A numeric-only field that sets the base temperature according to the Register compensation table that was chosen in the list box.

**Temperature** – A read-only text field that displays the current temperature of the Register—if a temperature probe is connected.

**Net Quantity** – A read-only text field that displays the current net volume of the last delivery made with the Register. If temperature compensation is not active, this field will not increment.

**Gross Quantity** – A read-only text field that displays the current gross volume of the last delivery made with the Register.


**Calibration (2/4)**

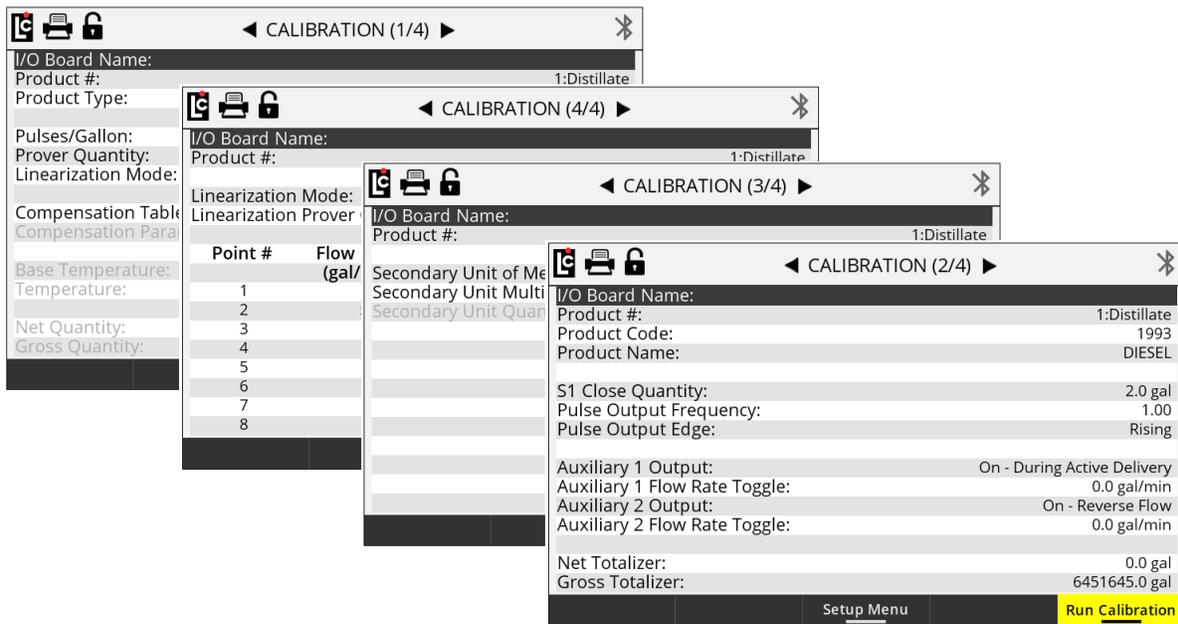

**Product #** – A list box that list the 16 products that are available for setting up and calibrating the Register.

Options:

- Products 1-16 are available for setup. Only setup and calibrate products that are to be used by the Register.

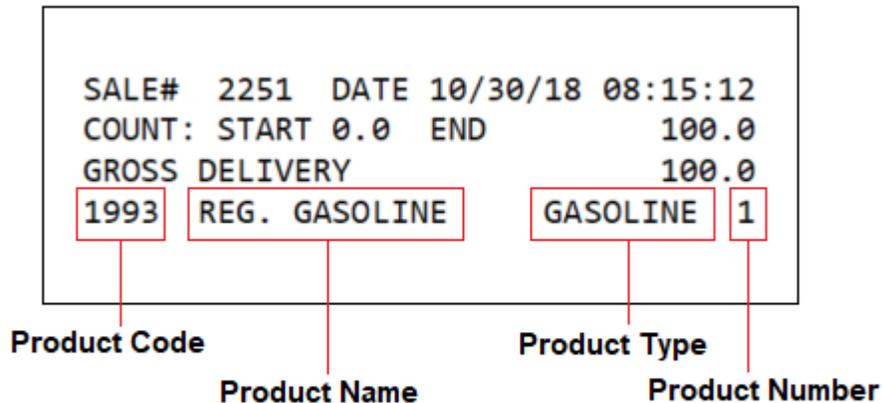

**Product Code** – A text field for identifying the selected product with a code. The product code will appear on all ticket formats to identify the product that was delivered, as shown above. **(Maximum - 5 alphanumeric characters)**

**Product Name** – A text field for identifying the selected product with a specific name. The product name will appear on all ticket formats to identify the product that was delivered as shown above. **(Maximum - 18 alphanumeric characters)**

**S1 Close Quantity** – A numeric text field that is used with 2 stage preset valves. This value sets the number based on the unit of measure that will transition a 2 stage valve from high flow to low flow—for an accurate preset stop. For more information on setting up the S1 closure, see [Setting the S1 Close time](#). **(Maximum - 5 alphanumeric characters)**

**Pulse Output Frequency** – A numeric text field that determines the number of output pulses per unit of measure when using the calibrated pulse output feature of the Register. Setting this field to 1 will result in a 1:1 pulse output to the unit of measure. The maximum value that can be set for this field will vary depending on the decimal setting for the unit of measure and the K-Factor (Pulses/Unit) of the product.

- Hundredths - Max 1% of the K-Factor
- Tenths - Max 10% of the K-Factor
- Whole - Max 50% of the K-Factor

**Pulse Output Edge** – A list box that determines the signal direction of the calibrated pulse output. Toggling this setting can help align the pulse output of the Register with a remote counter or injection system by inverting the output square wave resulting in an opposite adjustment in the signal.

Options:

- Rising - The pulse output square wave from the Register
- Falling - The inverted pulse output square wave from the Register

**Auxiliary 1 Output** – A list box that determines how any digital output that is set to AUX 1 will operate based on the selected product on the Register. There are several features in the Register that can be performed based on the Aux settings to control external components such as pumps, injectors, PTO, throttle, alarms, reset pulse, etc.

Options:

- Off - Any output set to AUX 1 Calibration Mode Settings will always be off (Not active)
- On - Any output set to AUX 1 Calibration Mode Settings will always be on (Active and Sinking to ground)
- On - During Active Delivery - Any output set to AUX 1 Calibration Mode Settings will turn on (Sink to ground) when a delivery is started and will turn off when End is pressed and the delivery is complete.
- On - During Run State - Any output set to AUX 1 Calibration Mode Settings will turn on (Sink to ground) when a delivery is active and not paused. The output will be on when a delivery starts. However, if the delivery is paused by issuing a stop command, the output will turn off until the resume command is given. If the end of delivery command is given, the output will remain off and the delivery will end.
- On - Flow Rate Monitor - Any output set to AUX 1 Calibration Mode Settings will be on when a delivery is active, however it will deactivate if the flow rate meets or exceeds 40 units/time. If the flow rate does not meet or exceed 40 units/time, the output will remain on.

- On - Reverse Flow - Any output set to AUX 1 Calibration Mode Settings will be off when a delivery starts, and will only turn on when the register detect flow in the negative or reverse direction.
- Reset Pulse/Delivery Start - Any output set to AUX 1 Calibration Mode Settings will output a short pulse at the start of a delivery that is used with 3rd party remote counters that require a reset pulse to reset to 0.0.
- Toggle Flow Rate - Any output set to AUX 1 Calibration Mode Settings will turn on once the flow rate of the Register exceeds the set flow rate point in the Auxiliary 1 Flow RateToggle field below.
- Calibrated Scaled Pulse Output - Any output set to AUX 1 Calibration Mode Settings will output a calibrated pulse output—that is scaled according to the Pulse Output Frequency setting in the calibration mode.

**Auxiliary 1 Flow Rate Toggle** – A numeric text field that can be used to program a flow rate set point when the Aux 1 is set to Toggle flow rate. Auxiliary 1 remains activated above the set flow rate value and deactivates when the flow rate falls below the value.

A common use for this output is an air operated valve (AOV) on the pump. When the flow rate value is attained, the AOV is activated and switches the pump from low-bypass pressure mode to full-flow fuel mode (high bypass pressure). When the flow rate falls below the set value, the AOV deactivates and the pump returns to low flow. Another possible use for this output is the engine throttle—to increase and decrease the RPM of the pump shaft. In applications such as these, the flow rate value in this field should be below the low flow rate with a fully open nozzle or the output will never turn on. Another application of this field is to set the value as a maximum flow rate at which a valve should be closed. On fuel delivery trucks, flow valves often activate an internal switch at approximately 18 GPM (68 LPM). The value of this field is unique to each product.

**Auxiliary 2 Output** – A list box that determines how any digital output that is set to AUX 2 will operate based on the selected product on the Register. There are several features in the Register that can be performed based on the Aux settings to control external components such as pumps, injectors, PTO, Throttle, alarms, and reset pulse.

Options:

- Off - Any output set to AUX 2 Calibration Mode Settings will always be off (Not active)

- On - Any output set to AUX 2 Calibration Mode Settings will always be on (Active and Sinking to ground)
- On - During Active Delivery - Any output set to AUX 2 Calibration Mode Settings will be on (Active and Sinking to ground) when a delivery is active on the Register. The output will be on when a delivery is started and will not turn off until an end of delivery command is given.
- On - During Run State - Any output set to AUX 2 Calibration Mode Settings will be on (Active and Sinking to ground) when a delivery is active and not paused. The output will be on when a delivery starts. However, if the delivery is paused by issuing a stop command, the output will turn off until the resume command is given. If the end of delivery command is given, the output will remain off and the delivery will end.
- On - Flow Rate Monitor - Any output set to AUX 2 Calibration Mode Settings will be on when a delivery is active. However, it will deactivate if the flow rate meets or exceeds 40 units/time. If the flow rate does not meet or exceed 40 units/time, the output will remain on.
- On - Reverse Flow - Any output set to AUX 2 Calibration Mode Settings will be off when a delivery is started and will only turn on when the register detects flow in the negative or reverse direction.
- Reset Pulse/Delivery Start - Any output set to AUX 2 Calibration Mode Settings will output a short pulse at the start of a delivery that is used with 3rd-party remote counters that require a reset pulse to reset to 0.0.
- Toggle Flow Rate - Any output set to AUX 2 Calibration Mode Settings will turn on once the flow rate of the Register exceeds the set flow rate point in the Auxiliary 1 Flow Rate Toggle field below.
- Calibrated Scaled Pulse Output - Any output set to AUX 2 Calibration Mode Settings will output a calibrated pulse output that is scaled according to the Pulse Output Frequency setting in the calibration mode.


**Auxiliary 2 Flow Rate Toggle** – A numeric text field for programming a flow rate set point, when the Aux 2 is set to Toggle flow rate. Auxiliary 2 remains activated above the set flow rate value, and deactivates when the flow rate falls below the value.

**Net Totalizer** – A numeric text field that shows the current accumulative net totalizer value of the current selected product on the Register. The Net Totalizer uses a non-resettable totalizer.

Cependant, il peut être reprogrammé si nécessaire dans le mode Poids et Mesures (Étalonnage) si une reprogrammation est requise. (**Réglage maximum - 999 999 999 unités**)

**Totalisateur Brut** – Un champ de texte numérique qui affiche la valeur totale brute cumulative actuelle du produit sélectionné sur la caisse. Le totalisateur brut utilise un totalisateur non remisable à zéro. Cependant, il peut être reprogrammé si nécessaire dans le mode Poids et Mesures (Étalonnage) si une reprogrammation est requise. (**Réglage maximum - 999 999 999 unités**)

### Étalonnage (3/4)

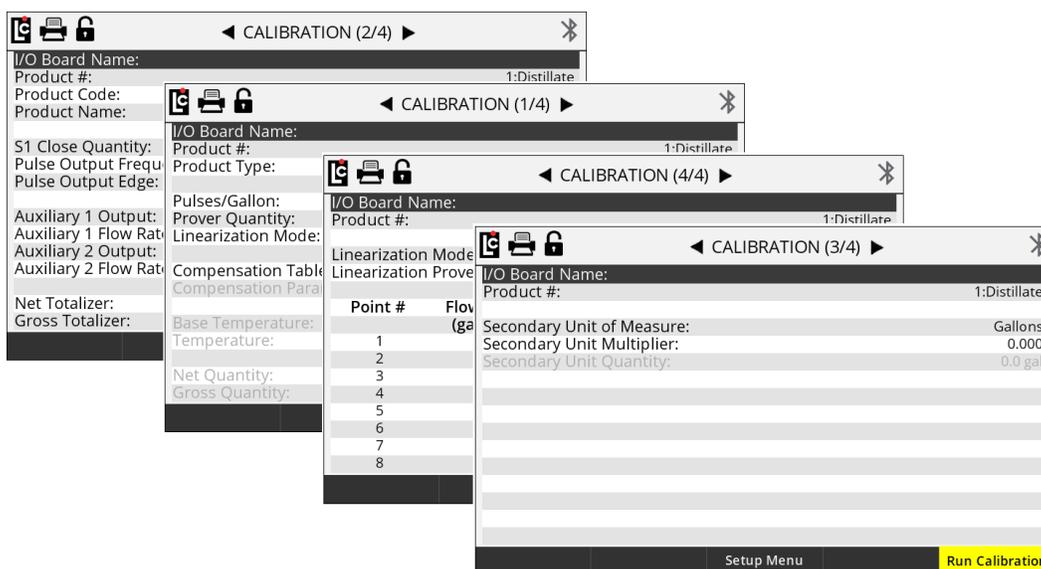

**Produit n°** – Une zone de liste contenant 16 produits disponibles pour la configuration et l'étalonnage du Register.

Options:

- Products 1-16 are available for setup. Only setup and calibrate products that are to be used by the Register.

**Secondary Unit of Measure** – A list box that can be set up to be the unit of measure label when printing or displaying a secondary unit of measure. See the Secondary Unit Multiplier below for setting descriptions.


Options:

- Gallon
- Litre
- Cubic Meter
- LB (Pound)
- KG (Kilogram)
- Barrel
- Other

**Secondary Unit Multiplier** – A numeric text field for applying a multiplying factor to the primary unit of measure in order to obtain a secondary unit of measure. An example of this would be a primary unit of measure in Gallons together with a multiplier of 3.78 that is entered to create a secondary unit of measure in Litres. **(Maximum setting is 9999.999)**

**Secondary Unit Quantity** – A read-only field that will display the secondary unit of measure if programmed for use.

### Calibration (4/4)

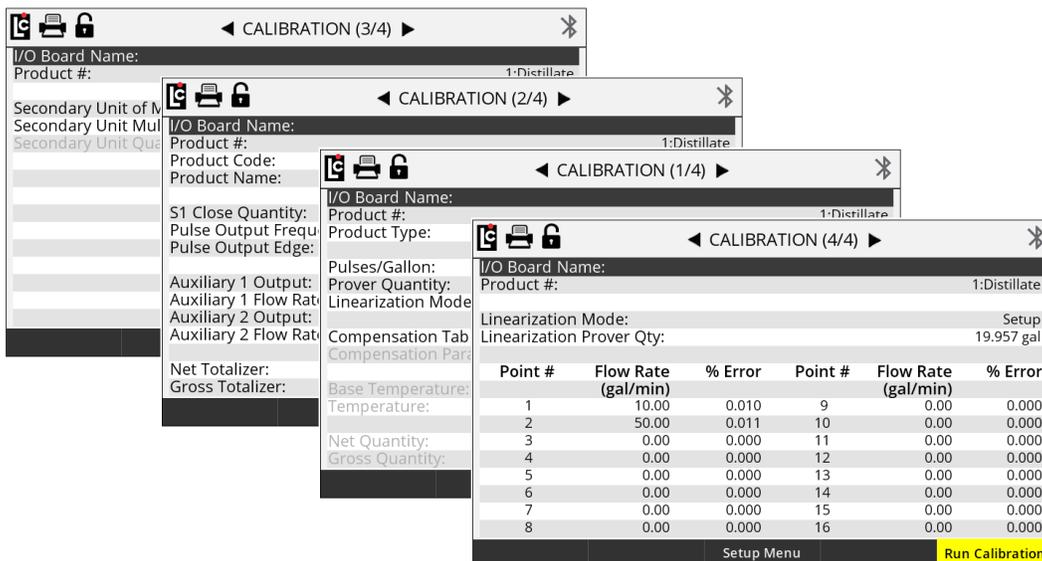

**Product #** – A list box containing the 16 products that are available for setting up and calibrating the Register.

NOTE:

- Products 1-16 are available for setup. Only setup and calibrate products that are to be used by the Register.

The Register provides two means of calibration, single-point [Calibration screen (1/4)] or multi-point calibration [Calibration screen (4/4)].

A “point” corresponds to a particular flow rate along the meter linearity curve. Single-point calibration adjusts one point along the linearity curve to zero percent error—typically at a flow rate representative of a normal delivery. Since meter linearity varies at different flow rates, and every meter behaves differently, the more points of calibration will generally result in more accurate fluid measurement.

Multi-point calibration zeroes the percent error at multiple flow rates (between the rated lowest flow rate and highest flow rate of the meter) in order to zero-out the linearity curve across the rated flow range.

To multi-point calibrate the meter using the Register (Calibration screen 4/4), first select point #1 and enter the lowest flow rate measured. Then, enter the % error measured at that flow rate. Repeat this for points 2 through the highest number of points measured (up to 16 points available).

**Linearization Mode** – A list box for applying a multi-point calibration. Setting this field to **Applied** will activate multi-point calibration—if all parameters are met for using multi-point calibration.

**Linearization Prover Qty** – A numeric only text field for performing a multi-point calibration on the currently selected product on the Register. This field is used during multi-point calibration to enter the known prover quantity of a volumetric proving device or master meter. Following a multi-point calibration run, entering a value into this field will automatically prompt the user to select a point to apply the run to, followed by a prompt to enter the flow rate that was used

during the multi-point calibration run. This action will store the point and flow rate, then calculate the percent error to be applied to the selected point.

**Point** – A list box for selecting the calibration point for the multi-point calibration. The Register is able to perform a multi-point calibration on as many as 16 separate points.

Options:

- Linearization Points 1-16 are available for setup.

**Flow Rate** – A numeric text field for entering the actual flow rate at which a multi-point calibration run was made.

**% Error** – A numeric field that is used when the Register calculates the percent error for a multi-point calibration point. The percent error field can also be manually entered for meter systems that have a factory supplied accuracy curve.

## Security

Security settings are for setting up and configuring the user level security, and also access to the **Clear All** process, software upgrades, Audit Trails and Reset Register Fields feature.

Setting the security level to **Locked** will prevent an operator from accessing fields that the owner may want to restrict.

SECURITY	
Date Format:	MM/DD/YY
Current Date:	11/03/16
Calibration #:	2
User Key:	
User Security:	Locked
Menu Access Protection:	None
Serial ID:	DC7A179679
Reset Register Fields:	No
Factory Key:	
<div style="display: flex; justify-content: space-between; padding: 0 10px;"> <span>Setup Menu</span> <span>Software Update</span> <span>Audit Trail</span> </div>	

**Date Format** – A list box for setting the display and print format for the Register date.

Options:

- MM/DD/YY - Month/Day/Year
- DD/MM/YY - Day/ Month/Year

**Current Date** – A fixed data entry field for setting the internal calendar of the Register– based on the date format field option. The Register will update the calendar automatically according to this setting, and the date can be displayed on screen, printed on the ticket, and recorded in each transaction record.

**Calibration #** – A read-only field that will display the number of times the Register been placed into the calibration mode.

**Serial ID** – A read-only text field that will display the serial number of the main board inside the Register.

**User Key** – A text field for entering a unique key code for unlocking access to specific menus and features in the Register. This user defined key should be set and saved by an owner or maintenance manager for secure access to these menus and features. Contact Liquid Controls customer support if you misplace or forget your user key. The user key is retrievable through the factory-calibration mode only.

**User Security** – A list box for toggling the security level between the locked and unlocked mode.

Options:

- Locked - When set to locked, access to certain screens and menu options is blocked without entering the user key.
- Unlocked - When unlocked, access to all menus is available–while menu options may still be unavailable based on the security current mode of the Register.

**Menu Access Protection** – A list box to configure which menus will require the entry of the user key to access different menus.

Options:

- **Main Menu** - Setting this field to **Main Menu** will require the user to enter a user key to access any of the main menu screens outside of the delivery screens.
- **Setup Menu** - Setting this field to Setup Menu will permit the user to access the main menu. However, it will restrict access to the Setup menu and require a user key for access.
- **None** - No menu level restriction is applied. However, access to screen options may still be unavailable based on the current security mode of the Register.

**Reset Register Fields** – A list box that permits access to the **Clear All** and **Rebuild** functions of the Register when in the Weights and Measures calibration mode. This process should only be performed by a trained technician or Liquid Controls factory representative.


Options:

- **Clear All** - Performing a Clear All will remove all current settings and set all parameters back to factory default (except Time and Date). This process should only be performed by a trained technician or Liquid Controls factory representative.
- **Rebuild** - Performing a rebuild will attempt to repair an Register, in case an area of the Register memory become corrupt. This process should only be performed by a trained technician or Liquid Controls factory representative.
- **No** - Make no selection and return to the Security Mode screen (or press Cancel )


**Factory Key** – Consult Liquid Controls for factory Key information and access.

## I/O Setup

I/O setup screen are used to setup and configure the various available inputs and outputs of the Register, and also activate and deactivate services such as printing, LCP communication, dP, Density and other sensing equipment.

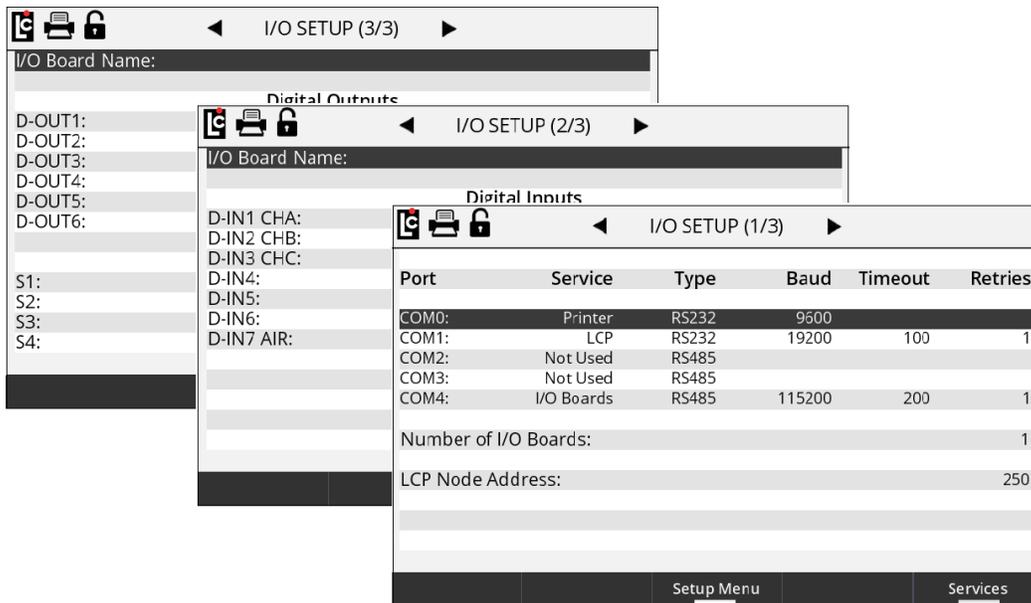

### I/O Setup (1/4)

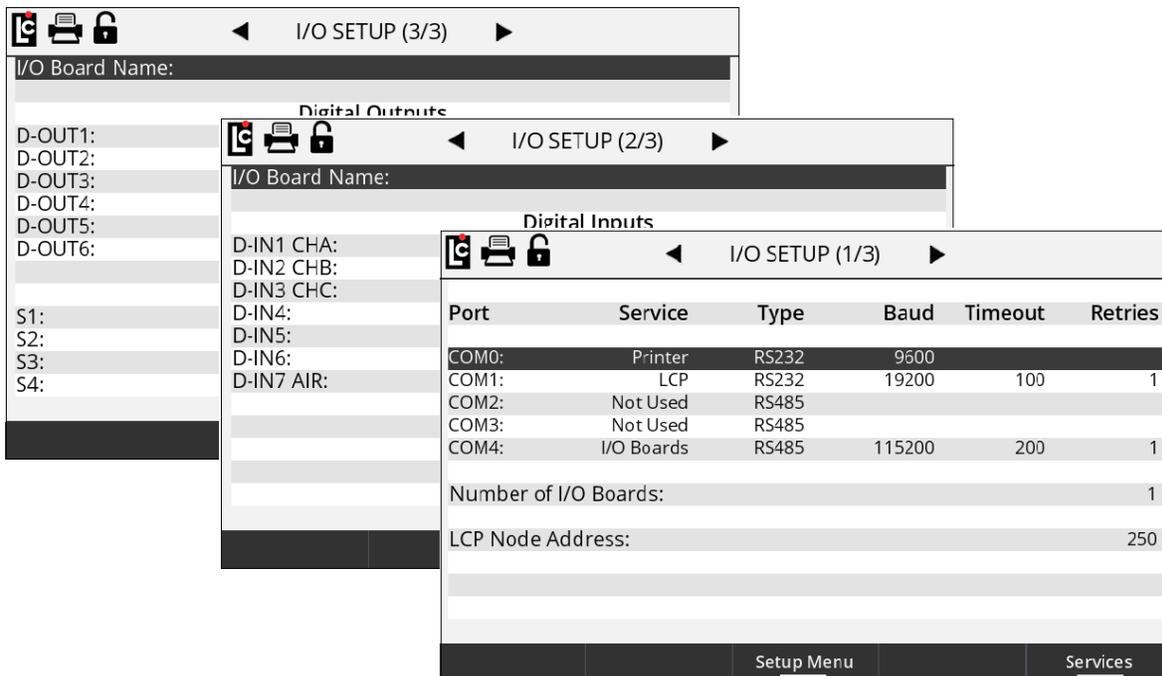

**COM0 – COM4** – The Register has five serial ports. When one of the ports is selected, prompts for the Service, Type, Baud, Timeout, and Retries are shown. **COM4** must be used with the I/O Boards service.

**Service** – A list box that permits the user to select between the services that have been enabled on the **Services** screen. **Not Used** can be selected to disable the use of the port.

**Type** – A list box permits the user to select between the types of serial communication for the serial port.

Options:

- RS232
- RS485

**Baud** – A list box that permits the user to select the baud rate for the serial port.

Options:

- 2400
- 4800
- 9600 – This is the standard baud rate used for the Printer service.
- 19200
- 57600
- 115200 – The I/O Boards service must use this baud rate.

**Timeout** – A numeric text field that shows the amount of time, in milliseconds, the Register will wait for a response, once a serial signal is sent out the port. This field is only used for the LCP and LCR.iQ Network services.

**Retries** – After a serial signal has been sent out the port, if a response isn't seen within the Timeout, this is the number of attempts the Register will attempt to retry sending the serial signal. This field is only used for the LCP and LCR.iQ Network services.

**Number of I/O Boards** – The number of I/O boards within the Register. The current limit is 1.

**LCP Node Address** – A numeric text field that shows the node address of the Register when communicating with a 3rd party device via the LCP service. (**Minimum setting – 1, Maximum setting - 250**)

**Allow Pump & Print with LCP Host** – A list box permits the user to select how the LCP service will behave.

Options:

- No – When the register receives an LCP message, the Start key will be disabled for 60 seconds. If the user wants to begin a delivery, it must be done through the 3rd-party device.
- Yes – The Start key on the register will not be disabled during LCP communication. This allows the user to always be able to begin a delivery from the register screen.

## I/O Setup (2/4)

The screenshot shows the 'I/O SETUP (2/4)' screen. At the top, there are icons for Bluetooth, a printer, and a lock, along with a back arrow, the title 'I/O SETUP (2/4)', and a forward arrow. A Wi-Fi signal icon is in the top right corner. The screen is divided into sections for Bluetooth and Wi-Fi settings.

Bluetooth	Service	Timeout	Retries
BT0:	Not Used		

Wi-Fi	Service	Port	Timeout	Retries
WF0:	Not Used			
WF1:	LCP		500	1

Below the Wi-Fi table, there are settings for Wi-Fi Mode, SSID Name, SSID Password, and Wi-Fi Direct IP Address:

Wi-Fi Mode:	Wi-Fi Direct
SSID Name:	LCRIQ-f8-dc-7a-18-92-e5
SSID Password:	f8dc7a1892e5
Wi-Fi Direct IP Address:	192.168.1.30

At the bottom of the screen, there are two buttons: 'Setup Menu' and 'Apply Wi-Fi'.

**BT0** – The register has one Bluetooth port. Choosing this option will display prompts for the **Service** , **Timeout** , and **Retries** .

**Service** – A list box that permits the user to select between the services that have been enabled on the Services screen that can be used over Bluetooth.

Options:

- Not Used – This disables the use of Bluetooth.
- LCP – LCP communication over Bluetooth.
- Printer – To be used with a Bluetooth printer.

**Timeout** – A numeric text field that shows the amount of time, in milliseconds, the register will wait for a response, once a serial signal is sent out the port. This field is only used for the LCP service.

**Retries** – After a serial signal has been sent out the port, if a response isn't seen within the **Timeout**, this is the number of attempts the register will attempt to retry sending the serial signal. This field is only used for the LCP service.

**WF0 & WF1** – The register can establish two wi-fi connections. Choosing this option will display prompts for the **Service**, **Timeout**, and **Retries**.

**Wi-Fi Mode** – A list box permits the user to select which Wi-Fi Mode to use.

Options:

- Wi-Fi Direct – Does not require a wireless access point, allowing two devices to establish a direct Wi-Fi connection without requiring a wireless router.
- Wi-Fi Stationary – Requires a wireless access point to act as a hub for Wi-Fi communication.

**SSID Name** – An alpha-numeric text field that shows the service set identifier for the register.

Other devices will use this name to identify the register and establish a connection. The default value begins with "LCRIQ", which is followed by a unique identifier.


**SSID Password** – An alpha-numeric text field that shows the password for wireless communication with the Register. Other devices will use this password to establish a connection.

**Wi-Fi Direct IP Address** – The IP address of the register when in Wi-Fi Direct Mode.

**Apply Wi-Fi** – The user must press **Apply Wi-Fi** for any changes to the **Wi-Fi Mode**, **SSID Name**, **SSID Password** , or **Wi-Fi Direct IP Address** to take effect.


### I/O Setup (3/4)

- Digital Inputs 1-7

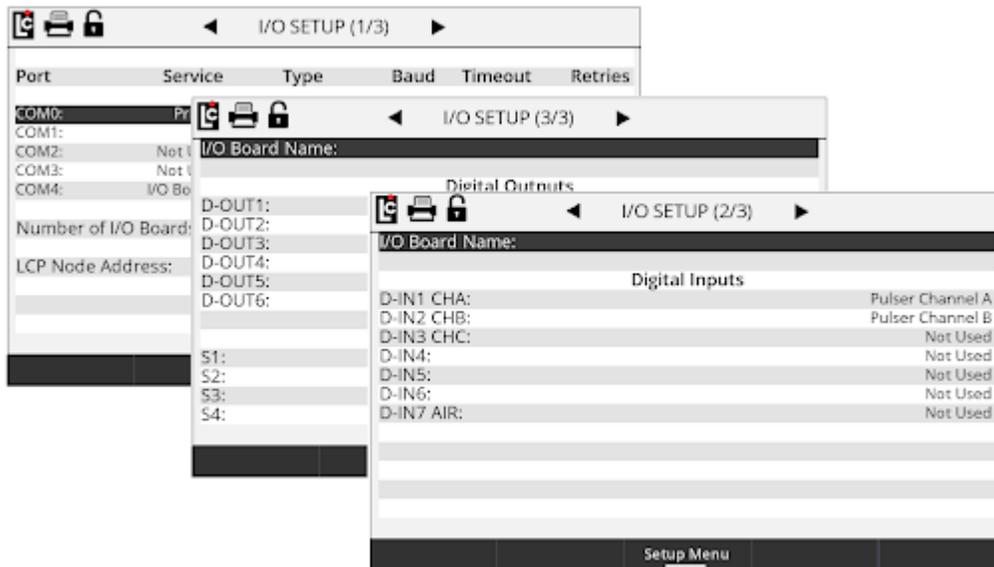


### I/O Setup (4/4)

- Digital Outputs 1-6 and Solenoid Outputs S1-S4

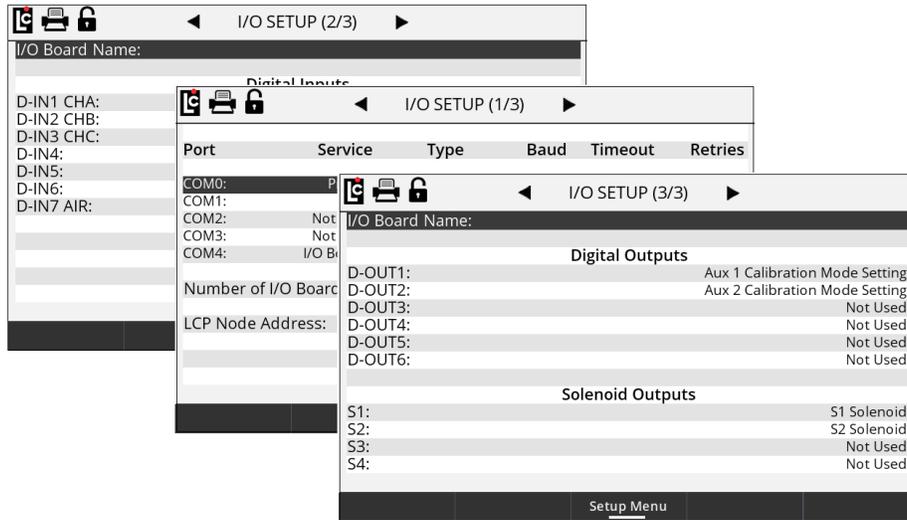


## Customize Home Screen

The Custom Home Screen menu permits the user to setup and configure various parameters that appear on the home screen. In these screens, the user can select from a series of default profiles that are common to an industry, or create a custom arrangement from the available drop-down selection options for each line.

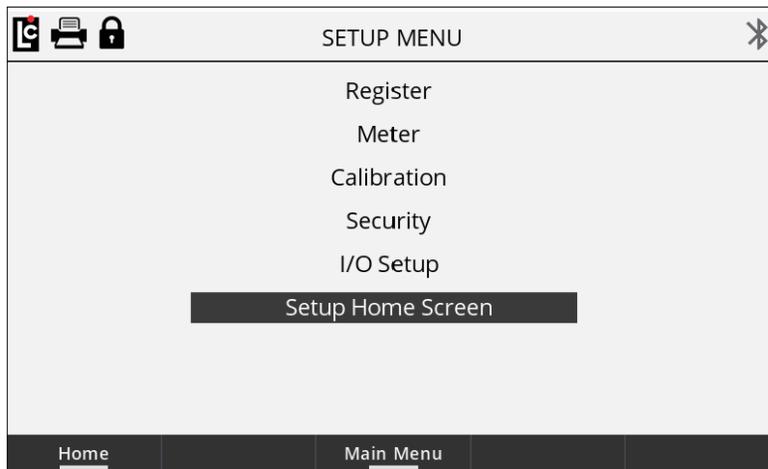


Customize Home Screen can be used to configure up to 12 parameters inside one or two data columns displayed on the idle and active delivery screens.

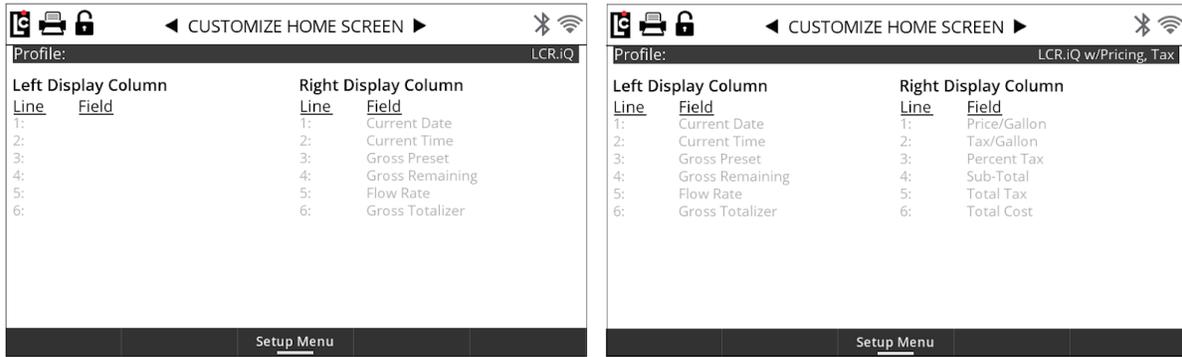


The following preconfigured display profiles are available on the Register:


**Preconfigured LPG Profiles are basic screen profiles that are tailored to propane industry standards and available options.**

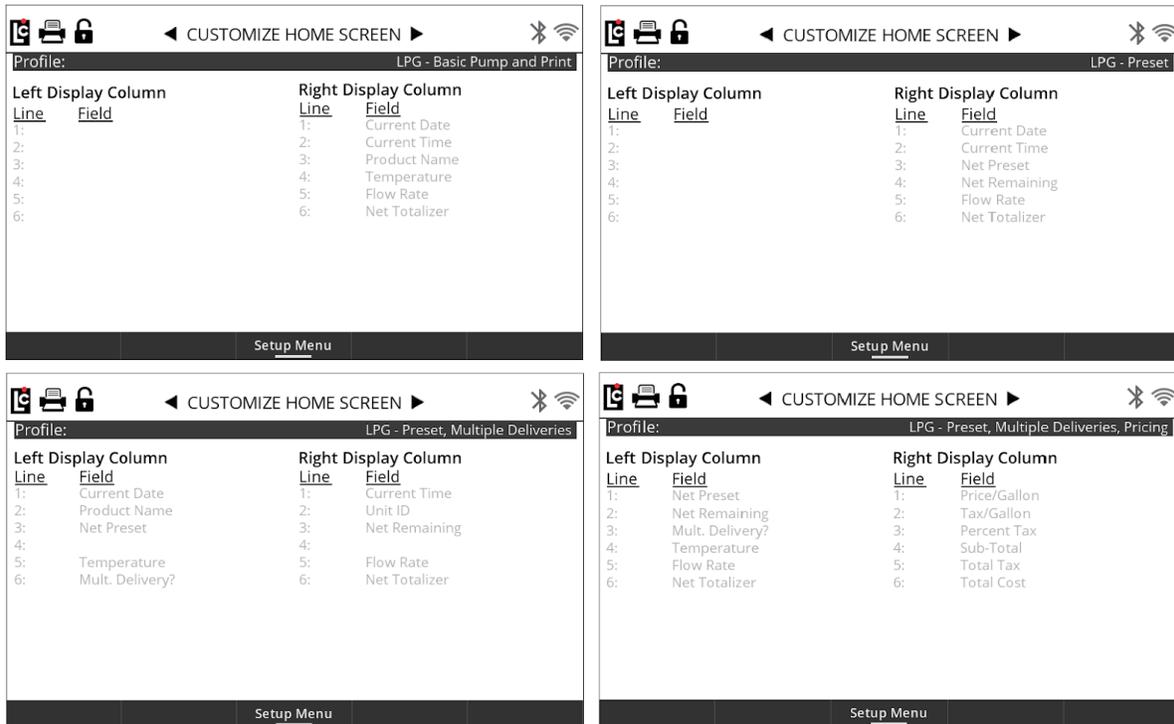


**Preconfigured Refined Profiles are basic screen profiles that are tailored to aviation refined fuel industry standards and available options.**

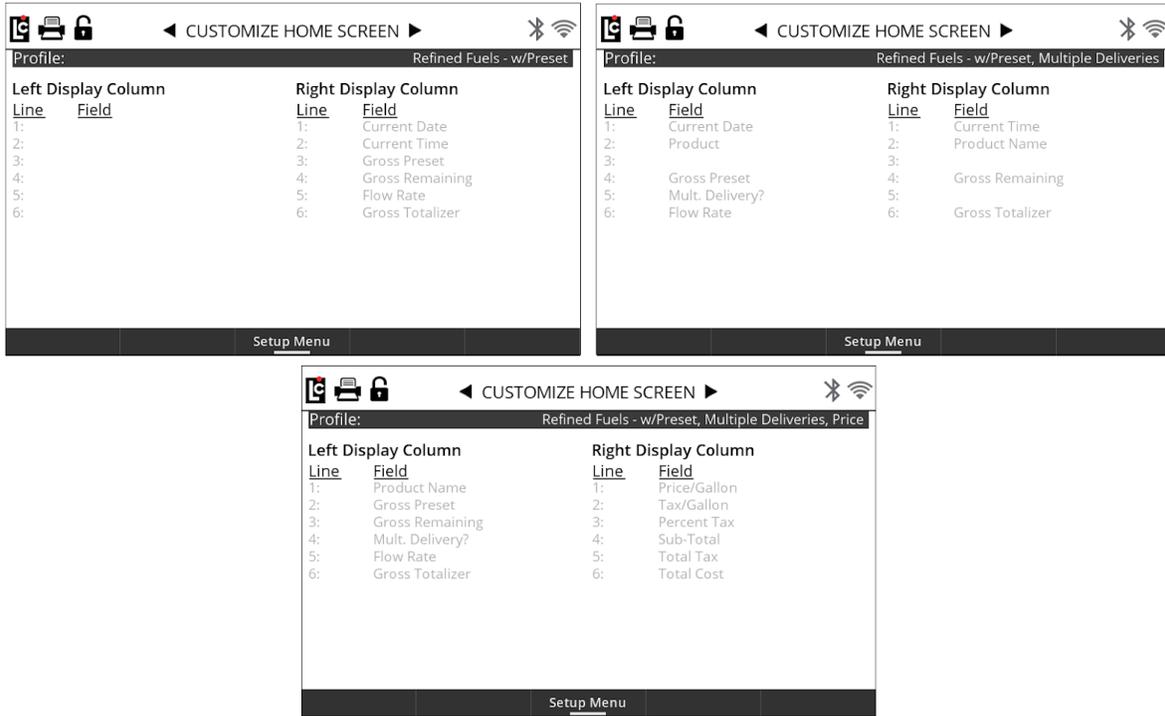

**Preconfigured Aviation Profiles are basic screen profiles that are tailored to aviation industry standards and available options.**

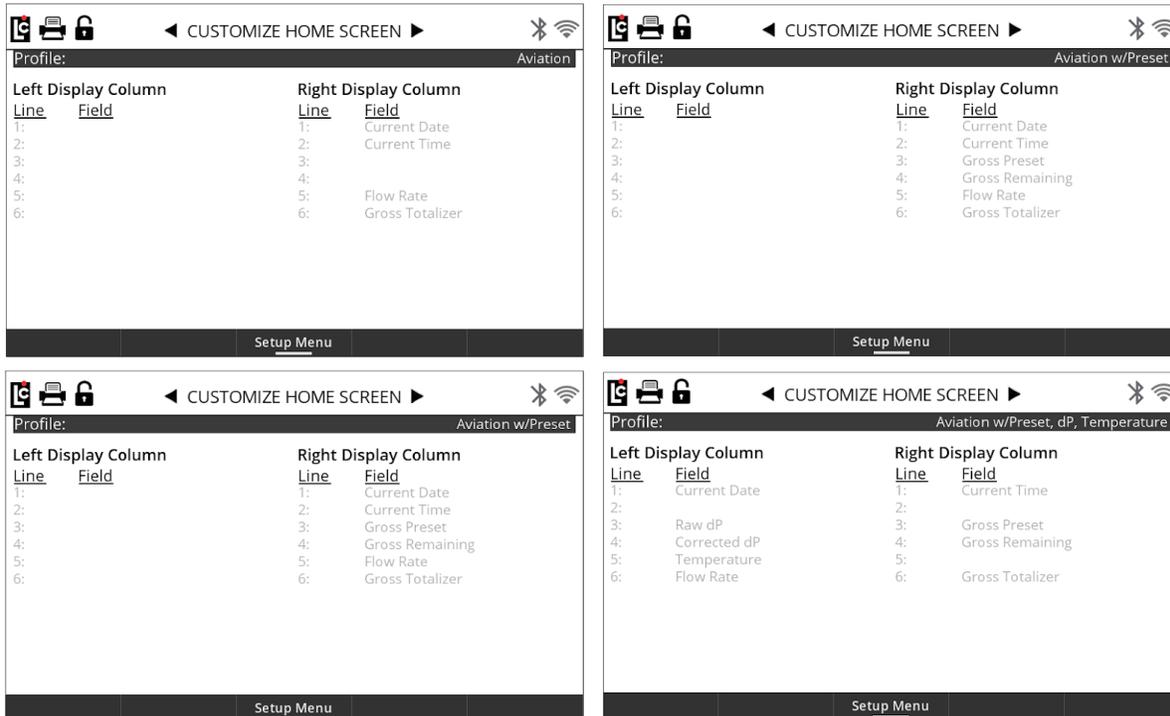


**Custom Home Screen design** can be done by selecting the **Custom** profile options. Use the navigation keys to scroll the cursor to the column (Left or Right) and field (1-6) then press **OK** to view the available list of fields that can be displayed. Once a selection is made, pressing the **OK** button again will confirm the selection. That field will now appear in the selected column on the home screens.

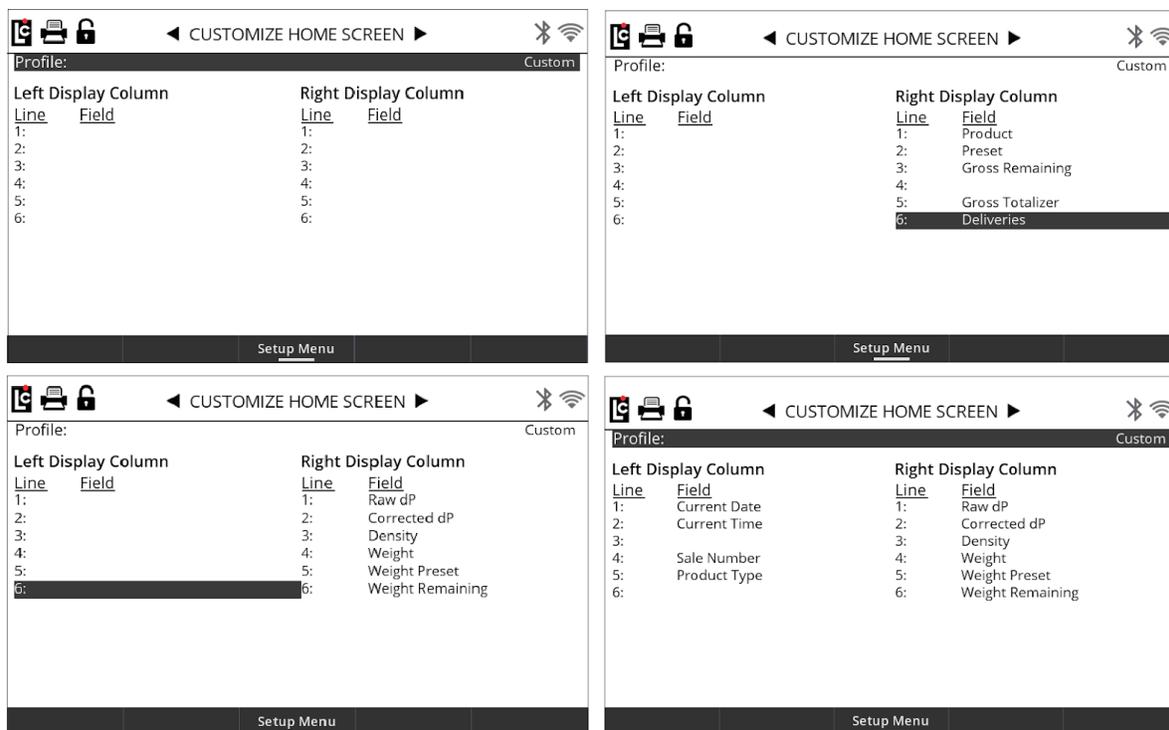


## Configure Delivery Setup


This setup configures the delivery options available when the setup delivery function key is displayed. The Register has several preconfigured delivery setup options that correspond to the specific industries. Or, a custom configuration can be setup using the custom option. There are two basic Register screens as well as pre-configured screens for common markets such as **LPG** , **Refined Fuel** and **Aviation** . There is a direct correspondence between the profile selected in the **Customize Home Screen** menus and the **Configure Delivery Setup** menus. If you make a profile selection in **Customize Home Screen** , the same profile will be selected in the **Configure Delivery Setup** .

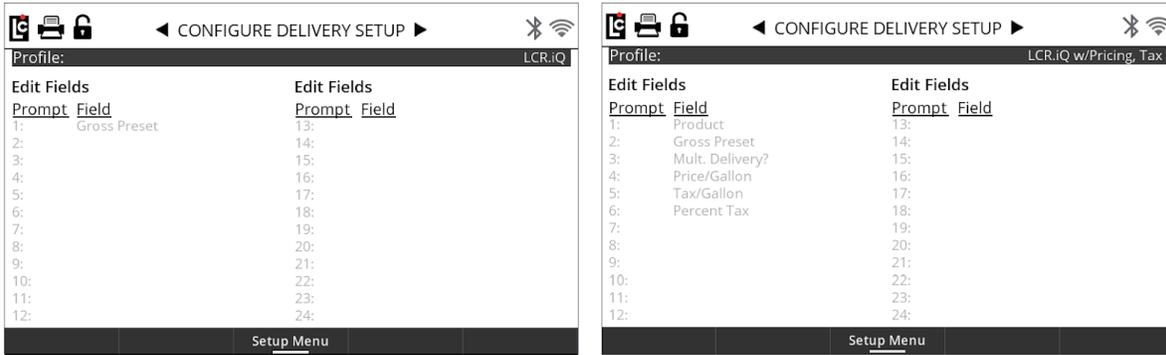


Preconfigured LPG Profiles are basic screen profiles that are tailored to propane industry standards and available options.

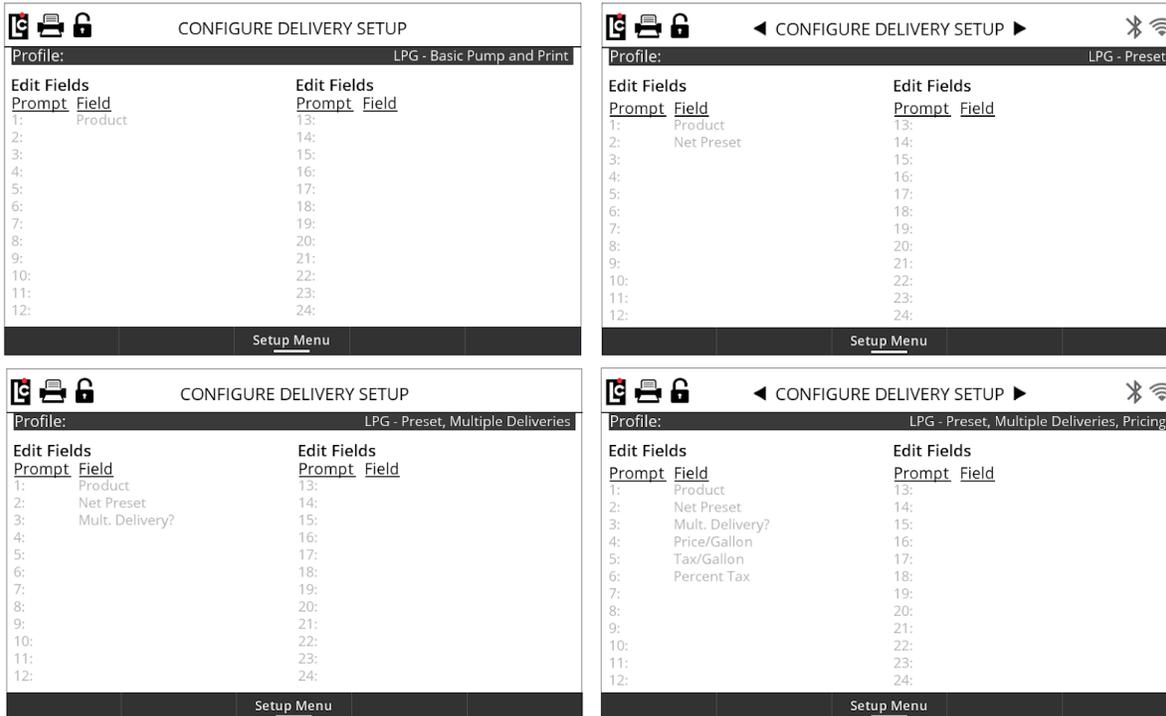

Preconfigured Refined Profiles are basic screen profiles that are tailored to refined fuel industry standards and available options.

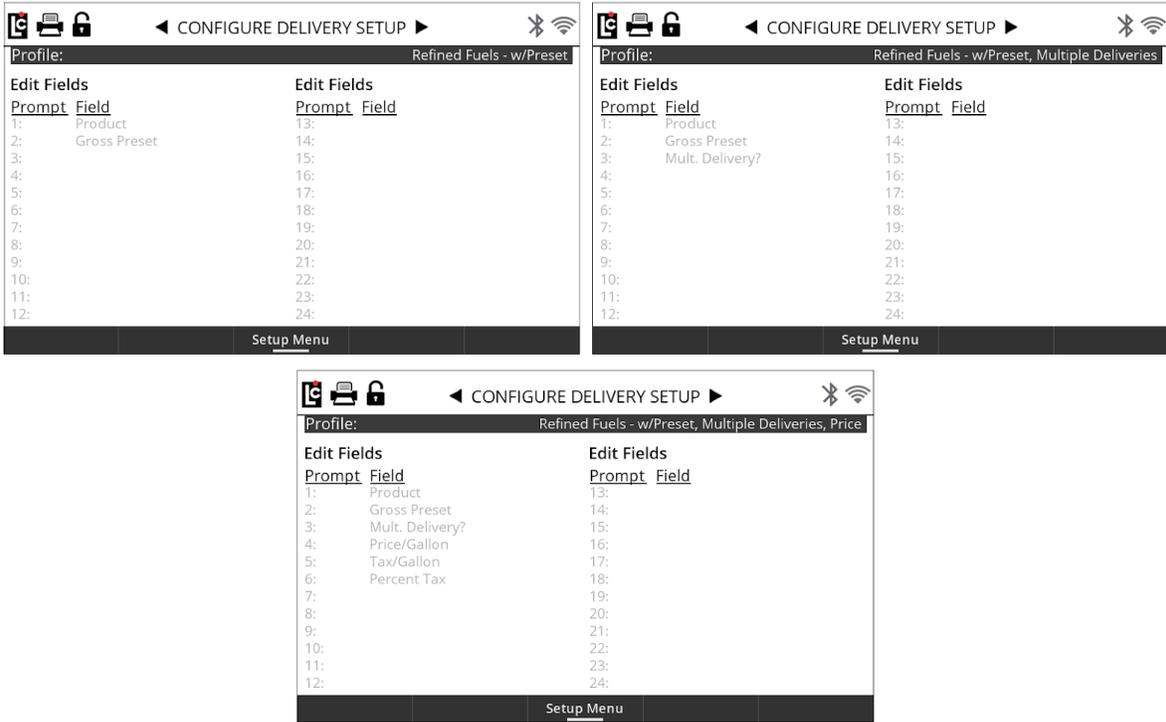

Preconfigured Aviation Profiles are basic screen profiles that are tailored to aviation industry standards and available options.

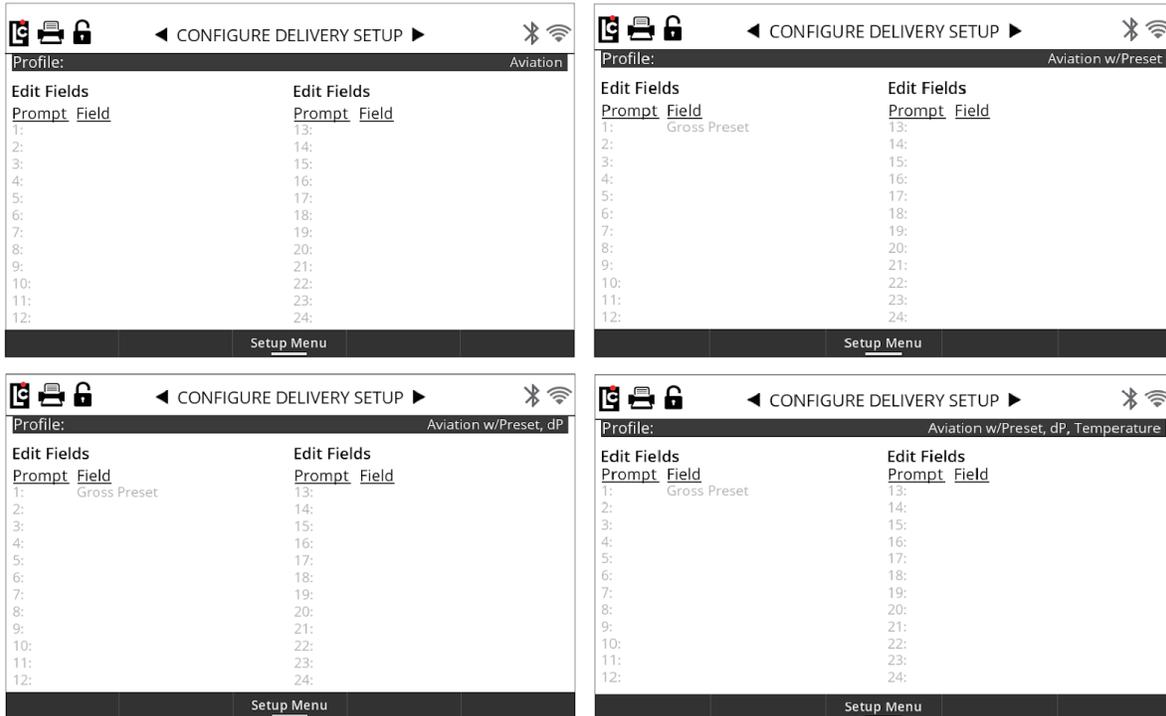

Customizing the Home Screen can be done by selecting Custom profile options:



## Operating the Register

This chapter covers all of the operations that you can perform with the Register:

- Performing a basic delivery  110
- Performing a preset delivery - Preset Key  111
- Using the Info button  111
- Performing a preset delivery - Delivery Setup  112
- Using the hose reset feature  114
- Single-point Calibration  114
- Multi-point Calibration  116
- Setting the S1 Close time  117
- Setting up delivery ticket options  118
- Print the previous ticket  119
- Upgrading the Firmware by USB  120
- Perform a Clear All Procedure  123
- Print a transaction  124
- Setup custom profiles  125
- Print a diagnostic ticket  126

### Performing a basic delivery

Simple and easy. That was the goal when designing the operation of the Register. Making a delivery with the Register can be as simple and easy as pressing the yellow **Start** key.

When you're ready to begin a basic delivery, press the **Start** key. The register will start the reset process by completing a display test, then will reset to zero. At this time if the Register is connected to a flow control valve, the register will send a signal to open the valve and possibly signal a pump to start. With the pump on, fuel will begin to flow through the meter and register on the display. The main delivery screen of the Register will always default to the active fueling screen with large, high resolution digits.

While a delivery is active, it is possible to view detailed delivery information by pressing the **Show Details** button. The detailed information displayed is configurable depending on the

profile which can be configured on any register. A separate how to instruction on setting up a profile is available.

To return to the default fueling screen, simply press the **Full Screen** button and the default delivery screen will now be displayed.

At any time during the delivery, pressing the **Stop** key will pause the delivery by sending a signal to the flow control valve (if installed) to close. You'll also see that the display now has a **Resume** key.

Pressing the **Resume** key will resume the delivery after it is stopped by sending a signal to the flow control valve to open.

To end a delivery, pressing the **End** or **End and Print** button will complete the transaction. If a printer is connected, this will also print the delivery ticket.

Once the delivery is complete, the display will return to the Idle home screen and the Register is ready for the next delivery.

## Performing a preset delivery - Preset Key

Presetting with the Register is simple. There are a few different ways to enter a preset depending on how the register is configured. The most basic way if presets are configured for use, is when presetting is the only delivery setup option. In this case the Register will display a preset function key on the main delivery idle screen. If a preset is desired, simply press the preset function key and a prompt to enter the preset amount will appear on the screen. Use the alphanumeric keypad to type in the preset amount, then press **OK** to accept the amount entered. Start the delivery as normal and your system will stop at the entered preset amount.

## Using the Info button


The **Info** button is a helpful tool for the technician or user that does not have access to the setup and operation manual when setting up and programming the register. Like the manual, the **Info** button will give the user valuable information about the field and available parameters.

Follow these steps:

1. To access information using the Info button, navigate to any available field and press OK to access the field data.
2. Once in the field data, the screen will display a function key labeled Info.
3. Press the Info button and the screen will now display the info details.

List Boxes will display the default setting, current setting, field description and a list of options that may also include detailed description information. Text Boxes will display the default value, current value, minimum and maximum number of characters for the field or minimum and maximum value for the field, accepted data type and a field description.

4. While in an info screen, text data can be entered, however the user must exit the info screen to make a list box selection.
5. To exit an info screen, press the Close Info function key.

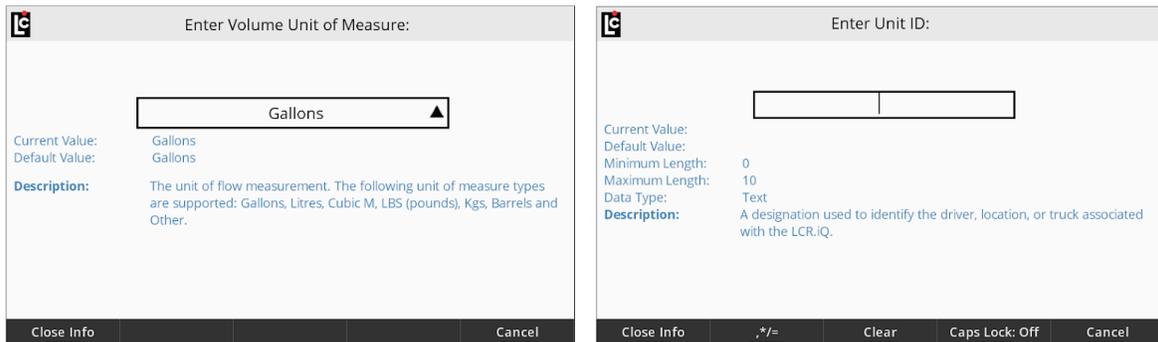

## Performing a preset delivery - Delivery Setup

If you have configured delivery setup prompts including the preset field, press the Setup Delivery function key and follow the on screen prompts until you see Enter Preset. After entering the preset, press OK to accept the amount entered. Continue with any remaining setup delivery prompts, then start the delivery as normal and your system will stop at the entered preset amount.

### Add to a Preset

If you have started a preset delivery and you need to add to the amount, or if you are using the multiple preset type option, it is possible to add to or append the preset amount. Simply press the **Stop** key, then press the **Preset** key and a prompt will be shown on the screen to

enter a new preset volume. Once the new volume is entered, press **OK** to accept the change and then press the **Resume** button to continue fueling.

### Selecting a Preset Type

When selecting a preset type, it is important to know how the register will be used in the preset process. There are 3 options when selecting a preset type: **Clear** , **Retain** , and **Multiple** . The best way to describe each is by example.

#### Clear a Preset

If you are currently using a mechanical preset, the clear option will best match this functionality. A clear preset allows the user to set up a preset amount for a specific delivery. Using the Register keypad, enter the desired preset value by pressing the preset key or if using the delivery setup mode, enter a preset when prompted. Once the preset is entered and the delivery is started, the Register will deliver the set preset amount and complete the delivery once the amount is reached. With electronic registration this means that the end of delivery command will be generated and if applicable, the completed delivery ticket will be generated. This action will set the preset field back to zero (Clear) so the register is ready for the next delivery. If the next delivery also requires a preset, the user will need to enter a new preset amount following the same steps.

#### Retain a Preset

If you are planning to use the Register for batching, the retain preset is the best option for this process. Retain preset allows the user to set a preset amount on the register and retain that amount from delivery to delivery, each time issuing an end of delivery command and resetting the delivery amount back to zero but retaining the preset amount. The preset amount will be retained until an operator sets a new preset amount or sets the preset back to zero for no preset.

#### Multiple Presets

For applications in which you have an initial preset volume, but the final preset volume has not been determined, it is best to use the multiple preset option. Multiple preset allows the user to set a preset amount. However, once the preset is reached, the delivery is paused, not completed. This allows the user to either add more fuel on top of the preset amount or set another preset amount for the remaining amount. This process can be repeated over again until such time that a final amount is determined. Once the final amount is determined, the

user issues the end of delivery command by pressing the **End / Print** key terminating the delivery. At this time, the preset amount is set back to zero and the user must set a new preset amount, if desired, for the next delivery.

## Using the hose reset feature

The hose reset feature is a Weights and Measures requirement that allows the user a one-time reset of the register back to zero after a delivery is started in order to charge the hose with system pressure. This assumes that the amount to charge the hose is within the hose reset features limits. The reason this feature is permitted, is that following a preset delivery, the meters preset valve (on the outlet of the meter) closes once the preset amount is reached, yet the fueling nozzle at the end of the hose is still open. This causes a small void in the packing of the hose because of the loss of system pressure. To use this feature, start a delivery on the Register and engage the pump (apply system pressure)—while leaving the nozzle closed. If the meter jumps up a few tenth of a unit, this is because there was a void in the hose that has now been filled by adding the pump pressure. If the amount is less than 1 gallon (or 4 Liters), the user is able to reset the register back to zero by pressing the **Stop** key, followed by the **Hose Reset** key. At this time, the register will be reading zero again and by pressing the **Resume** key, the user can continue with normal delivery functions.

## Single-point Calibration

Single-point calibration of the Register is designed to be quick and easy. Calibration of the Register should be performed by a qualified Weights and Measures authorized or factory trained technician. Typical calibrations are done using a volumetric prover, master meter or inline SVP (Small Volume Prover). Ensure that all equipment is properly connected and lines fully charged (pressurized) between the meter and proving device. To begin the calibration process, you must first put the Register into the calibration mode by removing any existing seal wire and loosening the calibration bolt on the side of the register housing approximately 5-6 turns. If a ticket printer is connected to the Register, make sure a ticket is in place and the printer is ready. If connected, the register will print a calibration ticket showing the current calibration information of the register. If no ticket printer is connected or the calibration ticket is not desired, press the **Abort** key to skip the print process.

Once in the calibration mode, select the calibration option from the main menu to access the calibration screens. If this is the first calibration for the register or if the calibration factor (Pulse/Unit) has not been set for the meter that the register is connected to, it is recommend to set a starting factor. This will save time and additional calibration runs as the register adjusts the meters accuracy closer to zero error. See the recommended starting calibration factor chart in the appendix of this manual for typical starting calibration factors and enter this value in the Pulse/Unit field.

**NOTE:** Unit label will vary depending on the unit of measure that has been set up in the Register.

In the calibration screens you will notice that there is a yellow key labeled Run Calibration .

Pressing this key will begin the actual calibration process by performing the meter screen test and resetting the delivery volume to 000.000. At the same time, the Register will provide the permissive signal to the valve output to allow flow through the meter.

**NOTE:** All deliveries in the calibration mode have a resolution to the thousandths decimal place allowing for very precise calibration.

Flow product into or through the proving device at the normal (nominal) operating flow rate for the meter until the desired calibration volume is reached. When calibrating the flow meter, it is recommended that the calibration volume be greater than or equal to the high end flow rate rating of the metering device (100 GPM = Minimum 100 Gallon prover).

Once the desired calibration volume is reached, pressing the **End** button will return the Register back to the calibration menu screens. Navigate the selection bar to the **Prover** quantity field, and press **OK** . Enter the exact volume to the greatest detail that was registered on the proving device, then press **OK** . At this point, the Register will calculate the percent of error between the prover and register, and automatically adjust the Pulses/Unit accordingly.

Repeat this process until the Register register is within local Weights and Measures tolerance or company regulations. Once all calibrations are made and setup is complete, tighten the calibration bolt on the side of the Register housing. If a ticket printer is connected and a final calibration ticket is desired, insert a ticket before exiting calibration mode and a ticket will print when prompted.

## Multi-point Calibration

Multi-point calibration is used to improve the accuracy of a flow meter across its full rated flow rate range, resulting in a much flatter accuracy curve. Accuracy of a flow meter tends to lessen at lower flow rates however repeatability of the meter remains consistent. A meter might not be perfectly accurate at low flow rates, but it is inaccurate by the same amount each time. Multi-point calibration takes advantage of the steadfast repeatability of a Liquid Controls meter by identifying the amount of inaccuracy and correcting it with a linearizing algorithm during deliveries. In order to apply the linearizing algorithm, the degree of error for points along the accuracy curve must be identified by making a number of deliveries at different flow rates into a volumetric prover. Multi-point calibration is very beneficial for meter systems that experience a wide range of flow rates (for example, trucks that fill tanks of varying sizes) and for meter systems that have recently undergone maintenance or other alterations that could change the accuracy curve itself.

To begin the multi-point calibration process, ensure the Register is in the calibration mode by removing any existing seal wire and loosening the calibration bolt on the side of the register housing approx 5-6 turns. If a ticket printer is connected to the Register, make sure a ticket is in place and the printer is ready. If connected, the register will print a calibration ticket showing the current calibration as well as any existing multi-point calibration information of the register. If no ticket printer is connected or the calibration ticket is not desired, press the **Abort** key to skip the print process.

Before starting the process of multi-point calibration, ensure that the initial single point calibration has been completed and the meter is accurate and repeatable. All multi-point factors are based on this initial calibration.

Once in the calibration mode, select **Calibration** from the main menu to access the calibration screens. Scroll to Calibration screen 4/4 to access the multi-point calibration fields.

In the Calibration screen 4/4 you will notice that there is a yellow key labeled Run Calibration.

Pressing this key will begin the actual calibration process by performing the meter screen test and resetting the delivery volume to 000.000. At the same time, the Register will provide the permissive signal to the valve output to allow flow through the meter.

**NOTE: All deliveries in the calibration mode have a resolution to the thousandths decimal place allowing for precise calibration.**

Begin to flow product into or through the proving device ensuring that the metering system is delivering at the flow rate for the desired multipoint calibration point.

Once the desired multi-point calibration volume is reached, pressing the **End** button will return the Register to the Calibration menu screen 4/4. Navigate the selection bar to the Linearization Prover Quantity field, and press **OK** . Enter the exact volume to the greatest detail that was registered on the proving device, then press **OK** . The Register will automatically display a prompt to select which of the 16 available multi-point fields to perform the calibration. Next the Register will display a prompt to the flow rate of the previous delivery. Enter the flow rate that was used for the multi-point calibration that was just performed. At this point, the Register will calculate the percent of error between the prover and register for the multi-point and automatically add the % error amount. When complete, the screen will show the point on the screen—together with the flowrate and % error.

Repeat this process, ensuring that the calibration process is accurate, repeatable and within local Weights and Measures tolerance—or company regulations. Repeat this process for each of the different multi-point calibration flow rate points that are desired.

Once all multi-point calibrations are complete, you must apply multi-point calibration. To do this, you must ensure that the difference between adjacent multi-point flow rate errors does not exceed  $\pm .25\%$  or the Register will not allow you to apply multi-point. If all adjacent % error points are within this range, change the **Linearization** mode setting from **Setup** to **Applied** . If within tolerance, the field will remain at **Applied** . If out of tolerance, this field will toggle back to **Setup** and require additional low rate points to further improve the linear accuracy with the  $\pm .25\%$  range.

Once all multipoint calibrations are made and linearization has been applied, tighten the calibration bolt on the side of the Register housing. If a ticket printer is connected and a final calibration ticket is desired, insert a ticket before exiting calibration mode and a ticket will print when prompted.

## Setting the S1 Close time

Setting the S1 closure time properly is an important part of the setup process when using a 2-stage preset valve. If this value is not set correctly, it may cause the Register to over or under

shoot the desired preset volume or cause long delays in reaching the final preset amount. S1 closure rates will depend on the flow rate of the system as well as the viscosity of the product.

A 2 stage preset valve is designed to allow a soft closure of the valve by transitioning from high flow, to low flow before reaching final closure. This process greatly improves the ability of the preset to stop at the exact volume desired. For the most accurate closure, it is best that once the transition from high flow to low flow is made, the flow rate should stabilize at the low flow rate for a few seconds before the final closure is reached.

The best way to figure out a proper setting for the S1 field is to set up the register for a normal, non preset delivery, and then begin flow at the normal operating flow rate. Once at a normal flow rate, press the **Stop** button on the register and watch the register closely to see how many units are measure between normal flow to a full stop. This will help to determine how many units of measure it takes to close the valve fully. Repeat this process two more times and find the average close time.

Next, take the normal flow rate of the meter, calculate 2% of this number (for example, 2% of 100GPM = 2 units), then add this value to the valve close time. This number should represent a closure time that is not too long or too short for the user and allow for accurate preset volumes.

Here's an example: The valve close time of 2 gallons + 2% of normal flow rate is 2 GPM = 4 units to be set in S1 close field.

Enter the calculated value into the S1 close time field and give the system a final test to ensure the Register is now presetting accurately. If you find that the closure time is to long, minor adjustments can be made to the S1 closure.

If you see that the unit is not presetting accurately, or it is over or under-shooting, then increase the S1 closure until the issue is resolved or consult with a Liquid Controls factory trained technician.

## Setting up delivery ticket options


Setup of a delivery ticket on the Register can primarily be completed in the Register screen 3/3. In this screen, the base ticket format can be selected as well as additional printed lines that are available.

The Register has incorporated the 4 most common ticket formats from the past LCR family of tickets as a baseline for setting up a ticket.

- Formulaire long standard - Ce format est basé sur le ticket LCR original ST200. Il contient de nombreux détails sur la configuration du registre, ainsi que les données métrologiques requises pour l'impression sur chaque ticket.
- Formulaire court standard - Ce format est basé sur les tickets compressés LCR disponibles ST202, ST208, ST215, ST221, etc. Ce format a été conçu à l'origine pour tenir dans le petit espace d'impression d'un ticket mécanique pour les clients qui ne souhaitent pas modifier leur conception de ticket. La version de base de ce ticket imprime uniquement les champs imprimés obligatoires minimums des Poids et Mesures.
- Détaillé avec totalisateurs - Ce format reproduit les formats de tickets aviation LCR originaux ST210, ST247, ST250. Ce format contient des informations détaillées sur la livraison et imprime également les totalisateurs cumulatifs de début et de fin, ce qui est courant dans les applications aviation et rack de chargement.
- Formulaire long sans heure - Ce format reproduit le ST203.

## Imprimer le ticket précédent

Depuis l'écran de livraison en veille, il est toujours possible de réimprimer une copie du ticket de transaction pour la livraison précédente. Appuyez sur la touche fonction identifiée **Imprimer dernier ticket**. Ensure that there is a ticket in place and the Register will issue the reprint command and print the ticket.

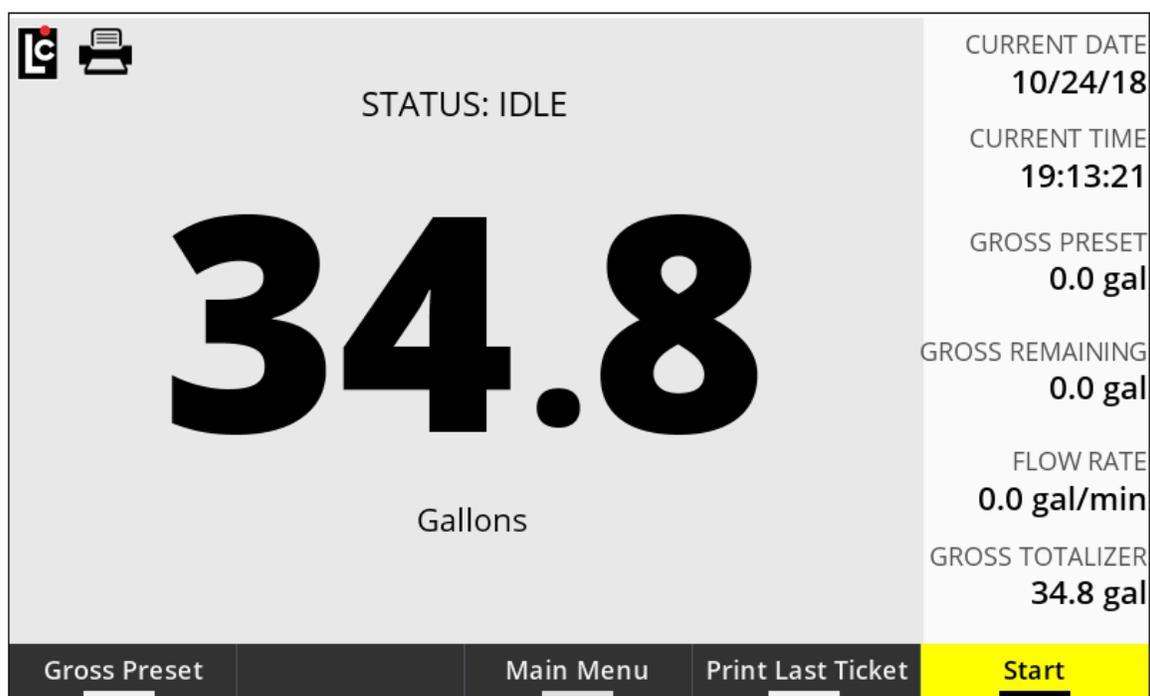


## Upgrading the Firmware by USB


Upgrading the Register firmware is straightforward. This guide explains how to upgrade the firmware with a USB drive.

Follow these steps:

1. Obtain the firmware upgrade from the Liquid Controls website (if available) or a factory representative. The firmware will be named SR1000\_Vx.xx.xx.deb (x.xx.xx represents the current firmware version number).
2. Use a standard USB flash drive for the upgrade and create a folder on the root of the drive called "Import". (USB\Import).

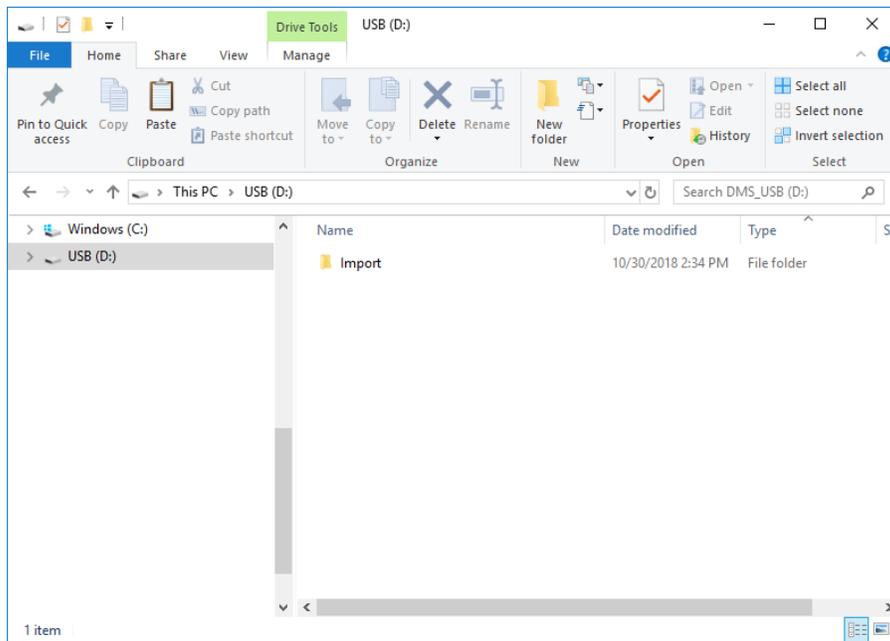


3. Copy the firmware from the computer where it was previously saved directly into the **Import** folder on the USB drive.

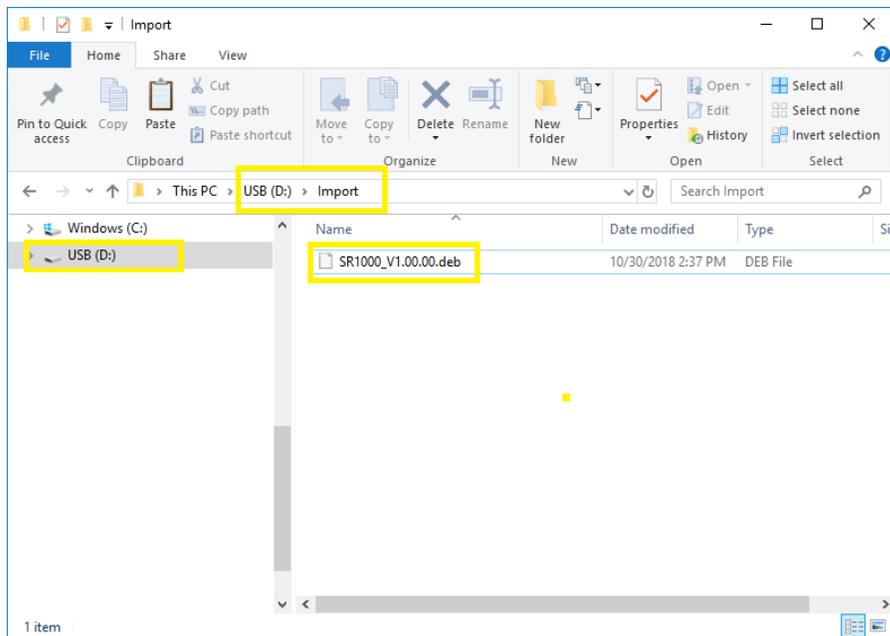

4. Remove the USB drive from the computer.
5. Insert the USB drive into the USB port on the main circuit board of the Register.

6. If power is not already applied to the Register, turn on the power, then continue.
7. Loosen the calibration bolt on the side of the Register until the unit is in the calibration mode and the **Main Menu** is displayed.

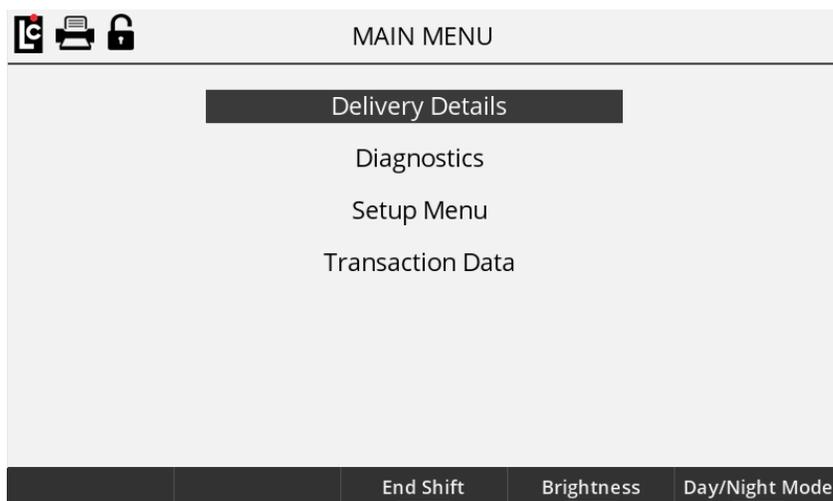

8. Navigate to the Setup Menu option and press OK .



9. Navigate to the Security option and press OK .



10. Press the function key labeled Firmware Upgrade .
11. Select **Copy Files from USB** option and press **OK** . This will copy the firmware from the USB drive to the drive of the Register. However, you must continue to complete the load process. Once loaded, a screen stating **File Load was successful** should appear, then press **OK** .
12. Select Update LCR.iQ (MASTERLOAD.iQ) Firmware and press OK .
13. Select the file to be loaded (SR1000\_Vx.xx.xx) and press **OK** . If you have more than one version of firmware saved on the USB drive, make sure you are selecting the most recent version before pressing OK.
14. Once the firmware is loaded, the Register will automatically reboot.
15. Remove the USB drive from the Register once complete.
16. If the Register requires a **Clear All** following the upgrade, a screen will display suggesting that a clear all be done. As necessary, follow the procedure to [Perform a Clear All](#) .
17. If no Clear All is necessary, the upgrade should be complete at this time.

## Perform a Clear All Procedure

In some cases it may be necessary to perform a Clear All procedure and reset all of the program settings back to the factory default. This is usually done by a factory trained technician that is upgrading software, transferring a board from unit to unit, or if a memory

clear is needed. It is recommended that you save a configuration file of the current program settings or copy all of the settings to a notepad before performing a clear all if you plan to preprogram the unit with the same information.

Follow these steps to perform a clear all:

1. Enter the calibration mode by loosening the calibration bolt on the side of the Register until the Main Menu is displayed on the screen.
2. Navigate to the Setup Menu and press OK .
3. Navigate to the Security option and press OK .
4. Navigate to Reset Register Fields option and press OK .
5. Select Clear All from the list box that is displayed and press OK .
6. A prompt will appear: “Are you sure you want to clear all settings? All settings will revert back to factory defaults including custom settings.”
7. To proceed with the clear all, press the Yes function key and the clear all process will begin.
8. Once complete, all programmable fields (except Time and Date) will be reset to factory default settings.
9. Reprogram the unit as appropriate.

## Print a transaction

The Register is capable of reprinting transaction using the transactions data log screens. The register is able to store a number of transactions in its memory, corresponding with the number of days retained (which is set in the **Logging** setup). The default setting is to retain transaction logs for 365 days before deleting them from memory.

Follow these steps:

1. To reprint a transaction log, press the Main Menu function key to access the main menu. 2. Navigate to the **Transaction Data** option and press **OK** .
3. Use the navigation key pad to scroll between the screen pages or up and down in the screen to select a transaction record. Transaction records are sorted in order by date. Time and sale number are also displayed for quick identification of the record.

4. Select the needed record and press OK
5. The transaction information will now be displayed on the screen for review.
6. If the correct record is selected and a printer is connected to the Register, the user can print the transaction data by pressing the Print function button.
7. Once the ticket is printed, or if this is not the desired record, press the Close function key to return to the transaction list, or press the Home button to return to the Home screen.

## Setup custom profiles

The Register is capable of displaying and prompting for detailed delivery information that may be useful when making a delivery. Customize Home Screen and Configure Delivery Setup can be used to setup preconfigured or custom delivery detail screens, and setup user prompts that can be used to collect additional transaction information.

Both the Customize Home Screen and the Configure Delivery Setup screens share a profile field. The profile field setting will determine the information that is to be displayed on the delivery screen and in the Delivery setup options. Liquid Controls has included several pre-configured profiles in the Register to help simplify the setup process. Optionally, you can create a custom profile.

Follow these steps to select a profile:

1. Place the Register into the calibration mode and access the Main Menu.
2. Navigate to the Setup Menu and press OK .
3. Navigate to Setup Home Screen option and press OK .
4. From either screen 1 ( Customize Home Screen ) or screen 2 ( Configure Delivery Setup ) **the user can select the desired profile from the profile field.**

Follow these steps to set up a custom profile ( Customize Home Screen ):

1. Select Custom from the Profile field list box and press OK .
2. Setup the left and right columns in Customize Home Screen by using the navigation keys to move the selection bar up and down to the desired column and line number, and press **OK** .

3. Select the desired field to be displayed in that location from the list box and then press enter.
4. The selected item should now be displayed in the Customize Home Screen in the desired location.
5. Continue setting up any desired locations with options as needed remembering that it is good practice to keep like items grouped together on the screen for easy viewing by the user.

Follow these steps to set up a custom profile ( Configure Delivery Setup ):

1. Navigate to the Configure Delivery Setup screen by pressing the left or right navigation keys.
2. Select the Custom profile from the Profile list box and press OK .
3. Use the navigation keys to scroll to Prompt 1 and press OK .
4. Select the desired first prompt from the Edit Fields list box remembering that is it good practice to setup the prompts in a logical order that makes sense for the user.
5. Repeat this step for each additional prompt that is desired when making a delivery.

## Print a diagnostic ticket

Printing a diagnostic ticket is very simple with the Register.

Follow these steps:

1. From the home screen, press the Main Menu key to access the main menu options. 2. Navigate to the **Diagnostics** menu option and press **OK** .
3. Ensure you have a ticket in the printer, then press the Print Diagnostic key.

At this point, the Register will print the current diagnostic ticket. Below is an example of a calibration ticket. The number of products that will print out will depend on the number of calibrations that have been set up on the register.

```

CALIBRATION TICKET #          12
CALIBRATION EVENT #           9
CONFIGURATION EVENT #         8
CALIBRATION DATE 11/15/18 14:15:12
METER IDENTIFIER              555214
SERIAL NUMBER                  DC7A179679
CALIBRATION NUMBER 1          LPG
COMP TYPE                      TABLE 24
SG                             0.500
PULSES/GALLON                 2189.125200
TOTAL GROSS                   212354.4 GALLONS
TOTAL NET                     210354.1 GALLONS
SR1000 FIRMWARE               V0.01.00
SR1010 FRIMWARE              V0.01.00
TEMPERATURE                   63.81 DEG. F
TEMP ZERO                     0.00 DEG. F
PULSER FAULTS                 0
FLOW DIRECTION                ->
LCR NODE ADDRESS              250
    
```

```

CALIBRATION TICKET #          12
CALIBRATION EVENT #           9
CONFIGURATION EVENT #         8
CALIBRATION DATE 11/15/18 14:15:12
METER IDENTIFIER              555214
SERIAL NUMBER                  DC7A179679
CALIBRATION NUMBER 1          GASOLINE
COMP TYPE                      NONE
NONE                           0
PULSES/GALLON                 2184.125200
TOTAL GROSS                   212231.4 GALLONS
TOTAL NET                     0.0 GALLONS
CALIBRATION NUMBER 2          DISTILLATE
COMP TYPE                      NONE
NONE                           0
PULSES/GALLON                 2180.122200
TOTAL GROSS                   132231.4 GALLONS
TOTAL NET                     0.0 GALLONS
CALIBRATION NUMBER 3          LUBE OIL
COMP TYPE                      NONE
NONE                           0
PULSES/GALLON                 2103.324200
TOTAL GROSS                   12122.4 GALLONS
TOTAL NET                     0.0 GALLONS
SR1000 FIRMWARE               V0.01.00
SR1010 FRIMWARE              V0.01.00
TEMPERATURE                   63.81 DEG. F
TEMP ZERO                     0.00 DEG. F
PULSER FAULTS                 0
FLOW DIRECTION                ->
LCR NODE ADDRESS              250
    
```

## Appendix A: K-Factor (Pulse/Unit) Chart

Approximate K-Factors and Volumetric Reference Data									
The K-Factor (Pulses/Unit) values listed below are for reference only when initially calibrating a specific meter model and are not to be used as a final K-Factor.									
(All Liquid Controls meter models listed below assume use of the 400ppr pulser with a 1:1 Packing Gland/Face Gear ratio when calculating the Pulses/Unit. For 2:1 ratio, divide the Pulses/Unit by 2)									
	Meter Model	pulses/gal	max gal/min	revs/gal	gal/rev	pulses/L	max L/min	revs/L	L/rev
Liquid Controls M & MA Series	MA-4	4894.8	30	12.2370	0.0817	1293.21	225	3.2330	0.3093
	M-5, MA-5	4894.8	60	12.2370	0.0817	1293.11	225	3.2328	0.3093
	M-5, MA-5 (3:1 Internal gearing)	1631.6	60	4.0790	0.2452	431.07	225	1.0777	0.9279
	M-7, MA-7	2222.0	100	5.5550	0.1800	587.05	380	1.4676	0.6814
	M-10	2222.0	150	5.5550	0.1800	587.05	550	1.4676	0.6814
	M-15, MA-15	823.2	200	2.0580	0.4859	217.49	760	0.5437	1.8392
	M-25	823.2	300	2.0580	0.4859	217.49	1140	0.5437	1.8392
	M-30	296.8	350	0.7420	1.3477	78.41	1325	0.1960	5.1011
	M-40	296.8	450	0.7420	1.3477	78.41	1700	0.1960	5.1011
	M-60 (New Style)	159.3	600	0.3983	2.5107	42.09	2270	0.1052	9.5029
M-60 (Old Style)	101.8	600	0.2545	3.9293	26.90	2270	0.0672	14.8723	
M80	159.3	800	0.3983	2.5107	42.09	3030	0.1052	9.5029	
Liquid Controls MS Series	MS-7	2222.0	100	5.5550	0.1800	587.05	380	1.4676	0.6814
	MS-15	823.2	200	2.0580	0.4859	217.49	760	0.5437	1.8392
	MS-25	823.2	350	2.0580	0.4859	217.49	1140	0.5437	1.8392
	MS-30	296.8	350	0.7420	1.3477	78.41	1325	0.1960	5.1011
	MS-40	159.3	450	0.3983	2.5107	42.09	1700	0.1052	9.5029
	MS-75	101.8	700	0.2545	3.9293	26.90	2650	0.0672	14.8723
	MS-120	63.2	1000	0.1579	6.3331	16.69	3780	0.0417	23.9709
Avery Hardoll BM & DM Series	BM250 (Single Capsule)	666.8	300	1.6670	0.5999	176.17	1140	0.4404	2.2705
	BM950 (Single Capsule)	666.8	362	1.6670	0.5999	176.17	1370	0.4404	2.2705
	BM350 (Dual Capsule)	333.5	660	0.8337	1.1995	88.11	2050	0.2203	4.5400
	BM450 (Dual Capsule)	333.5	542	0.8337	1.1995	88.11	2280	0.2203	4.5393
	BM550 (Dual Capsule)	333.5	602	0.8337	1.1995	88.11	2500	0.2203	4.5400
	BM650 (Triple Capsule)	222.3	793	0.5558	1.7992	58.74	3000	0.1468	6.8100
	BM750 (Triple Capsule)	222.3	793	0.5558	1.7992	58.74	3000	0.1468	6.8120
	DM	263.3	660	0.6583	1.5191	69.57	2500	0.1739	5.7504

Liquid Controls recommends that any meter-mounted register driven by the packing gland/face gear assembly uses the 1:1 Ratio for the highest resolution.  
Max flow rates listed above may vary depending on the meter class and regulatory approval.

## Appendix B: Data Types

For data types D, F, SI, SL, SS, UI, UL, US, and V, the least significant byte of the data is stored at the lowest address with each subsequent byte being stored at the next incremented address. For example, a two byte unsigned short equal to 1,000 and placed at offset 4 in a message or record would be stored as an E8h at offset 4 and a 03h at offset 5.

Type	Name	Description
A	ASCII Character	Contains a one byte ASCII character. The number of characters stored in the field is Size .
AZ	ASCIIZ String	Contains a NUL terminated string of ASCII characters. The maximum length of the string is Size-1 .
B	Boolean	Contains a Boolean value of TRUE or FALSE.
D	Double Floating Point	Contains an eight byte floating point number in IEEE-754 format.
F	Floating Point	Contains a four byte floating point number in IEEE-754 format.
LF	LCR Flow Rate	Contains a signed four byte integer in the range -2147483648 to 2147483647 with an implied decimal point defined by the decimals field in the record.
LL	LCR List	Contains a one byte unsigned integer in the range of 0 to 255.
LV	LCR Volume	Contains a signed four byte integer in the range -2147483648 to 2147483647 with an implied decimal point defined by the decimals field in the record.
SB	Signed Byte	Contains a one byte signed integer in the range -128 to 127.
SI	Signed Integer	Contains a signed integer in which the range is operating system dependent. On 16-bit machines, it is a two-byte signed integer in the range -32768 to 32767. On 32-bit machines, it is a four-byte signed integer in the range -2147483648 to 2147483647.
SL	Signed Long	Contains a four byte signed integer in the range -2147483648 to 2147483647.
SS	Signed Short	Contains a two byte signed integer in the range -32768 to 32767.
ST	Structure	Data element is a structure that varies depending on the structure definition.
UB	Unsigned Byte	Contains a one-byte unsigned integer in the range of 0 to 255.
UI	Unsigned Integer	Contains an unsigned integer in which the range is operating system dependent. On 16-bit machines, it's a two byte unsigned integer in the range 0 to 65535. On 32-bit machines, it's a four byte unsigned integer in the range 0 to 4294967295.
UL	Unsigned Long	Contains a four byte unsigned integer in the range 0 to 4294967295.
UN	Union	Data element is a union, and the contents vary depending on the union definition.
US	Unsigned Short	Contains a two-byte unsigned integer in the range 0 to 65535.



# LIQUID CONTROLS<sup>®</sup>

An IDEX Energy & Fuels Business



105 Albrecht Drive  
Lake Bluff, IL 60044-2242  
1.800.458.5262  
847.295.105  
Fax: 1.847.295.1057  
[www.LCmeter.com](http://www.LCmeter.com)

© 2017 Liquid Controls  
LCIOM\_ONTHEGOWIFIADAPTER V1: 05/17